

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581566

Luminaire Tested: **HCC6S10D010MB-HM60525827-61WWW**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P581566  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6S10D010MB-HM60525827-61WWW  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1004.3 lumens  
Efficiency: N/A  
Efficacy: 101.4 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.06 / 1.14  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P581566  
CATALOG NUMBER: HCC6S10D010MB-HM60525827-61WWW

### Luminous Intensity Polar Plot

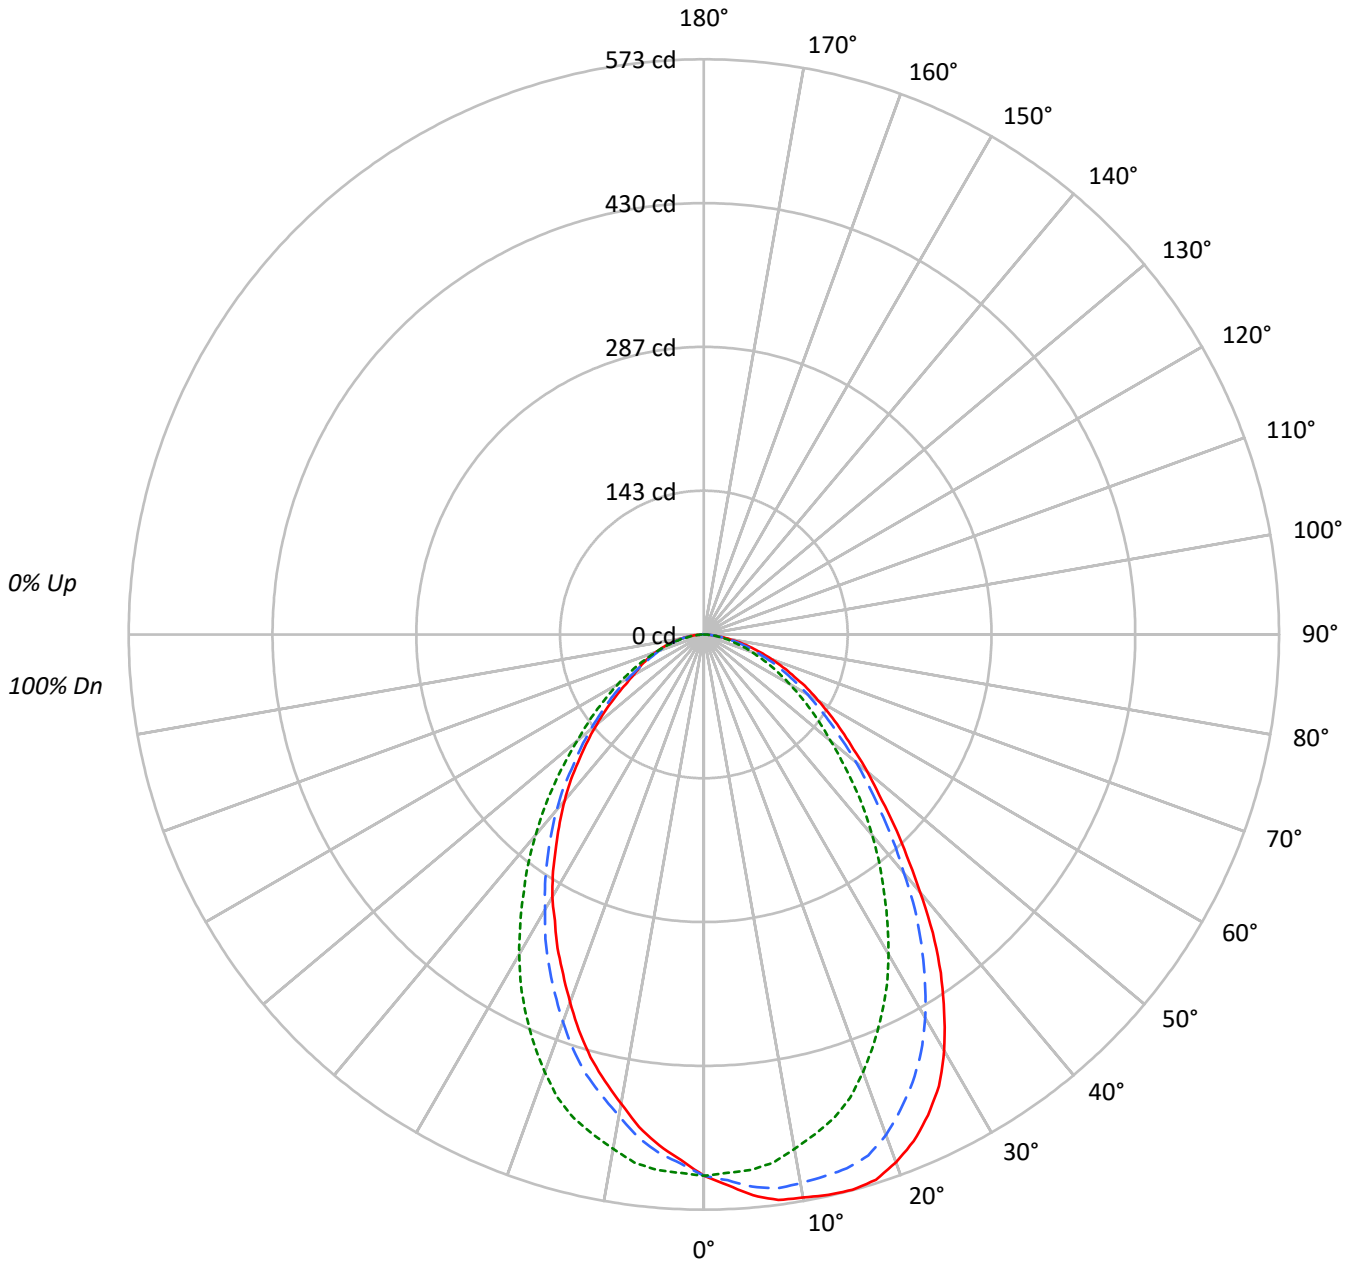

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581566

CATALOG NUMBER: HCC6S10D010MB-HM60525827-61WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	110	106	103	99	108	104	101	98	100	97	95	96	94	92	93	91	89	87								
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76								
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66								
4	87	76	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58								
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51								
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46								
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42								
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38								
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34								
10	58	46	39	34	57	45	38	34	44	38	33	44	38	33	43	37	33	32								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	29559	29559	29559
5°	30866	29468	28115
10°	31707	28963	26413
15°	32497	28332	24745
20°	32635	27052	22729
25°	31955	25326	20850
30°	30315	23288	19111
35°	27532	20934	17146
40°	23988	18642	15422
45°	20754	16312	13560
50°	18132	14046	11880
55°	16019	12348	10188
60°	14396	10822	8837
65°	12894	9417	8561
70°	11524	8014	8014
75°	9997	6757	7519
80°	8019	5714	6851
85°	5472	5032	5913



TEST NUMBER: P581566  
 CATALOG NUMBER: HCC6S10D010MB-HM60525827-61WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	50.7	5.0
10°-20°	140.9	14.0
20°-30°	196.3	19.5
30°-40°	202.3	20.1
40°-50°	167.6	16.7
50°-60°	120.5	12.0
60°-70°	76.7	7.6
70°-80°	39.4	3.9
80°-90°	10.0	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	387.8	38.6
0°-40°	590.1	58.8
0°-60°	878.1	87.4
0°-90°	1004.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1004.3	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	539	539	539	539	539	
5°	561	552	536	518	511	54
15°	573	551	499	454	436	161
25°	528	492	419	365	345	242
35°	411	378	313	271	256	256
45°	268	249	210	184	175	207
55°	168	154	129	115	107	151
65°	99	88	73	63	66	100
75°	47	41	32	33	36	50
85°	9	8	8	9	9	11
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581566

CATALOG NUMBER: HCC6S10D010MB-HM60525827-61WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	539.2	539.2	539.2	539.2	539.2	539.2	539.2	539.2	539.2
2.5°	549.2	547.1	544.3	541.3	536.9	531.9	527.5	526.0	523.9
5°	560.9	558.0	552.2	544.9	535.5	526.0	518.1	513.0	510.9
7.5°	568.2	564.5	556.6	544.3	530.5	516.6	505.0	497.7	494.9
10°	569.6	566.0	555.1	538.4	520.3	501.4	486.9	478.2	474.5
12.5°	571.8	566.7	552.9	533.3	510.1	488.3	470.2	459.4	455.7
15°	572.6	566.7	550.7	526.8	499.2	473.1	453.5	440.5	436.0
17.5°	569.6	563.1	544.3	515.2	484.0	456.4	433.2	419.4	413.6
20°	559.4	552.2	530.5	497.7	463.7	434.7	410.7	396.2	389.6
22.5°	546.4	536.9	512.2	477.5	441.9	411.4	387.5	373.0	366.4
25°	528.3	519.6	492.0	455.0	418.7	386.8	365.0	349.8	344.7
27.5°	507.2	497.1	468.8	431.7	394.7	362.8	341.8	327.9	321.5
30°	478.9	469.4	441.1	404.1	367.9	338.1	316.4	304.7	301.9
32.5°	445.6	437.5	410.0	375.1	340.3	312.8	294.5	282.3	279.4
35°	411.4	402.0	378.1	345.4	312.8	288.1	271.3	260.5	256.2
37.5°	374.5	365.7	345.4	316.4	287.3	264.1	249.6	240.2	235.8
40°	335.2	328.7	309.8	286.6	260.5	240.2	227.9	219.8	215.5
42.5°	299.0	292.4	279.4	257.6	235.8	217.7	206.8	199.6	195.9
45°	267.7	261.9	248.9	230.0	210.4	195.2	183.6	178.5	174.9
47.5°	236.6	233.6	222.0	204.7	186.4	173.4	165.4	159.6	156.8
50°	212.6	209.0	198.1	180.0	164.7	154.5	147.3	142.2	139.3
52.5°	187.9	184.3	174.1	158.9	146.6	137.1	129.8	125.5	122.6
55°	167.6	164.7	153.8	140.0	129.2	121.1	114.7	109.6	106.6
57.5°	148.7	145.8	135.7	122.6	113.2	106.0	100.2	95.8	92.1
60°	131.3	129.2	119.0	106.6	98.7	91.5	86.4	82.7	80.6
62.5°	116.1	111.7	103.0	92.1	84.9	79.1	74.0	71.9	73.2
65°	99.4	97.2	88.5	79.1	72.6	66.8	63.2	64.5	66.0
67.5°	85.6	82.7	75.5	66.8	60.9	56.6	54.4	57.3	58.1
70°	71.9	68.9	62.4	55.1	50.0	47.2	47.2	49.4	50.0
72.5°	58.8	56.6	50.8	44.9	41.3	39.2	40.6	42.1	42.8
75°	47.2	44.9	40.6	35.5	31.9	31.9	33.4	34.9	35.5
77.5°	36.3	34.9	30.5	26.8	25.4	25.4	26.8	27.6	28.3
80°	25.4	24.0	21.7	19.6	18.1	19.6	21.1	21.1	21.7
82.5°	16.6	16.0	14.5	13.0	13.0	13.8	14.5	15.3	15.3
85°	8.7	8.7	8.0	7.2	8.0	8.7	8.7	9.4	9.4
87.5°	2.9	2.9	2.9	2.9	3.6	3.6	3.6	3.6	3.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)