

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581754

Luminaire Tested: **HCC6W15D010MB-HM60525840-61NDW**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P581754
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-3)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W15D010MB-HM60525840-61NDW
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" NARROW DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1522.1 lumens
Efficiency: N/A
Efficacy: 108.7 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1.03
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 14
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581754
CATALOG NUMBER: HCC6W15D010MB-HM60525840-61NDW

Luminous Intensity Polar Plot

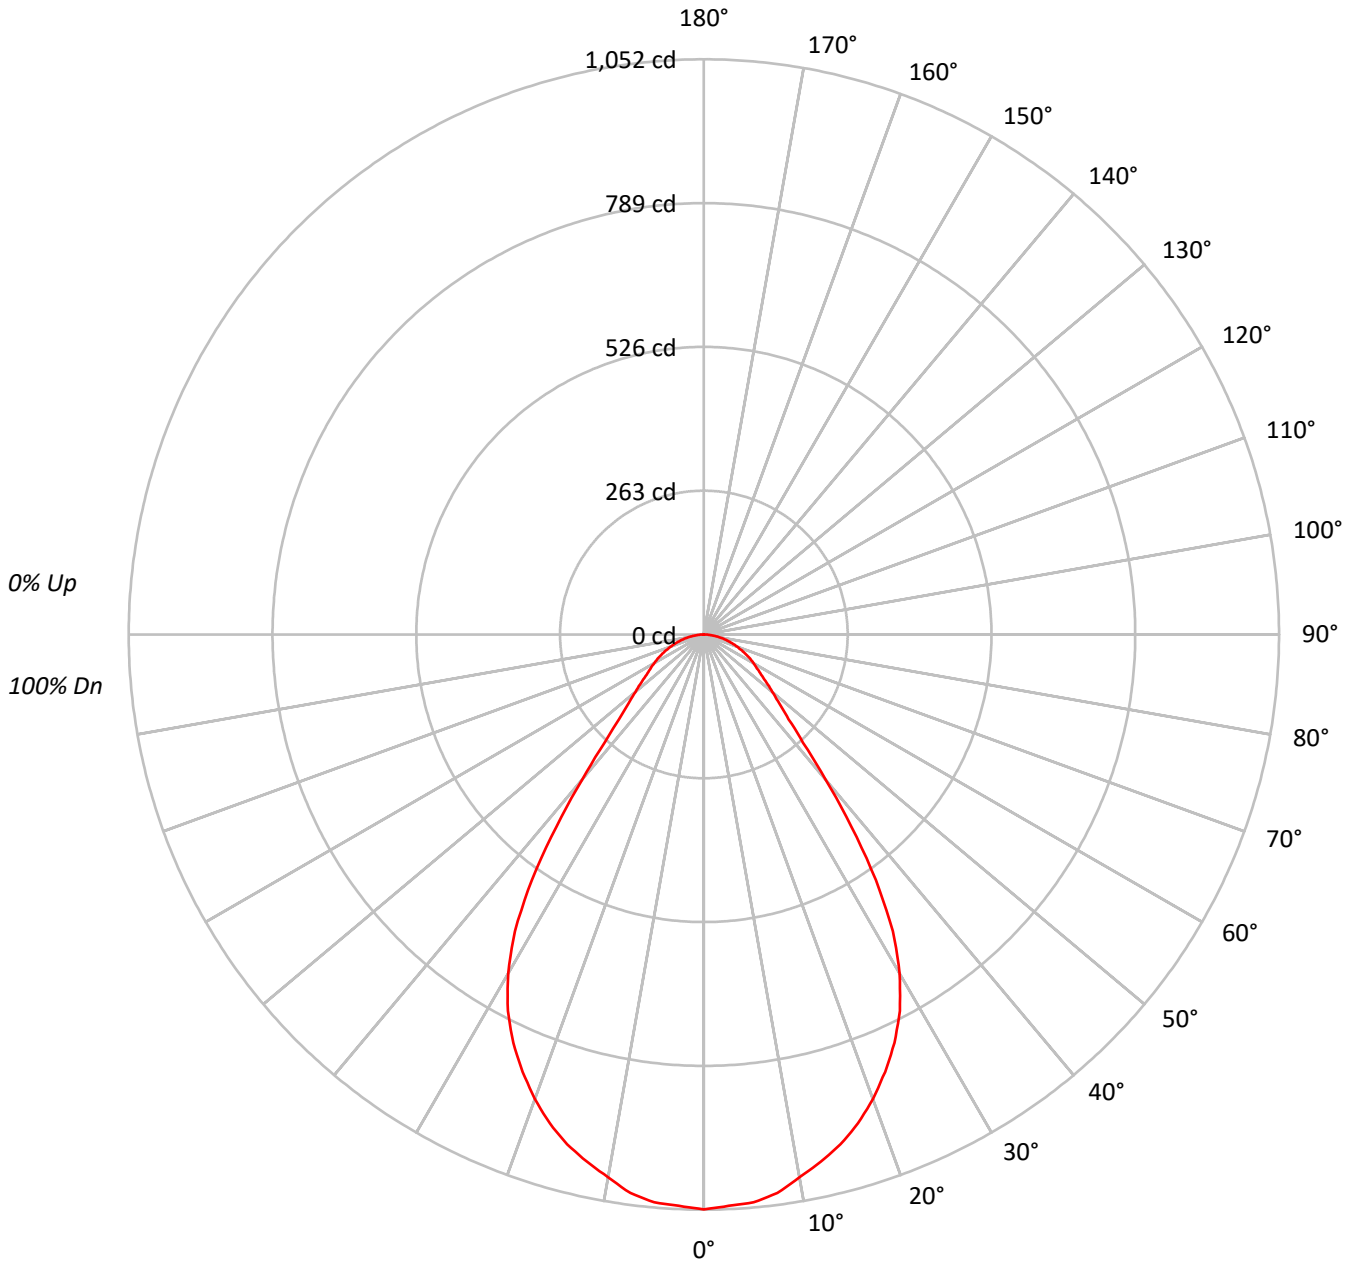

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P581754

CATALOG NUMBER: HCC6W15D010MB-HM60525840-61NDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89	89	89	89
2	104	97	92	87	101	95	90	86	92	88	84	89	85	83	86	83	81	79	79	79	79
3	97	88	82	77	94	87	81	76	84	79	75	81	77	73	79	75	72	70	70	70	70
4	90	81	73	68	88	79	73	68	77	71	67	75	70	66	73	69	65	63	63	63	63
5	84	74	67	61	83	73	66	61	71	65	60	69	64	60	67	63	59	57	57	57	57
6	79	68	61	55	77	67	60	55	66	59	55	64	59	54	63	58	54	52	52	52	52
7	74	63	56	50	73	62	55	50	61	55	50	60	54	50	58	53	49	48	48	48	48
8	70	59	51	46	69	58	51	46	57	50	46	56	50	46	54	49	46	44	44	44	44
9	66	55	48	43	65	54	47	43	53	47	42	52	46	42	51	46	42	41	41	41	41
10	62	51	44	40	61	51	44	40	50	44	39	49	43	39	48	43	39	38	38	38	38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	57649
5°	57374
10°	56111
15°	54790
20°	52732
25°	49872
30°	45323
35°	36687
40°	24739
45°	17002
50°	13927
55°	12196
60°	11534
65°	10883
70°	10226
75°	9722
80°	8808
85°	7737



TEST NUMBER: P581754
 CATALOG NUMBER: HCC6W15D010MB-HM60525840-61NDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	98.4	6.5
10°-20°	271.1	17.8
20°-30°	376.7	24.7
30°-40°	335.4	22.0
40°-50°	178.0	11.7
50°-60°	116.5	7.7
60°-70°	83.5	5.5
70°-80°	48.4	3.2
80°-90°	14.1	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	746.2	49.0
0°-40°	1081.6	71.1
0°-60°	1376.1	90.4
0°-90°	1522.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1522.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1052	
5°	1043	98
15°	965	271
25°	824	377
35°	548	335
45°	219	178
55°	128	116
65°	84	83
75°	46	48
85°	12	14
90°	0	



TEST NUMBER: P581754
CATALOG NUMBER: HCC6W15D010MB-HM60525840-61NDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1051.6
2.5°	1046.0
5°	1042.6
7.5°	1030.4
10°	1008.0
12.5°	987.8
15°	965.4
17.5°	937.5
20°	903.9
22.5°	865.9
25°	824.5
27.5°	776.3
30°	716.0
32.5°	643.3
35°	548.2
37.5°	443.0
40°	345.7
42.5°	268.5
45°	219.3
47.5°	186.8
50°	163.3
52.5°	144.4
55°	127.6
57.5°	115.2
60°	105.2
62.5°	95.1
65°	83.9
67.5°	73.9
70°	63.8
72.5°	54.8
75°	45.9
77.5°	36.9
80°	27.9
82.5°	20.1
85°	12.3
87.5°	5.6
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)