

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582106

Luminaire Tested: **HCC6W25D010MW-HM60525935-61WWW**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P582106  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6W25D010MW-HM60525935-61WWW  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2229.6 lumens  
Efficiency: N/A  
Efficacy: 83.2 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.06 / 1.14  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 26.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P582106  
CATALOG NUMBER: HCC6W25D010MW-HM60525935-61WWW

### Luminous Intensity Polar Plot

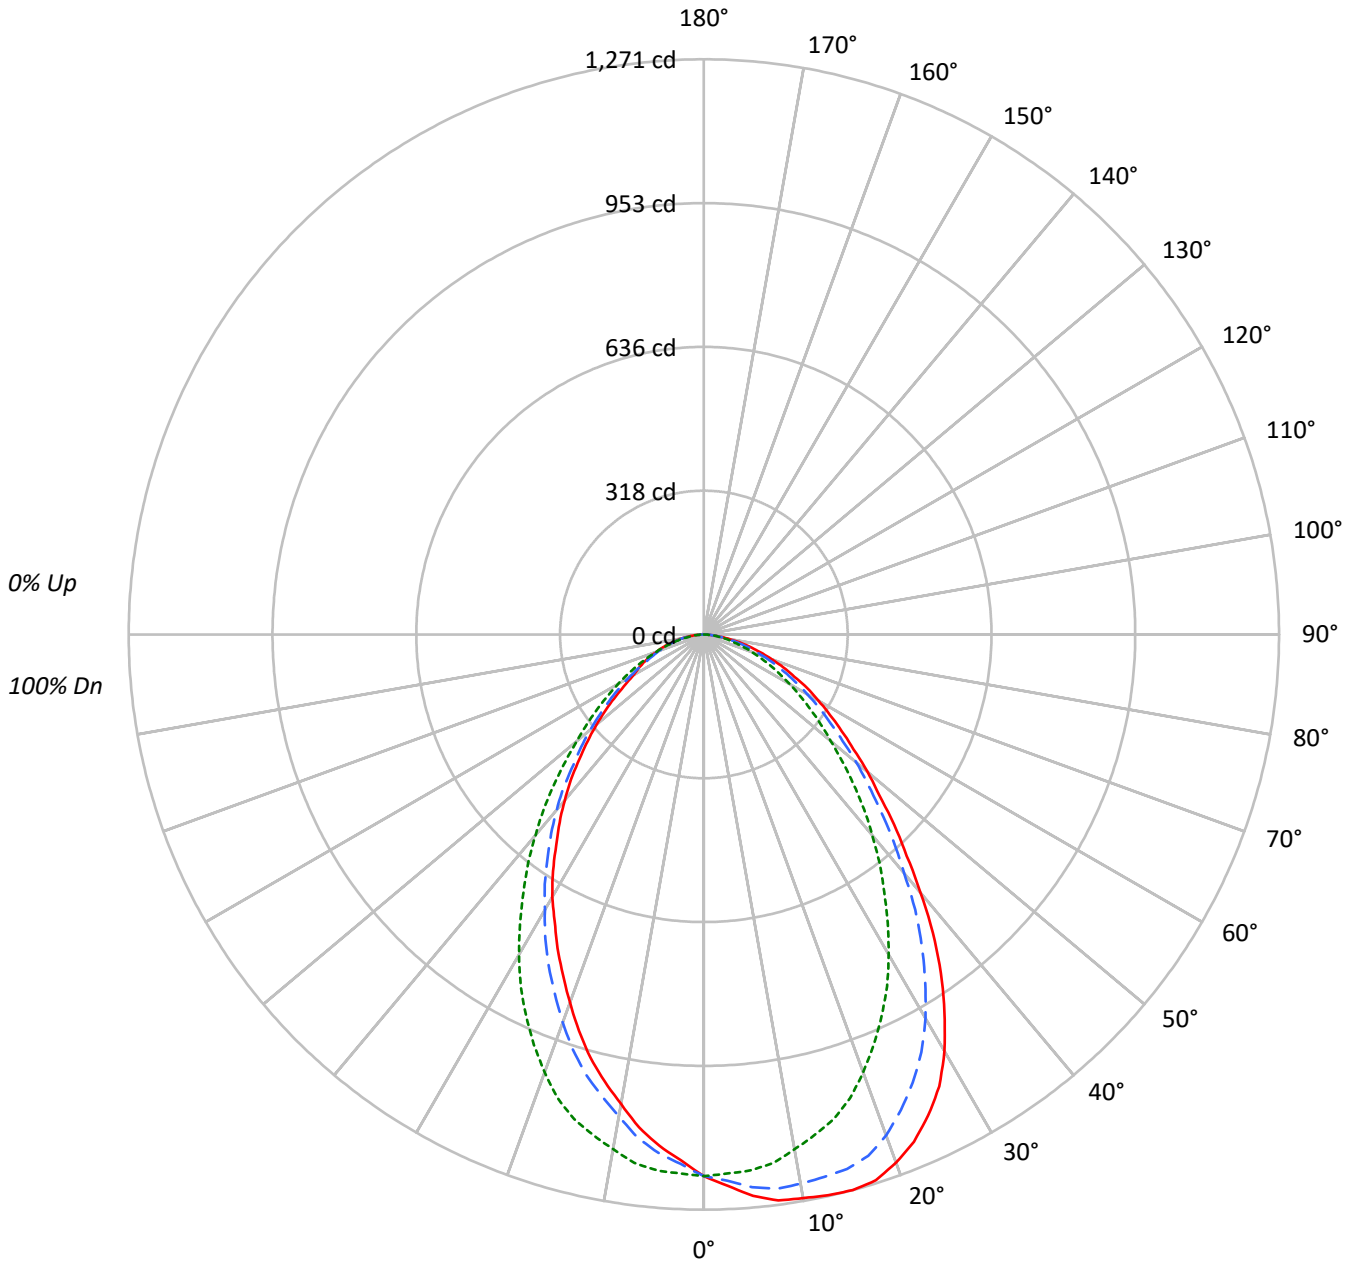

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582106

CATALOG NUMBER: HCC6W25D010MW-HM60525935-61WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	110	106	103	99	108	104	101	98	100	97	95	96	94	92	93	91	89	87								
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76								
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66								
4	87	76	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58								
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51								
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46								
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42								
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38								
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34								
10	58	46	39	34	57	45	38	34	44	38	33	44	38	33	43	37	33	32								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	65614	65614	65614
5°	68523	65419	62409
10°	70389	64294	58644
15°	72134	62900	54949
20°	72456	60048	50469
25°	70940	56223	46285
30°	67301	51698	42418
35°	61128	46465	38052
40°	53264	41392	34236
45°	46082	36213	30096
50°	40255	31180	26370
55°	35564	27402	22632
60°	31971	24011	19604
65°	28628	20897	19016
70°	25565	17807	17807
75°	22198	15017	16712
80°	17805	12691	15280
85°	12140	11133	13146



TEST NUMBER: P582106  
 CATALOG NUMBER: HCC6W25D010MW-HM60525935-61WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	112.5	5.0
10°-20°	312.7	14.0
20°-30°	435.8	19.5
30°-40°	449.0	20.1
40°-50°	372.1	16.7
50°-60°	267.4	12.0
60°-70°	170.3	7.6
70°-80°	87.5	3.9
80°-90°	22.2	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	861.0	38.6
0°-40°	1310.0	58.8
0°-60°	1949.6	87.4
0°-90°	2229.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2229.6	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	1197	1197	1197	1197	1197	
5°	1245	1226	1189	1150	1134	119
15°	1271	1223	1108	1007	968	358
25°	1173	1092	930	810	765	537
35°	913	839	694	602	569	567
45°	594	553	467	408	388	460
55°	372	342	287	254	237	335
65°	221	197	161	140	147	221
75°	105	90	71	74	79	112
85°	19	18	18	19	21	25
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582106

CATALOG NUMBER: HCC6W25D010MW-HM60525935-61WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1196.9	1196.9	1196.9	1196.9	1196.9	1196.9	1196.9	1196.9	1196.9
2.5°	1219.4	1214.7	1208.1	1201.8	1192.1	1180.8	1171.2	1167.9	1163.0
5°	1245.2	1238.8	1225.9	1209.8	1188.8	1167.9	1150.3	1139.0	1134.1
7.5°	1261.4	1253.3	1235.6	1208.1	1177.6	1147.0	1121.2	1105.1	1098.6
10°	1264.5	1256.5	1232.3	1195.4	1155.0	1113.2	1081.0	1061.7	1053.5
12.5°	1269.4	1258.1	1227.6	1184.1	1132.5	1084.1	1043.9	1019.7	1011.7
15°	1271.0	1258.1	1222.7	1169.6	1108.3	1050.4	1006.8	977.8	968.2
17.5°	1264.5	1250.1	1208.1	1143.7	1074.4	1013.3	961.7	931.1	918.2
20°	1242.0	1225.9	1177.6	1105.1	1029.3	964.9	911.8	879.6	865.1
22.5°	1213.0	1192.1	1137.3	1060.0	981.1	913.4	860.2	828.0	813.6
25°	1172.8	1153.4	1092.2	1010.0	929.5	858.7	810.3	776.5	765.2
27.5°	1126.1	1103.5	1040.6	958.5	876.3	805.4	758.7	728.1	713.6
30°	1063.2	1042.2	979.5	897.3	816.7	750.7	702.3	676.6	670.1
32.5°	989.1	971.5	910.2	832.9	755.6	694.3	654.1	626.6	620.2
35°	913.4	892.5	839.3	766.8	694.3	639.5	602.4	578.4	568.6
37.5°	831.2	811.9	766.8	702.3	637.9	586.4	554.2	533.3	523.5
40°	744.3	729.7	687.9	636.3	578.4	533.3	505.8	488.2	478.4
42.5°	663.7	649.2	620.2	571.9	523.5	483.3	459.1	443.1	434.9
45°	594.4	581.5	552.6	510.7	467.1	433.3	407.6	396.3	388.2
47.5°	525.1	518.7	492.9	454.3	414.0	385.0	367.3	354.3	348.0
50°	472.0	464.0	439.8	399.5	365.6	343.1	327.0	315.8	309.2
52.5°	417.2	409.2	386.7	352.8	325.4	304.5	288.3	278.7	272.3
55°	372.1	365.6	341.6	310.9	286.7	269.0	254.5	243.2	236.8
57.5°	330.3	323.8	301.2	272.3	251.4	235.2	222.3	212.6	204.6
60°	291.6	286.7	264.1	236.8	219.0	203.0	191.7	183.7	178.8
62.5°	257.7	248.1	228.8	204.6	188.5	175.5	164.3	159.5	162.8
65°	220.7	215.9	196.6	175.5	161.1	148.2	140.2	143.3	146.6
67.5°	190.1	183.7	167.5	148.2	135.3	125.7	120.8	127.3	128.9
70°	159.5	153.0	138.6	122.4	111.1	104.8	104.8	109.5	111.1
72.5°	130.4	125.7	112.8	99.9	91.8	87.0	90.2	93.5	95.1
75°	104.8	99.9	90.2	78.9	70.9	70.9	74.1	77.3	78.9
77.5°	80.6	77.3	67.7	59.6	56.4	56.4	59.6	61.3	62.8
80°	56.4	53.1	48.4	43.5	40.2	43.5	46.7	46.7	48.4
82.5°	37.1	35.5	32.2	28.9	28.9	30.6	32.2	33.8	33.8
85°	19.3	19.3	17.7	16.2	17.7	19.3	19.3	20.9	20.9
87.5°	6.4	6.4	6.4	6.4	8.0	8.0	8.0	8.0	8.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)