

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P593205

Luminaire Tested: **HCC6S30D010BZ-HM63040850-61MDW**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P593205
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6S30D010BZ-HM63040850-61MDW
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" MEDIUM DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 5000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3307.1 lumens
Efficiency: N/A
Efficacy: 118.1 lumens/watt
Spacing Criteria (0/90/45): 1.08 / 1.08 / 1.03
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 28
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P593205
CATALOG NUMBER: HCC6S30D010BZ-HM63040850-61MDW

Luminous Intensity Polar Plot

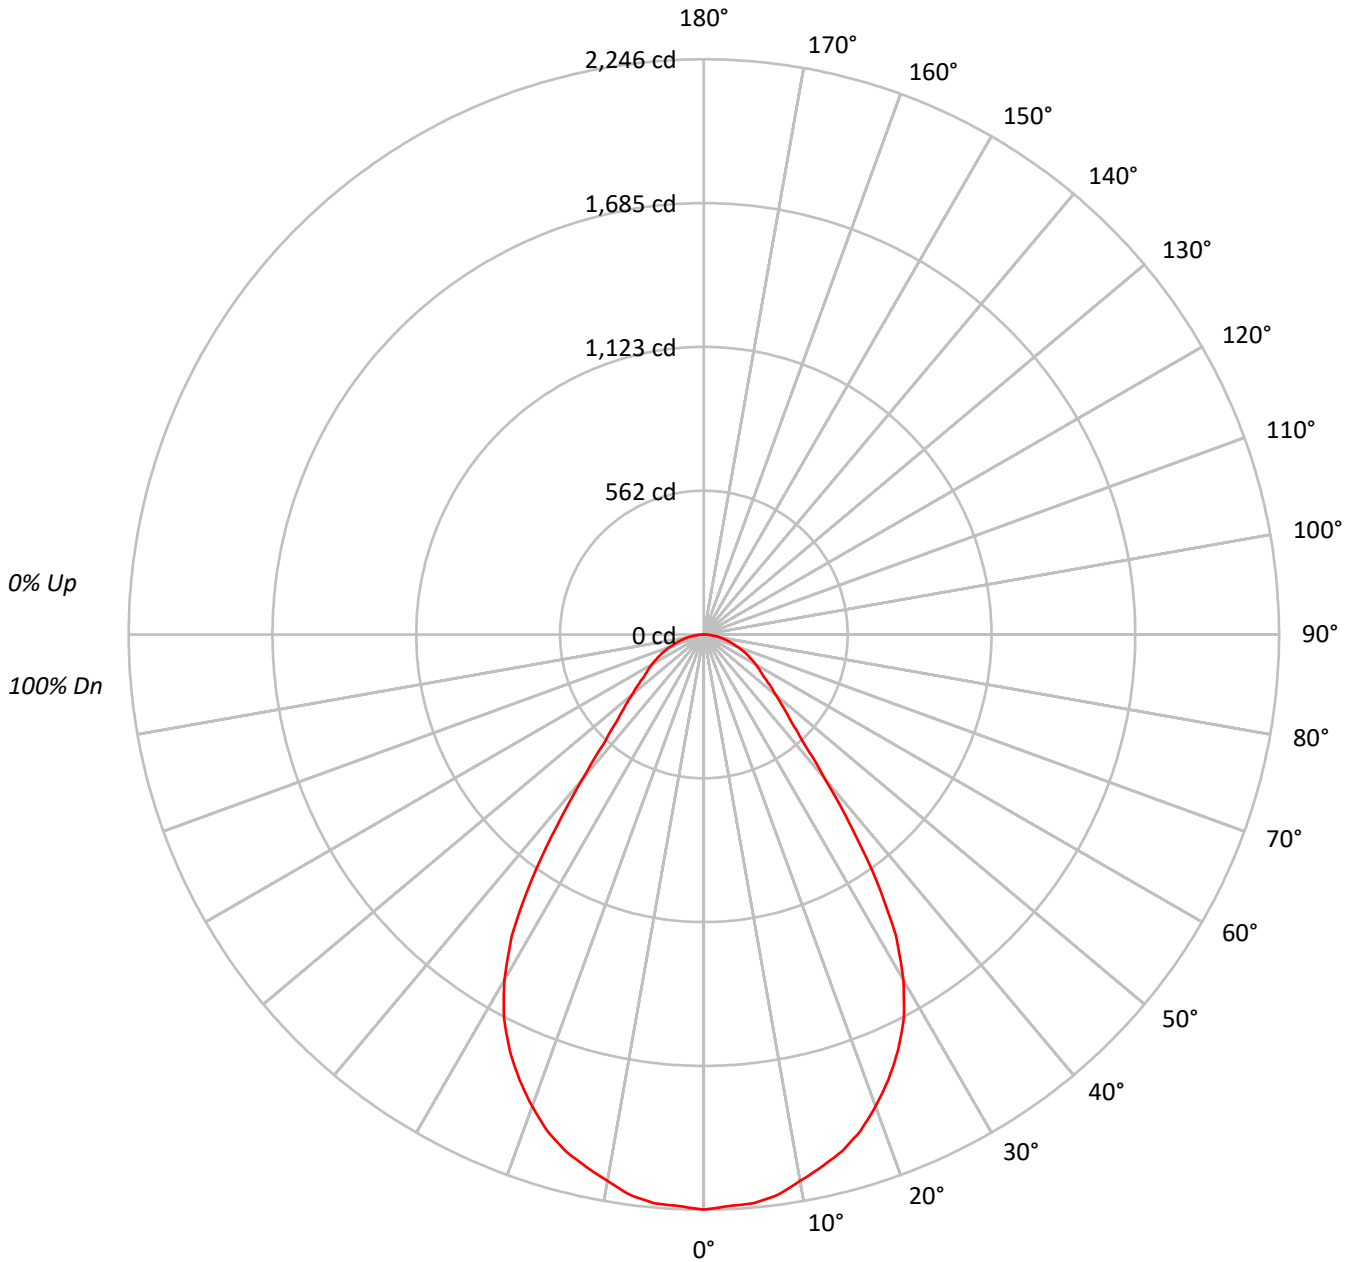

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P593205

CATALOG NUMBER: HCC6S30D010BZ-HM63040850-61MDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89		
2	104	97	92	87	101	95	90	86	92	88	84	89	85	82	86	83	81	79		
3	97	88	82	76	94	87	81	76	84	79	75	81	77	73	79	75	72	70		
4	90	80	73	68	88	79	73	67	77	71	67	75	70	66	73	68	65	63		
5	84	74	66	61	82	73	66	61	71	65	60	69	64	59	67	63	59	57		
6	79	68	61	55	77	67	60	55	65	59	55	64	58	54	62	58	54	52		
7	74	63	55	50	73	62	55	50	61	54	50	59	54	50	58	53	49	48		
8	70	58	51	46	69	58	51	46	57	50	46	55	50	46	54	49	45	44		
9	66	54	47	43	65	54	47	42	53	47	42	52	46	42	51	46	42	40		
10	62	51	44	39	61	50	44	39	49	43	39	49	43	39	48	43	39	37		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	123110
5°	122661
10°	120611
15°	118491
20°	114390
25°	108466
30°	98654
35°	78829
40°	52599
45°	37492
50°	31240
55°	27230
60°	25722
65°	24231
70°	22263
75°	20800
80°	18879
85°	16542



TEST NUMBER: P593205
 CATALOG NUMBER: HCC6S30D010BZ-HM63040850-61MDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	210.8	6.4
10°-20°	586.2	17.7
20°-30°	819.1	24.8
30°-40°	721.6	21.8
40°-50°	389.8	11.8
50°-60°	260.7	7.9
60°-70°	184.8	5.6
70°-80°	103.9	3.1
80°-90°	30.3	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1616.1	48.9
0°-40°	2337.7	70.7
0°-60°	2988.2	90.4
0°-90°	3307.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3307.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2246	
5°	2229	211
15°	2088	586
25°	1793	819
35°	1178	722
45°	484	390
55°	285	261
65°	187	185
75°	98	104
85°	26	30
90°	0	



TEST NUMBER: P593205
CATALOG NUMBER: HCC6S30D010BZ-HM63040850-61MDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2245.7
2.5°	2233.8
5°	2229.0
7.5°	2207.4
10°	2166.7
12.5°	2128.4
15°	2087.8
17.5°	2032.6
20°	1960.8
22.5°	1881.8
25°	1793.2
27.5°	1690.3
30°	1558.5
32.5°	1395.8
35°	1177.9
37.5°	940.9
40°	735.0
42.5°	579.4
45°	483.6
47.5°	419.0
50°	366.3
52.5°	323.2
55°	284.9
57.5°	258.6
60°	234.6
62.5°	210.7
65°	186.8
67.5°	162.8
70°	138.9
72.5°	117.4
75°	98.2
77.5°	78.9
80°	59.8
82.5°	43.0
85°	26.3
87.5°	12.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)