

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582207

Luminaire Tested: **HCC6S30D010MB-HM63040927-61RWWH**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P582207  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-15)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6S30D010MB-HM63040927-61RWWH  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2584.2 lumens  
Efficiency: N/A  
Efficacy: 92.3 lumens/watt  
Spacing Criteria (0/90/45): 1.19 / 1.12 / 1.19  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P582207  
CATALOG NUMBER: HCC6S30D010MB-HM63040927-61RWWH

### Luminous Intensity Polar Plot

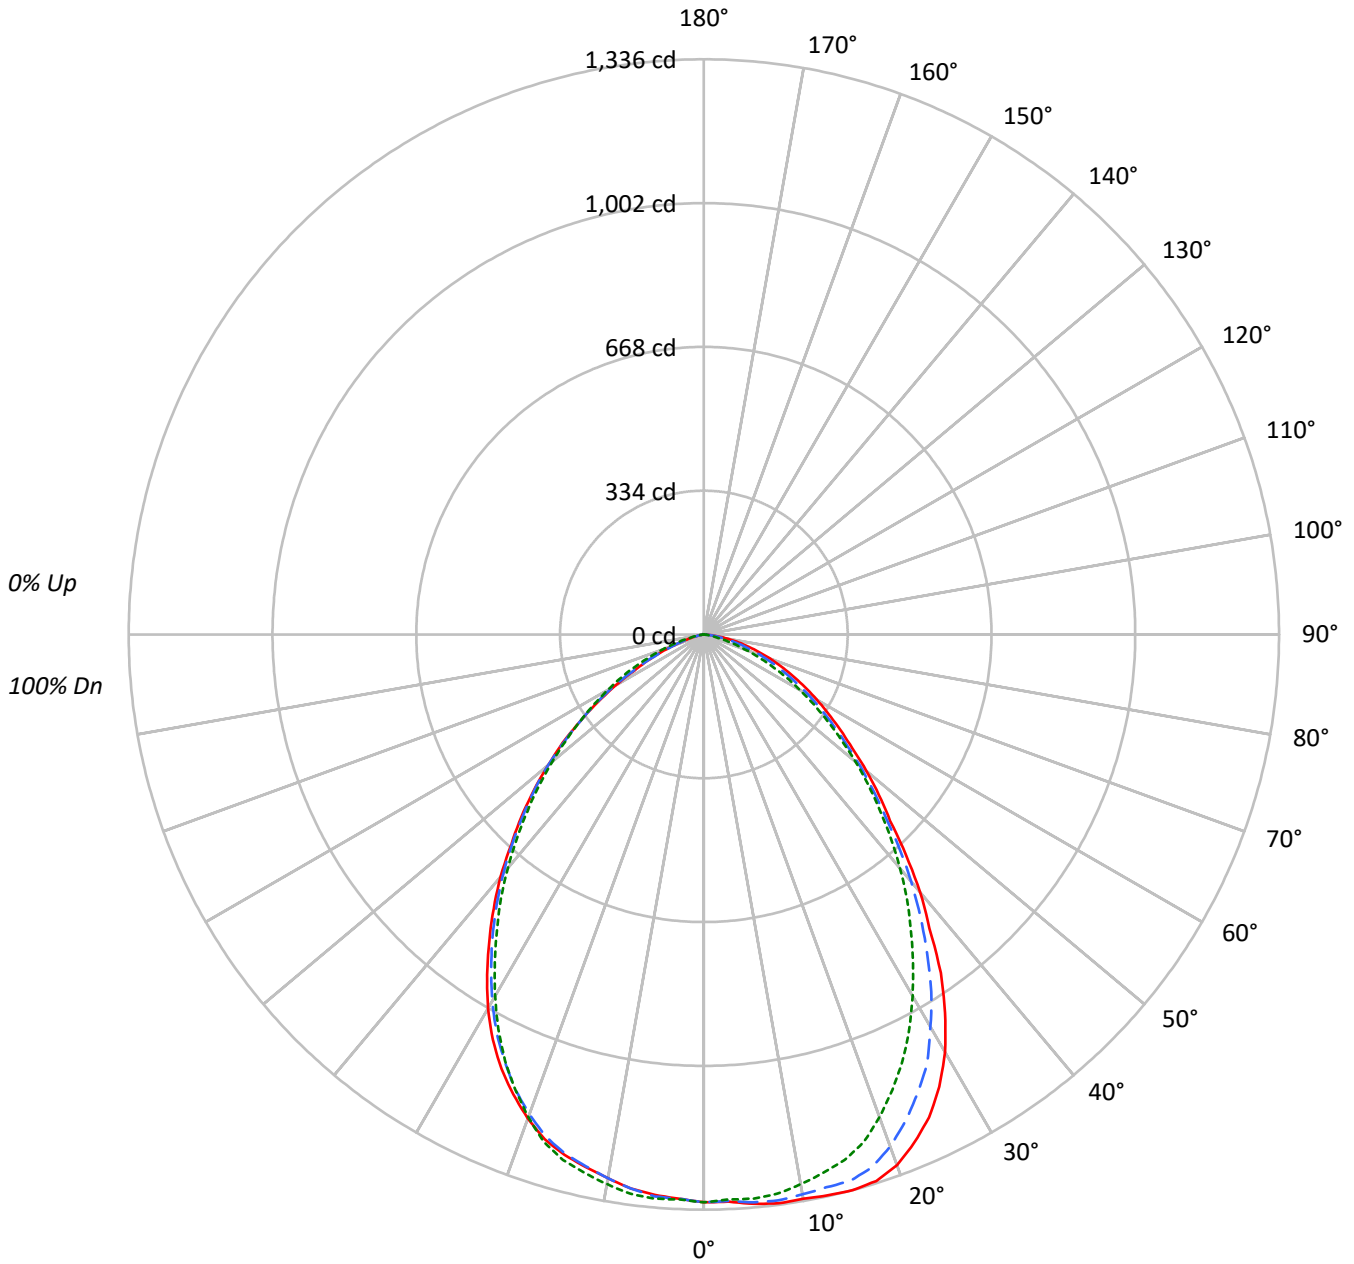

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582207

CATALOG NUMBER: HCC6S30D010MB-HM63040927-61RWWH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	93	92	90	88					88			
2	103	96	90	85	100	94	89	84	91	86	83	87	84	81	85	82	79	77					77			
3	95	86	79	74	93	84	78	73	82	76	72	79	74	70	77	73	69	67					67			
4	88	78	70	64	86	76	69	64	74	68	63	72	66	62	70	65	61	59					59			
5	82	70	62	57	80	69	62	56	67	61	56	65	60	55	64	59	55	53					53			
6	76	64	56	50	74	63	56	50	61	55	50	60	54	49	58	53	49	47					47			
7	71	59	51	45	69	58	50	45	56	50	45	55	49	44	54	48	44	42					42			
8	66	54	46	41	65	53	46	41	52	45	41	51	45	40	50	44	40	38					38			
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35					35			
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	72297	72297	72297
5°	73046	72386	71907
10°	74091	72165	71397
15°	75829	71714	71022
20°	76534	69580	69779
25°	74859	66070	67328
30°	70897	61377	63465
35°	64199	56095	58183
40°	55912	50709	52570
45°	47439	44888	46493
50°	42011	39214	40246
55°	36997	33538	33366
60°	33166	28232	25963
65°	29601	22635	18614
70°	26030	16349	11637
75°	21965	9891	6608
80°	16921	4357	2747
85°	9812	1132	1132



TEST NUMBER: P582207  
 CATALOG NUMBER: HCC6S30D010MB-HM63040927-61RWWH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	125.2	4.8
10°-20°	359.8	13.9
20°-30°	520.1	20.1
30°-40°	547.3	21.2
40°-50°	460.0	17.8
50°-60°	322.9	12.5
60°-70°	177.6	6.9
70°-80°	63.1	2.4
80°-90°	8.3	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1005.1	38.9
0°-40°	1552.3	60.1
0°-60°	2335.2	90.4
0°-90°	2584.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2584.2	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	1319	1319	1319	1319	1319	
5°	1327	1324	1315	1310	1307	127
15°	1336	1314	1264	1248	1251	377
25°	1238	1175	1092	1094	1113	566
35°	959	904	838	856	869	595
45°	612	595	579	593	600	480
55°	387	366	351	351	349	348
65°	228	204	174	144	144	227
75°	104	83	47	31	31	111
85°	16	9	2	2	2	21
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582207

CATALOG NUMBER: HCC6S30D010MB-HM63040927-61RWWH

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1318.8	1318.8	1318.8	1318.8	1318.8	1318.8	1318.8	1318.8	1318.8
2.5°	1318.8	1318.8	1317.1	1317.1	1313.6	1313.6	1311.9	1311.9	1311.9
5°	1327.4	1327.4	1324.0	1318.8	1315.4	1310.2	1310.2	1308.5	1306.7
7.5°	1332.6	1331.0	1325.7	1318.8	1310.2	1301.5	1298.0	1299.8	1298.0
10°	1331.0	1327.4	1320.5	1306.7	1296.4	1284.2	1282.6	1280.8	1282.6
12.5°	1334.4	1329.2	1315.4	1298.0	1280.8	1267.0	1265.2	1265.2	1267.0
15°	1336.1	1331.0	1313.6	1287.7	1263.6	1249.6	1248.0	1249.6	1251.4
17.5°	1331.0	1324.0	1298.0	1263.6	1235.8	1222.1	1222.1	1225.5	1229.0
20°	1311.9	1301.5	1265.2	1223.7	1192.7	1182.2	1185.7	1192.7	1196.1
22.5°	1277.3	1265.2	1223.7	1177.1	1144.3	1135.6	1144.3	1152.9	1156.3
25°	1237.6	1223.7	1175.3	1126.9	1092.3	1082.0	1094.1	1107.9	1113.1
27.5°	1184.0	1168.4	1123.5	1068.2	1033.6	1028.5	1042.3	1057.9	1061.3
30°	1120.0	1102.8	1052.6	1000.8	969.6	968.0	983.5	997.3	1002.6
32.5°	1042.3	1026.7	983.5	931.6	904.0	904.0	919.6	931.6	936.8
35°	959.3	942.0	904.0	860.7	838.2	840.0	855.6	864.3	869.4
37.5°	860.7	855.6	826.2	789.9	774.4	777.8	789.9	796.9	802.0
40°	781.3	767.4	748.5	719.0	708.6	712.1	724.2	731.1	734.6
42.5°	694.9	686.2	670.6	649.9	643.0	648.1	658.6	663.7	662.0
45°	611.9	610.2	594.6	582.5	579.0	585.9	592.8	598.1	599.7
47.5°	551.3	544.4	530.7	522.0	518.5	525.4	532.3	535.8	535.8
50°	492.6	485.7	471.9	463.2	459.8	466.7	471.9	475.4	471.9
52.5°	433.9	427.0	414.8	404.5	402.7	406.2	407.9	409.6	413.1
55°	387.1	380.2	366.4	354.3	350.9	352.7	350.9	350.9	349.1
57.5°	342.2	335.3	321.5	307.7	302.5	300.7	295.6	293.8	292.1
60°	302.5	293.8	280.0	264.4	257.5	250.6	242.0	236.8	236.8
62.5°	264.4	255.8	240.3	226.4	216.0	203.9	190.1	183.2	183.2
65°	228.2	221.3	203.9	188.5	174.5	159.0	143.5	140.1	143.5
67.5°	193.6	186.7	169.4	153.9	136.5	117.6	103.7	103.7	107.1
70°	162.4	155.5	140.1	121.0	102.0	83.0	72.6	72.6	72.6
72.5°	133.0	126.2	108.9	91.6	72.6	53.6	48.4	50.2	48.4
75°	103.7	98.6	83.0	64.0	46.7	32.8	31.2	29.4	31.2
77.5°	77.8	72.6	58.7	41.5	25.9	19.0	17.2	17.2	17.2
80°	53.6	48.4	38.0	24.3	13.8	8.7	8.7	8.7	8.7
82.5°	32.8	27.7	20.7	12.1	5.2	5.2	5.2	5.2	5.2
85°	15.6	12.1	8.7	3.4	1.8	1.8	1.8	1.8	1.8
87.5°	3.4	3.4	1.8	1.8	0.0	1.8	1.8	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)