

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582227

Luminaire Tested: **HCC6W30D010BZ-HM63040930-61WDC**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P582227
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-7)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W30D010BZ-HM63040930-61WDC
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WIDE DISTRIBUTION, SPECULAR TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3330.3 lumens
Efficiency: N/A
Efficacy: 118.9 lumens/watt
Spacing Criteria (0/90/45): 1.28 / 1.28 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 28
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P582227
CATALOG NUMBER: HCC6W30D010BZ-HM63040930-61WDC

Luminous Intensity Polar Plot

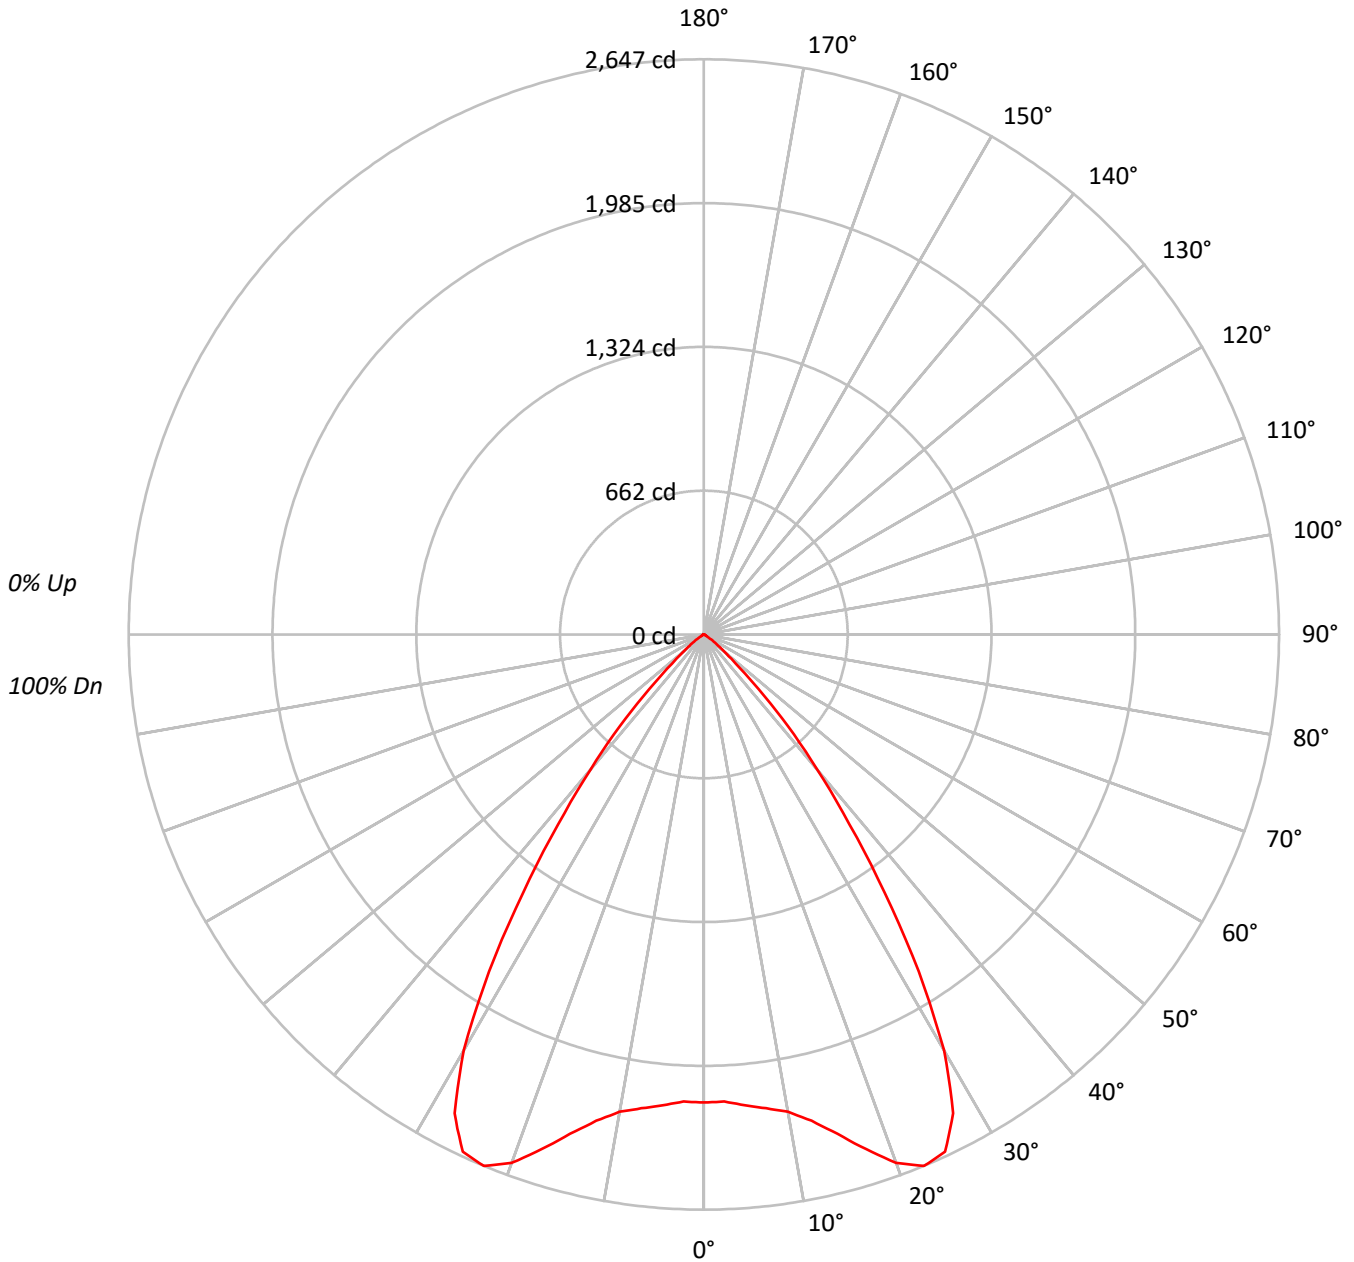

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P582227

CATALOG NUMBER: HCC6W30D010BZ-HM63040930-61WDC

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	103	104	102	100	100	99	97	97	96	94	93	93	93	93
2	107	102	97	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85	85	85	85
3	101	94	89	85	99	93	88	84	90	86	82	88	84	81	85	82	80	78	78	78	78
4	95	87	81	77	93	86	80	76	84	79	75	82	78	74	80	76	74	72	72	72	72
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66	66	66	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61	61	61	61
7	80	70	63	59	79	69	63	59	68	62	58	67	62	58	66	61	58	56	56	56	56
8	76	65	59	54	74	65	59	54	64	58	54	62	57	54	61	57	53	52	52	52	52
9	71	61	55	50	70	60	54	50	60	54	50	59	53	50	58	53	50	48	48	48	48
10	68	57	51	47	67	57	51	47	56	50	46	55	50	46	54	50	46	45	45	45	45

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	118072
5°	119651
10°	124140
15°	135006
20°	150945
25°	158876
30°	139863
35°	97012
40°	57930
45°	27538
50°	10396
55°	4339
60°	1360
65°	1064
70°	673
75°	424
80°	631
85°	0



TEST NUMBER: P582227
 CATALOG NUMBER: HCC6W30D010BZ-HM63040930-61WDC

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.3	6.3
10°-20°	683.1	20.5
20°-30°	1170.4	35.1
30°-40°	909.0	27.3
40°-50°	300.5	9.0
50°-60°	46.1	1.4
60°-70°	8.1	0.2
70°-80°	3.0	0.1
80°-90°	0.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2062.8	61.9
0°-40°	2971.8	89.2
0°-60°	3318.4	99.6
0°-90°	3330.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3330.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2154	
5°	2174	209
15°	2379	683
25°	2627	1170
35°	1450	909
45°	355	301
55°	45	46
65°	8	8
75°	2	3
85°	0	1
90°	0	



TEST NUMBER: P582227
CATALOG NUMBER: HCC6W30D010BZ-HM63040930-61WDC

CANDELA DISTRIBUTION (FULL):

	0°
0°	2153.8
2.5°	2151.6
5°	2174.3
7.5°	2199.2
10°	2230.1
12.5°	2292.0
15°	2378.8
17.5°	2484.1
20°	2587.4
22.5°	2647.2
25°	2626.6
27.5°	2484.1
30°	2209.5
32.5°	1839.9
35°	1449.6
37.5°	1100.7
40°	809.5
42.5°	572.0
45°	355.2
47.5°	198.2
50°	121.9
52.5°	74.3
55°	45.4
57.5°	22.7
60°	12.4
62.5°	10.3
65°	8.2
67.5°	6.2
70°	4.2
72.5°	4.2
75°	2.0
77.5°	2.0
80°	2.0
82.5°	2.0
85°	0.0
87.5°	0.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)