

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P593229

Luminaire Tested: **HCC6S30D010MW-HM63040950-61WWBB**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P593229  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-17)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6S30D010MW-HM63040950-61WWBB  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE BAFFLE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2645.8 lumens  
Efficiency: N/A  
Efficacy: 94.5 lumens/watt  
Spacing Criteria (0/90/45): 1.15 / 1.06 / 1.14  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P593229  
CATALOG NUMBER: HCC6S30D010MW-HM63040950-61WWBB

### Luminous Intensity Polar Plot

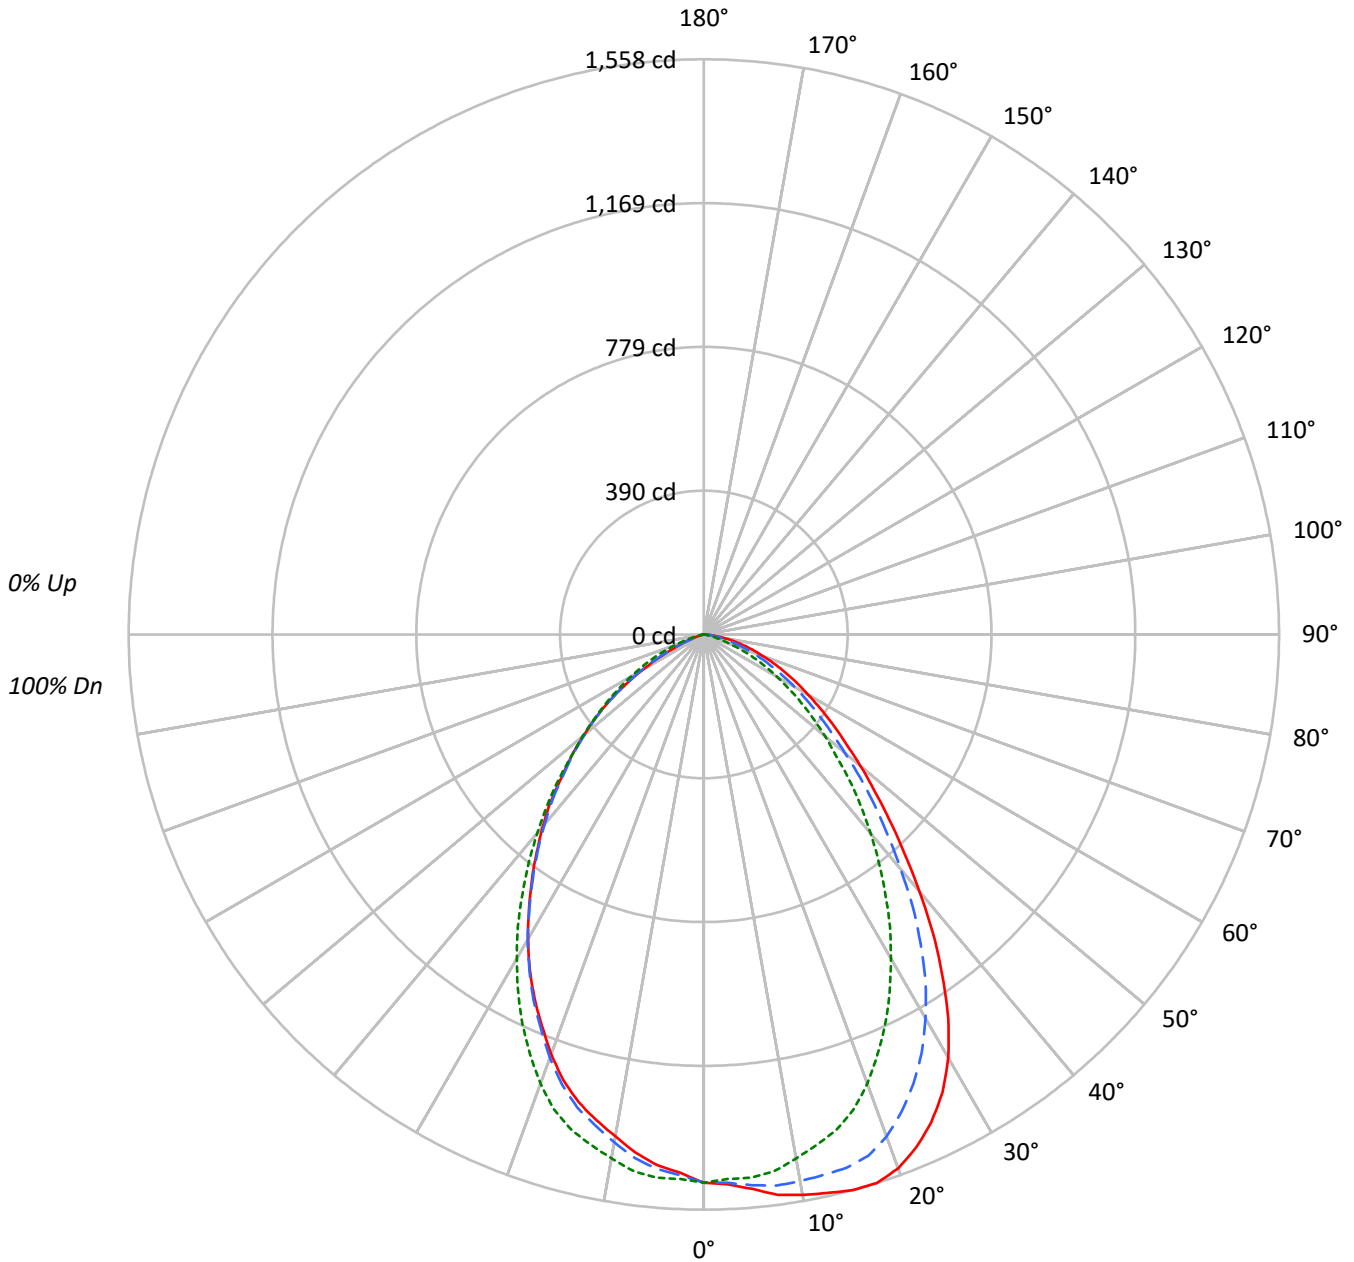

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P593229

CATALOG NUMBER: HCC6S30D010MW-HM63040950-61WWBB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89								
2	103	97	91	87	101	95	90	86	91	87	84	88	85	82	85	83	80	78								
3	96	87	80	75	93	86	79	74	83	77	73	80	76	72	78	74	71	69								
4	89	79	71	66	87	78	71	65	75	69	64	73	68	64	71	66	63	61								
5	83	72	64	58	81	71	63	58	69	62	57	67	61	57	65	60	56	54								
6	77	65	58	52	75	65	57	52	63	56	51	61	55	51	60	55	51	49								
7	72	60	52	47	70	59	52	47	58	51	46	56	51	46	55	50	46	44								
8	67	55	48	43	66	55	47	42	53	47	42	52	46	42	51	46	42	40								
9	63	51	44	39	62	51	44	39	50	43	39	49	43	38	48	42	38	37								
10	60	48	40	36	58	47	40	36	46	40	36	45	40	35	45	39	35	34								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	81392	81392	81392
5°	82968	81246	79408
10°	85787	80203	76836
15°	88411	78809	74422
20°	89783	75531	70537
25°	88166	70353	65683
30°	83810	64111	60281
35°	75322	57300	54362
40°	65008	50208	48570
45°	55044	43222	42090
50°	47197	36502	36152
55°	40907	30737	29533
60°	35721	24954	21062
65°	31417	19237	11648
70°	27120	12710	5706
75°	23002	6185	2224
80°	17805	2620	1326
85°	10567	1321	1321



TEST NUMBER: P593229

CATALOG NUMBER: HCC6S30D010MW-HM63040950-61WWBB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	140.1	5.3
10°-20°	396.2	15.0
20°-30°	558.0	21.1
30°-40°	570.1	21.5
40°-50°	459.6	17.4
50°-60°	308.3	11.7
60°-70°	156.0	5.9
70°-80°	49.9	1.9
80°-90°	7.7	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1094.3	41.4
0°-40°	1664.3	62.9
0°-60°	2432.2	91.9
0°-90°	2645.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2645.8	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	1485	1485	1485	1485	1485	
5°	1508	1497	1476	1453	1443	145
15°	1558	1495	1389	1326	1311	440
25°	1458	1343	1163	1092	1086	667
35°	1126	1023	856	808	812	700
45°	710	654	558	539	543	552
55°	428	380	322	307	309	385
65°	242	200	148	98	90	242
75°	109	77	29	10	10	117
85°	17	8	2	2	2	22
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P593229

CATALOG NUMBER: HCC6S30D010MW-HM63040950-61WWBB

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1484.7	1484.7	1484.7	1484.7	1484.7	1484.7	1484.7	1484.7	1484.7
2.5°	1491.0	1488.9	1486.8	1482.7	1476.4	1470.1	1465.9	1461.8	1459.6
5°	1507.7	1503.5	1497.3	1488.9	1476.4	1461.8	1453.4	1445.0	1443.0
7.5°	1530.7	1522.3	1505.6	1486.8	1465.9	1445.0	1430.5	1422.0	1415.9
10°	1541.1	1526.4	1503.5	1472.2	1440.8	1415.9	1397.1	1384.5	1380.3
12.5°	1549.5	1532.7	1499.3	1457.6	1415.9	1382.5	1361.5	1351.1	1346.9
15°	1557.8	1541.1	1495.2	1440.8	1388.6	1349.0	1326.0	1315.6	1311.3
17.5°	1557.8	1534.9	1480.5	1411.6	1349.0	1301.0	1277.9	1267.6	1265.5
20°	1539.0	1514.0	1447.1	1365.7	1294.7	1240.4	1219.6	1213.3	1209.1
22.5°	1503.5	1474.2	1399.1	1307.2	1230.0	1177.7	1154.8	1150.6	1146.4
25°	1457.6	1428.3	1342.7	1244.5	1163.1	1110.9	1092.1	1087.9	1085.9
27.5°	1399.1	1367.8	1277.9	1177.7	1090.1	1039.9	1023.3	1023.3	1021.1
30°	1324.0	1288.4	1200.8	1100.5	1012.8	966.9	954.3	954.3	952.3
32.5°	1232.0	1196.5	1117.2	1021.1	937.6	889.6	879.1	883.3	881.3
35°	1125.5	1096.3	1023.3	929.2	856.2	812.3	808.2	812.3	812.3
37.5°	1019.1	991.9	929.2	847.9	778.9	739.2	739.2	745.5	743.4
40°	908.4	887.5	829.0	758.0	701.6	674.5	670.4	676.5	678.7
42.5°	804.0	787.2	737.2	678.7	628.5	601.4	607.7	611.9	613.9
45°	710.0	693.3	653.6	593.1	557.5	538.7	538.7	545.0	542.9
47.5°	626.5	613.9	574.3	515.8	484.5	476.1	480.2	484.5	484.5
50°	553.4	534.6	497.0	451.1	428.0	417.7	421.9	423.9	423.9
52.5°	484.5	471.9	434.3	392.6	371.7	365.4	365.4	367.5	367.5
55°	428.0	413.4	380.0	338.3	321.6	313.2	307.0	304.9	309.0
57.5°	373.8	361.2	329.9	290.2	271.4	263.1	250.6	246.4	250.6
60°	325.8	315.3	284.1	246.4	227.6	210.9	196.3	188.0	192.1
62.5°	284.1	271.4	240.2	208.8	188.0	169.2	146.1	133.6	139.9
65°	242.2	231.7	200.5	169.2	148.3	125.3	98.1	89.8	89.8
67.5°	204.6	194.2	164.9	137.8	112.7	85.6	60.5	58.5	60.5
70°	169.2	158.7	133.6	106.5	79.3	52.2	35.6	35.6	35.6
72.5°	139.9	127.3	104.4	77.3	50.2	27.1	18.8	20.9	20.9
75°	108.6	98.1	77.3	52.2	29.2	12.5	10.5	10.5	10.5
77.5°	81.4	73.1	54.3	33.4	14.6	4.2	4.2	4.2	4.2
80°	56.4	48.0	35.6	20.9	8.3	4.2	4.2	4.2	4.2
82.5°	33.4	29.2	20.9	10.5	4.2	2.1	2.1	2.1	2.1
85°	16.8	14.6	8.3	4.2	2.1	2.1	2.1	2.1	2.1
87.5°	4.2	4.2	2.1	2.1	0.0	2.1	2.1	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)