

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582430

Luminaire Tested: **HCC6S40D010SL-HM63040827-61WWW**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P582430  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6S40D010SL-HM63040827-61WWW  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 3909.0 lumens  
Efficiency: N/A  
Efficacy: 95.3 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.06 / 1.14  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P582430  
CATALOG NUMBER: HCC6S40D010SL-HM63040827-61WWW

### Luminous Intensity Polar Plot

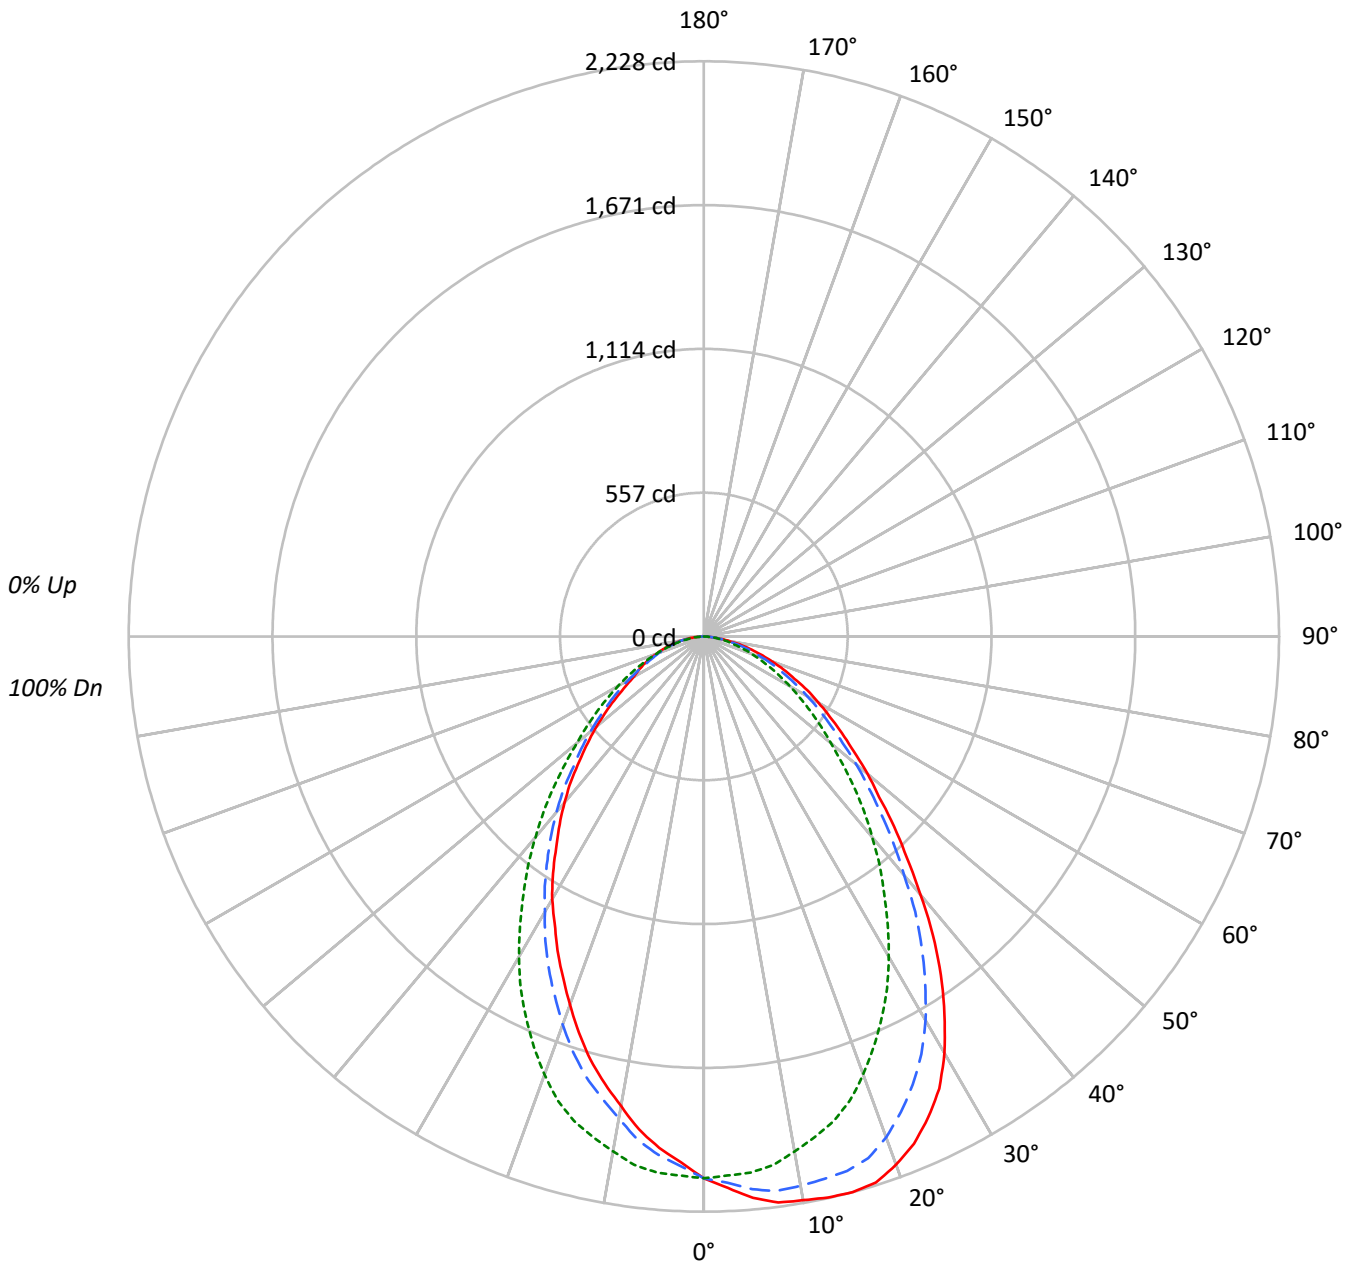

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582430

CATALOG NUMBER: HCC6S40D010SL-HM63040827-61WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	110	106	103	99	108	104	101	98	100	97	95	96	94	92	93	91	89	87					87			
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76					76			
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66					66			
4	87	76	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58					58			
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51					51			
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46					46			
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42					42			
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38					38			
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34					34			
10	58	46	39	34	57	45	38	34	44	38	33	44	38	33	43	37	33	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	115040	115040	115040
5°	120141	114704	109421
10°	123417	112729	102820
15°	126476	110284	96334
20°	127032	105289	88482
25°	124374	98570	81150
30°	117999	90641	74379
35°	107171	81465	66722
40°	93382	72557	60034
45°	80791	63503	52773
50°	70573	54685	46242
55°	62354	48056	39683
60°	56048	42113	34372
65°	50200	36632	33350
70°	44815	31223	31223
75°	38888	26307	29314
80°	31191	22288	26740
85°	21323	19562	23084



TEST NUMBER: P582430  
 CATALOG NUMBER: HCC6S40D010SL-HM63040827-61WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	197.2	5.0
10°-20°	548.2	14.0
20°-30°	764.1	19.5
30°-40°	787.2	20.1
40°-50°	652.4	16.7
50°-60°	468.9	12.0
60°-70°	298.6	7.6
70°-80°	153.3	3.9
80°-90°	39.0	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1509.5	38.6
0°-40°	2296.8	58.8
0°-60°	3418.1	87.4
0°-90°	3909.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3909.0	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	2098	2098	2098	2098	2098	
5°	2183	2149	2084	2017	1988	209
15°	2228	2144	1943	1765	1697	628
25°	2056	1915	1630	1421	1342	942
35°	1601	1472	1217	1056	997	995
45°	1042	969	819	714	681	807
55°	652	599	503	446	415	588
65°	387	344	282	246	257	388
75°	184	158	124	130	138	196
85°	34	31	31	34	37	43
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582430

CATALOG NUMBER: HCC6S40D010SL-HM63040827-61WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	2098.5	2098.5	2098.5	2098.5	2098.5	2098.5	2098.5	2098.5	2098.5
2.5°	2138.1	2129.5	2118.3	2107.0	2090.1	2070.3	2053.3	2047.6	2039.2
5°	2183.2	2172.0	2149.3	2121.1	2084.4	2047.6	2016.6	1996.8	1988.4
7.5°	2211.4	2197.3	2166.3	2118.3	2064.6	2010.9	1965.7	1937.5	1926.3
10°	2217.1	2203.0	2160.7	2095.6	2025.1	1951.6	1895.1	1861.2	1847.1
12.5°	2225.5	2205.9	2152.2	2076.0	1985.5	1900.8	1830.2	1787.8	1773.7
15°	2228.5	2205.9	2143.6	2050.5	1943.2	1841.5	1765.2	1714.4	1697.4
17.5°	2217.1	2191.7	2118.3	2005.3	1883.8	1776.6	1686.2	1632.5	1609.8
20°	2177.5	2149.3	2064.6	1937.5	1804.8	1691.7	1598.6	1542.2	1516.7
22.5°	2126.8	2090.1	1994.1	1858.5	1720.1	1601.4	1508.3	1451.7	1426.4
25°	2056.2	2022.3	1914.9	1770.9	1629.6	1505.4	1420.7	1361.3	1341.6
27.5°	1974.3	1934.7	1824.6	1680.5	1536.5	1412.3	1330.3	1276.7	1251.2
30°	1864.1	1827.3	1717.2	1573.2	1431.9	1316.1	1231.4	1186.2	1175.0
32.5°	1734.2	1703.1	1595.7	1460.3	1324.7	1217.3	1146.7	1098.7	1087.4
35°	1601.4	1564.7	1471.5	1344.5	1217.3	1121.3	1056.3	1013.9	997.0
37.5°	1457.4	1423.5	1344.5	1231.4	1118.5	1028.0	971.6	934.9	917.9
40°	1304.9	1279.4	1206.0	1115.6	1013.9	934.9	886.9	855.8	838.9
42.5°	1163.6	1138.2	1087.4	1002.7	917.9	847.3	805.0	776.8	762.6
45°	1042.1	1019.6	968.8	895.3	819.1	759.7	714.5	694.8	680.7
47.5°	920.8	909.5	864.2	796.4	725.8	675.1	643.9	621.4	610.0
50°	827.5	813.4	771.1	700.4	641.2	601.6	573.4	553.6	542.2
52.5°	731.5	717.4	677.8	618.5	570.5	533.8	505.6	488.6	477.3
55°	652.4	641.2	598.8	545.1	502.8	471.7	446.2	426.4	415.2
57.5°	579.0	567.7	528.1	477.3	440.5	412.3	389.8	372.9	358.6
60°	511.2	502.8	463.2	415.2	384.1	355.9	336.1	322.0	313.5
62.5°	451.9	435.0	401.1	358.6	330.4	307.9	288.1	279.6	285.3
65°	387.0	378.4	344.5	307.9	282.4	259.8	245.7	251.4	257.1
67.5°	333.3	322.0	293.7	259.8	237.3	220.3	211.8	223.2	225.9
70°	279.6	268.3	243.0	214.6	194.8	183.6	183.6	192.0	194.8
72.5°	228.7	220.3	197.7	175.2	161.0	152.5	158.1	163.8	166.6
75°	183.6	175.2	158.1	138.4	124.2	124.2	129.9	135.6	138.4
77.5°	141.3	135.6	118.6	104.5	98.8	98.8	104.5	107.4	110.1
80°	98.8	93.3	84.7	76.2	70.6	76.2	81.9	81.9	84.7
82.5°	64.9	62.1	56.5	50.8	50.8	53.7	56.5	59.4	59.4
85°	33.9	33.9	31.1	28.2	31.1	33.9	33.9	36.7	36.7
87.5°	11.3	11.3	11.3	11.3	14.1	14.1	14.1	14.1	14.1
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)