

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P593270

Luminaire Tested: **HCC6W40D010MB-HM63040850-61MDH**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P593270
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-5)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W40D010MB-HM63040850-61MDH
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" MEDIUM DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 5000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4681.6 lumens
Efficiency: N/A
Efficacy: 114.2 lumens/watt
Spacing Criteria (0/90/45): 1.01 / 1.01 / 0.97
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 41
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P593270
CATALOG NUMBER: HCC6W40D010MB-HM63040850-61MDH

Luminous Intensity Polar Plot

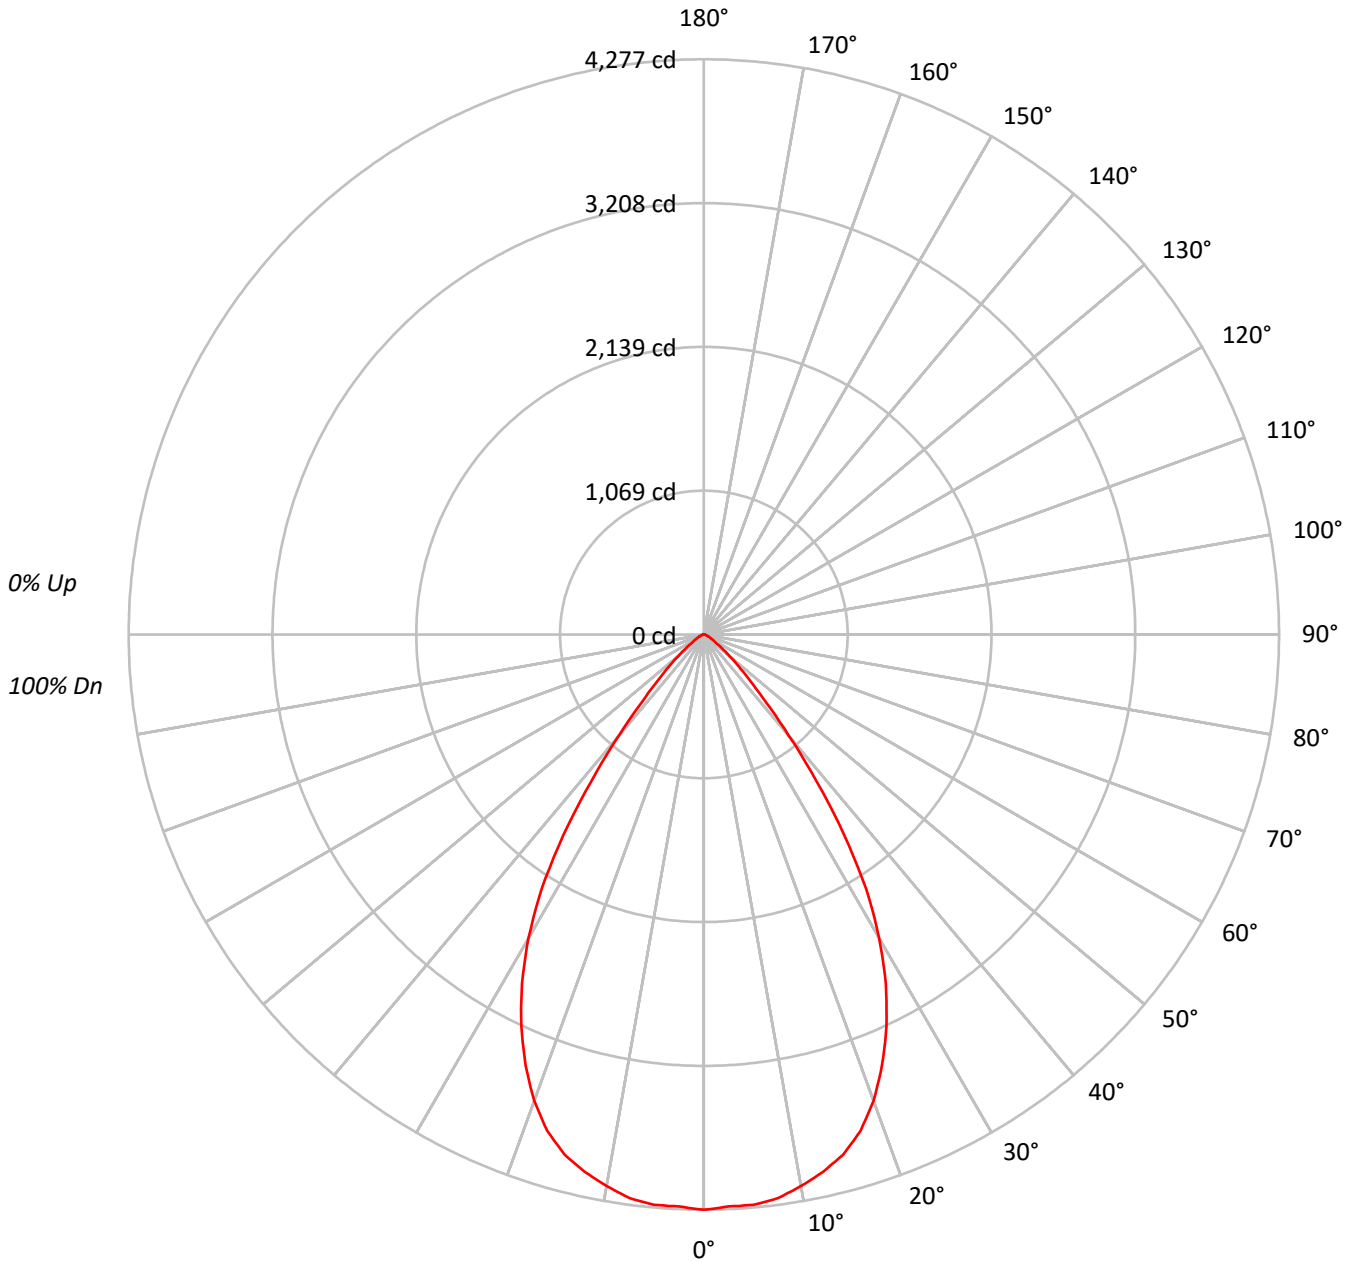

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P593270

CATALOG NUMBER: HCC6W40D010MB-HM63040850-61MDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	94	93			93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85			85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	81	86	83	80	79			79
4	96	88	82	77	94	86	81	77	84	79	76	82	78	75	80	77	74	72			72
5	90	81	75	71	89	80	75	70	79	74	70	77	73	69	75	72	68	67			67
6	85	76	70	65	84	75	69	65	74	68	64	72	67	64	71	67	63	62			62
7	81	71	65	60	79	70	64	60	69	64	60	68	63	59	67	62	59	57			57
8	77	67	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53			53
9	73	62	56	52	72	62	56	52	61	56	52	60	55	52	59	55	51	50			50
10	69	59	53	49	68	58	52	48	57	52	48	57	52	48	56	51	48	47			47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	234482
5°	234277
10°	231843
15°	227181
20°	215199
25°	194334
30°	165082
35°	121887
40°	70489
45°	37415
50°	21134
55°	11058
60°	7247
65°	5150
70°	3703
75°	2796
80°	2084
85°	2076



TEST NUMBER: P593270
 CATALOG NUMBER: HCC6W40D010MB-HM63040850-61MDH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	403.5	8.6
10°-20°	1119.6	23.9
20°-30°	1461.3	31.2
30°-40°	1116.7	23.9
40°-50°	404.3	8.6
50°-60°	117.4	2.5
60°-70°	42.0	0.9
70°-80°	14.3	0.3
80°-90°	2.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2984.3	63.7
0°-40°	4100.9	87.6
0°-60°	4622.6	98.7
0°-90°	4681.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4681.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4277	
5°	4257	403
15°	4003	1120
25°	3213	1461
35°	1821	1117
45°	483	404
55°	116	117
65°	40	42
75°	13	14
85°	3	3
90°	0	



TEST NUMBER: P593270
CATALOG NUMBER: HCC6W40D010MB-HM63040850-61MDH

CANDELA DISTRIBUTION (FULL):

	0°
0°	4277.3
2.5°	4257.3
5°	4257.3
7.5°	4227.7
10°	4164.9
12.5°	4092.1
15°	4002.9
17.5°	3870.6
20°	3688.8
22.5°	3464.1
25°	3212.8
27.5°	2928.6
30°	2607.9
32.5°	2247.7
35°	1821.3
37.5°	1375.1
40°	985.0
42.5°	680.9
45°	482.6
47.5°	347.0
50°	247.8
52.5°	175.2
55°	115.7
57.5°	82.6
60°	66.1
62.5°	52.9
65°	39.7
67.5°	33.1
70°	23.1
72.5°	16.5
75°	13.2
77.5°	9.9
80°	6.6
82.5°	3.3
85°	3.3
87.5°	0.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)