

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582538

Luminaire Tested: **HCC6S40D010MB-HM63040935-61WWW**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P582538  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6S40D010MB-HM63040935-61WWW  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 3887.3 lumens  
Efficiency: N/A  
Efficacy: 94.8 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.06 / 1.14  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P582538  
CATALOG NUMBER: HCC6S40D010MB-HM63040935-61WWW

### Luminous Intensity Polar Plot

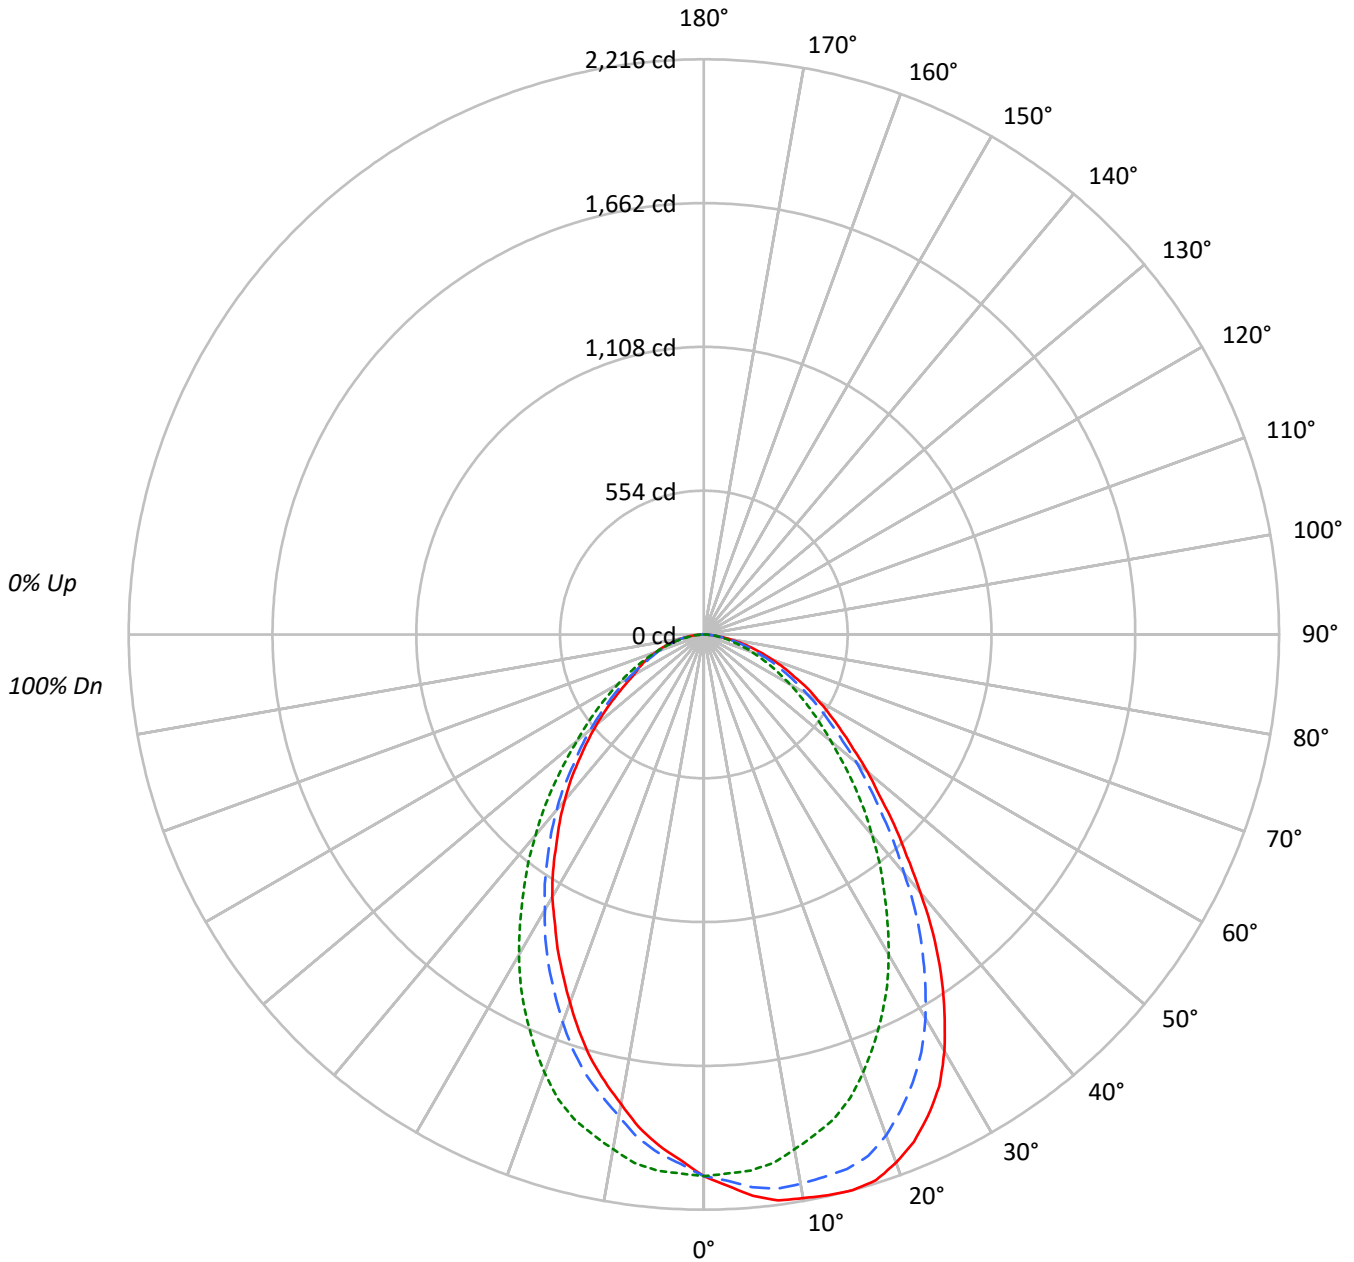

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582538

CATALOG NUMBER: HCC6S40D010MB-HM63040935-61WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	110	106	103	99	108	104	101	98	100	97	95	96	94	92	93	91	89	87								
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76								
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66								
4	87	76	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58								
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51								
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46								
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42								
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38								
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34								
10	58	46	39	34	57	45	38	34	44	38	33	44	38	33	43	37	33	32								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	114399	114399	114399
5°	119475	114065	108810
10°	122732	112100	102247
15°	125773	109666	95806
20°	126326	104706	87992
25°	123679	98020	80702
30°	117341	90140	73961
35°	106582	81017	66354
40°	92860	72149	59690
45°	80342	63146	52478
50°	70181	54378	45986
55°	62010	47778	39454
60°	55730	41883	34186
65°	49915	36424	33155
70°	44559	31063	31063
75°	38655	26180	29145
80°	31033	22162	26613
85°	21260	19436	22958



TEST NUMBER: P582538  
 CATALOG NUMBER: HCC6S40D010MB-HM63040935-61WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	196.1	5.0
10°-20°	545.2	14.0
20°-30°	759.8	19.5
30°-40°	782.9	20.1
40°-50°	648.8	16.7
50°-60°	466.3	12.0
60°-70°	296.9	7.6
70°-80°	152.5	3.9
80°-90°	38.8	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1501.1	38.6
0°-40°	2284.0	58.8
0°-60°	3399.1	87.4
0°-90°	3887.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3887.3	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	2087	2087	2087	2087	2087	
5°	2171	2137	2073	2005	1977	208
15°	2216	2132	1932	1756	1688	625
25°	2045	1904	1620	1413	1334	937
35°	1593	1463	1211	1050	992	989
45°	1036	963	814	710	677	802
55°	649	595	500	444	413	584
65°	385	343	281	244	256	385
75°	182	157	124	129	138	195
85°	34	31	31	34	36	43
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582538

CATALOG NUMBER: HCC6S40D010MB-HM63040935-61WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	2086.8	2086.8	2086.8	2086.8	2086.8	2086.8	2086.8	2086.8	2086.8
2.5°	2126.1	2117.7	2106.4	2095.2	2078.3	2058.7	2041.9	2036.3	2027.8
5°	2171.1	2159.9	2137.3	2109.3	2072.8	2036.3	2005.4	1985.8	1977.3
7.5°	2199.2	2185.1	2154.2	2106.4	2053.2	1999.7	1954.8	1926.7	1915.5
10°	2204.8	2190.7	2148.7	2084.0	2013.8	1940.8	1884.6	1851.0	1836.8
12.5°	2213.2	2193.5	2140.2	2064.4	1974.4	1890.3	1820.0	1777.9	1763.8
15°	2216.1	2193.5	2131.8	2039.0	1932.3	1831.2	1755.5	1704.8	1688.1
17.5°	2204.8	2179.5	2106.4	1994.2	1873.4	1766.7	1676.7	1623.4	1600.9
20°	2165.4	2137.3	2053.2	1926.7	1794.8	1682.4	1589.7	1533.5	1508.3
22.5°	2114.9	2078.3	1982.9	1848.1	1710.5	1592.6	1499.8	1443.6	1418.3
25°	2044.7	2010.9	1904.2	1761.0	1620.5	1497.1	1412.8	1353.8	1334.2
27.5°	1963.2	1923.9	1814.4	1671.2	1527.9	1404.3	1322.8	1269.5	1244.2
30°	1853.7	1817.2	1707.7	1564.5	1424.0	1308.8	1224.6	1179.6	1168.4
32.5°	1724.5	1693.6	1586.9	1452.1	1317.3	1210.6	1140.3	1092.5	1081.3
35°	1592.6	1556.0	1463.3	1336.9	1210.6	1115.1	1050.5	1008.2	991.5
37.5°	1449.3	1415.6	1336.9	1224.6	1112.2	1022.4	966.2	929.6	912.7
40°	1297.6	1272.3	1199.2	1109.4	1008.2	929.6	881.9	851.0	834.1
42.5°	1157.2	1131.8	1081.3	997.0	912.7	842.6	800.5	772.4	758.3
45°	1036.3	1013.9	963.4	890.3	814.5	755.5	710.5	690.9	676.9
47.5°	915.6	904.4	859.5	792.1	721.8	671.2	640.4	618.0	606.6
50°	822.9	808.9	766.7	696.6	637.6	598.3	570.2	550.6	539.2
52.5°	727.4	713.4	674.0	615.0	567.3	530.9	502.8	485.9	474.7
55°	648.8	637.6	595.4	542.1	499.9	469.0	443.7	424.1	412.8
57.5°	575.7	564.5	525.2	474.7	438.2	410.1	387.7	370.8	356.7
60°	508.3	499.9	460.6	412.8	382.0	353.9	334.2	320.1	311.8
62.5°	449.4	432.5	398.9	356.7	328.6	306.1	286.5	278.0	283.7
65°	384.8	376.3	342.7	306.1	280.8	258.4	244.4	250.0	255.6
67.5°	331.5	320.1	292.2	258.4	236.0	219.1	210.6	221.9	224.6
70°	278.0	266.8	241.5	213.4	193.8	182.5	182.5	191.0	193.8
72.5°	227.5	219.1	196.7	174.1	160.1	151.7	157.2	162.9	165.7
75°	182.5	174.1	157.2	137.6	123.6	123.6	129.3	134.8	137.6
77.5°	140.5	134.8	117.9	103.9	98.3	98.3	103.9	106.7	109.5
80°	98.3	92.7	84.3	75.8	70.2	75.8	81.5	81.5	84.3
82.5°	64.6	61.7	56.2	50.5	50.5	53.4	56.2	59.0	59.0
85°	33.8	33.8	30.9	28.1	30.9	33.8	33.8	36.5	36.5
87.5°	11.2	11.2	11.2	11.2	14.0	14.0	14.0	14.0	14.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)