

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582530

Luminaire Tested: **HCC6W40D010SL-HM63040935-61RWWC**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P582530  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-14)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6W40D010SL-HM63040935-61RWWC  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, SPECULAR TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 4185.0 lumens  
Efficiency: N/A  
Efficacy: 102.1 lumens/watt  
Spacing Criteria (0/90/45): 1.22 / 1.15 / 1.2  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P582530  
CATALOG NUMBER: HCC6W40D010SL-HM63040935-61RWWC

### Luminous Intensity Polar Plot

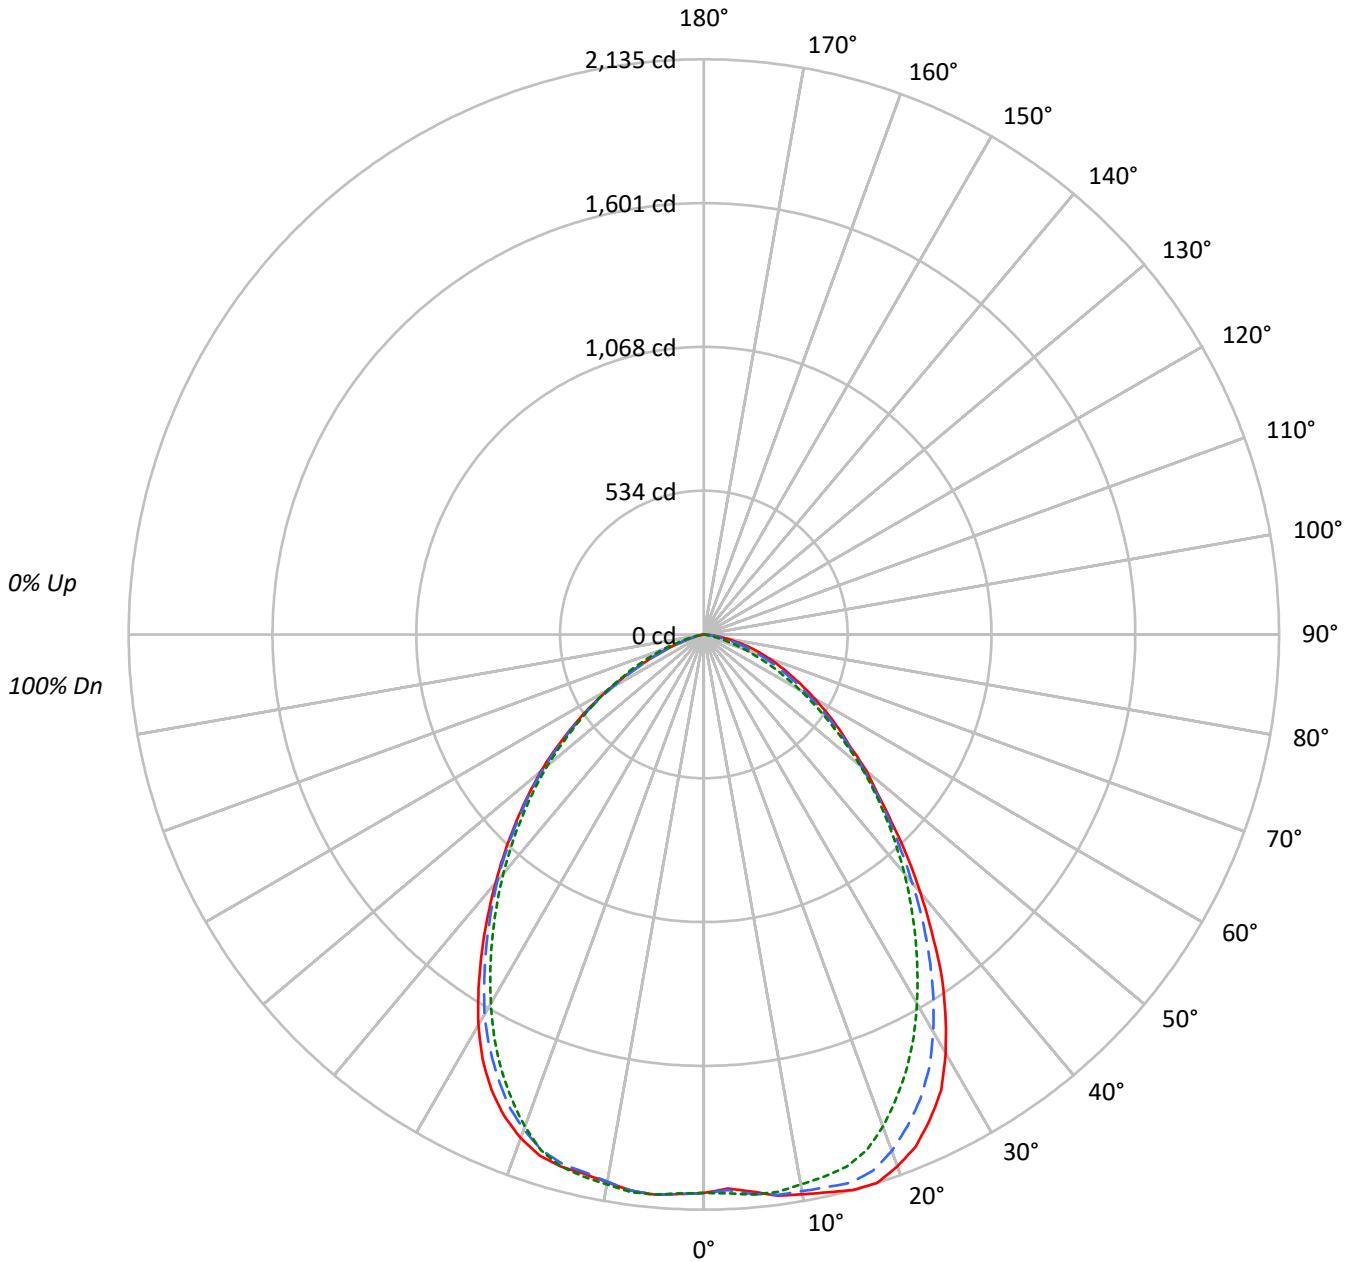

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582530

CATALOG NUMBER: HCC6W40D010SL-HM63040935-61RWWC

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	88								
2	103	96	90	86	100	94	89	85	91	86	83	88	84	81	85	82	79	77								
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	69	68								
4	88	78	70	64	86	76	69	64	74	68	63	72	67	62	70	65	61	60								
5	82	70	62	57	80	69	62	56	67	61	56	65	60	55	64	59	55	53								
6	76	64	56	50	74	63	56	50	62	55	50	60	54	49	58	53	49	47								
7	71	59	51	45	69	58	50	45	56	50	45	55	49	45	54	48	44	42								
8	66	54	46	41	65	53	46	41	52	45	41	51	45	40	50	44	40	38								
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35								
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	113637	113637	113637
5°	114225	114841	114841
10°	117427	115390	114922
15°	121153	116051	116051
20°	122569	113392	116018
25°	120122	107716	112815
30°	113619	100098	105972
35°	102827	91544	96055
40°	89446	82819	86025
45°	76442	73822	76442
50°	67077	64680	67315
55°	58521	54497	56638
60°	51739	45260	44657
65°	45906	35711	30613
70°	40536	25229	18449
75°	34504	14276	8917
80°	25729	4420	2652
85°	14089	1761	1761



TEST NUMBER: P582530  
 CATALOG NUMBER: HCC6W40D010SL-HM63040935-61RWWC

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	198.8	4.8
10°-20°	581.8	13.9
20°-30°	849.7	20.3
30°-40°	891.1	21.3
40°-50°	750.7	17.9
50°-60°	526.0	12.6
60°-70°	282.0	6.7
70°-80°	94.6	2.3
80°-90°	10.3	0.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1630.3	39.0
0°-40°	2521.4	60.2
0°-60°	3798.1	90.8
0°-90°	4185.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4185.0	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	2073	2073	2073	2073	2073	
5°	2076	2084	2087	2087	2087	200
15°	2135	2107	2045	2034	2045	602
25°	1986	1902	1781	1812	1865	910
35°	1536	1458	1368	1407	1435	954
45°	986	969	952	978	986	768
55°	612	593	570	581	593	551
65°	354	323	275	228	236	353
75°	163	126	67	42	42	173
85°	22	11	3	3	3	31
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582530

CATALOG NUMBER: HCC6W40D010SL-HM63040935-61RWWC

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	2072.9	2072.9	2072.9	2072.9	2072.9	2072.9	2072.9	2072.9	2072.9
2.5°	2058.8	2058.8	2064.5	2070.2	2075.7	2075.7	2078.6	2081.4	2078.6
5°	2075.7	2075.7	2084.2	2086.9	2086.9	2084.2	2086.9	2086.9	2086.9
7.5°	2101.0	2095.4	2098.3	2092.6	2086.9	2084.2	2081.4	2081.4	2081.4
10°	2109.5	2103.8	2098.3	2086.9	2072.9	2064.5	2061.7	2064.5	2064.5
12.5°	2120.7	2115.0	2101.0	2078.6	2061.7	2047.6	2044.8	2050.5	2050.5
15°	2134.7	2129.1	2106.7	2070.2	2044.8	2030.9	2033.6	2039.2	2044.8
17.5°	2134.7	2123.5	2086.9	2039.2	2008.3	1994.3	2005.5	2019.5	2028.0
20°	2101.0	2089.8	2039.2	1980.2	1943.7	1935.2	1955.0	1980.2	1988.7
22.5°	2056.1	2033.6	1974.7	1904.4	1865.1	1865.1	1893.2	1924.0	1935.2
25°	1985.9	1969.0	1901.6	1820.1	1780.8	1778.0	1811.8	1853.9	1865.1
27.5°	1907.3	1884.7	1811.8	1727.5	1685.3	1688.2	1724.6	1766.8	1778.0
30°	1794.9	1766.8	1702.2	1620.7	1581.3	1592.6	1629.1	1660.1	1674.1
32.5°	1668.4	1643.2	1584.3	1508.4	1474.6	1485.9	1516.7	1544.8	1556.2
35°	1536.5	1508.4	1457.8	1390.4	1367.9	1379.1	1407.2	1429.7	1435.3
37.5°	1387.6	1367.9	1331.4	1278.0	1261.2	1275.2	1297.6	1311.7	1317.4
40°	1249.9	1233.1	1202.1	1162.8	1157.3	1168.5	1190.9	1199.4	1202.1
42.5°	1115.1	1101.1	1081.4	1053.4	1053.4	1064.6	1084.2	1089.9	1092.7
45°	986.0	977.5	969.1	946.6	952.2	966.3	977.5	986.0	986.0
47.5°	873.6	876.3	865.1	848.2	853.9	867.9	876.3	884.8	884.8
50°	786.5	778.1	766.9	750.0	758.4	769.6	780.8	786.5	789.3
52.5°	685.4	682.6	674.1	654.5	660.0	665.7	676.9	685.4	688.1
55°	612.3	604.0	592.6	570.2	570.2	575.9	581.4	587.1	592.6
57.5°	542.1	533.7	516.8	491.6	488.7	488.7	485.9	491.6	500.0
60°	471.9	469.0	443.8	421.3	412.8	404.5	393.2	396.1	407.3
62.5°	410.1	404.5	382.0	353.9	337.0	323.0	308.9	306.1	317.4
65°	353.9	348.3	323.0	294.9	275.3	250.0	227.5	227.5	236.0
67.5°	303.4	292.2	269.6	238.7	213.4	182.5	160.1	165.7	168.6
70°	252.9	244.4	219.1	188.2	157.4	126.4	112.4	115.1	115.1
72.5°	207.9	196.7	171.3	140.5	109.6	81.5	75.8	73.1	73.1
75°	162.9	151.7	126.4	95.5	67.4	47.7	42.1	42.1	42.1
77.5°	117.9	109.6	87.1	59.0	36.5	22.4	19.7	16.9	16.9
80°	81.5	73.1	53.4	30.9	14.0	8.4	8.4	8.4	8.4
82.5°	47.7	39.3	25.3	14.0	5.7	2.8	2.8	2.8	2.8
85°	22.4	16.9	11.2	5.7	2.8	2.8	2.8	2.8	2.8
87.5°	2.8	2.8	2.8	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)