

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P593298

Luminaire Tested: **HCC6W40D010SL-HM63040950-61WDW**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P593298
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W40D010SL-HM63040950-61WDW
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WIDE DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4206.5 lumens
Efficiency: N/A
Efficacy: 102.6 lumens/watt
Spacing Criteria (0/90/45): 1.11 / 1.11 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 41
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P593298
CATALOG NUMBER: HCC6W40D010SL-HM63040950-61WDW

Luminous Intensity Polar Plot

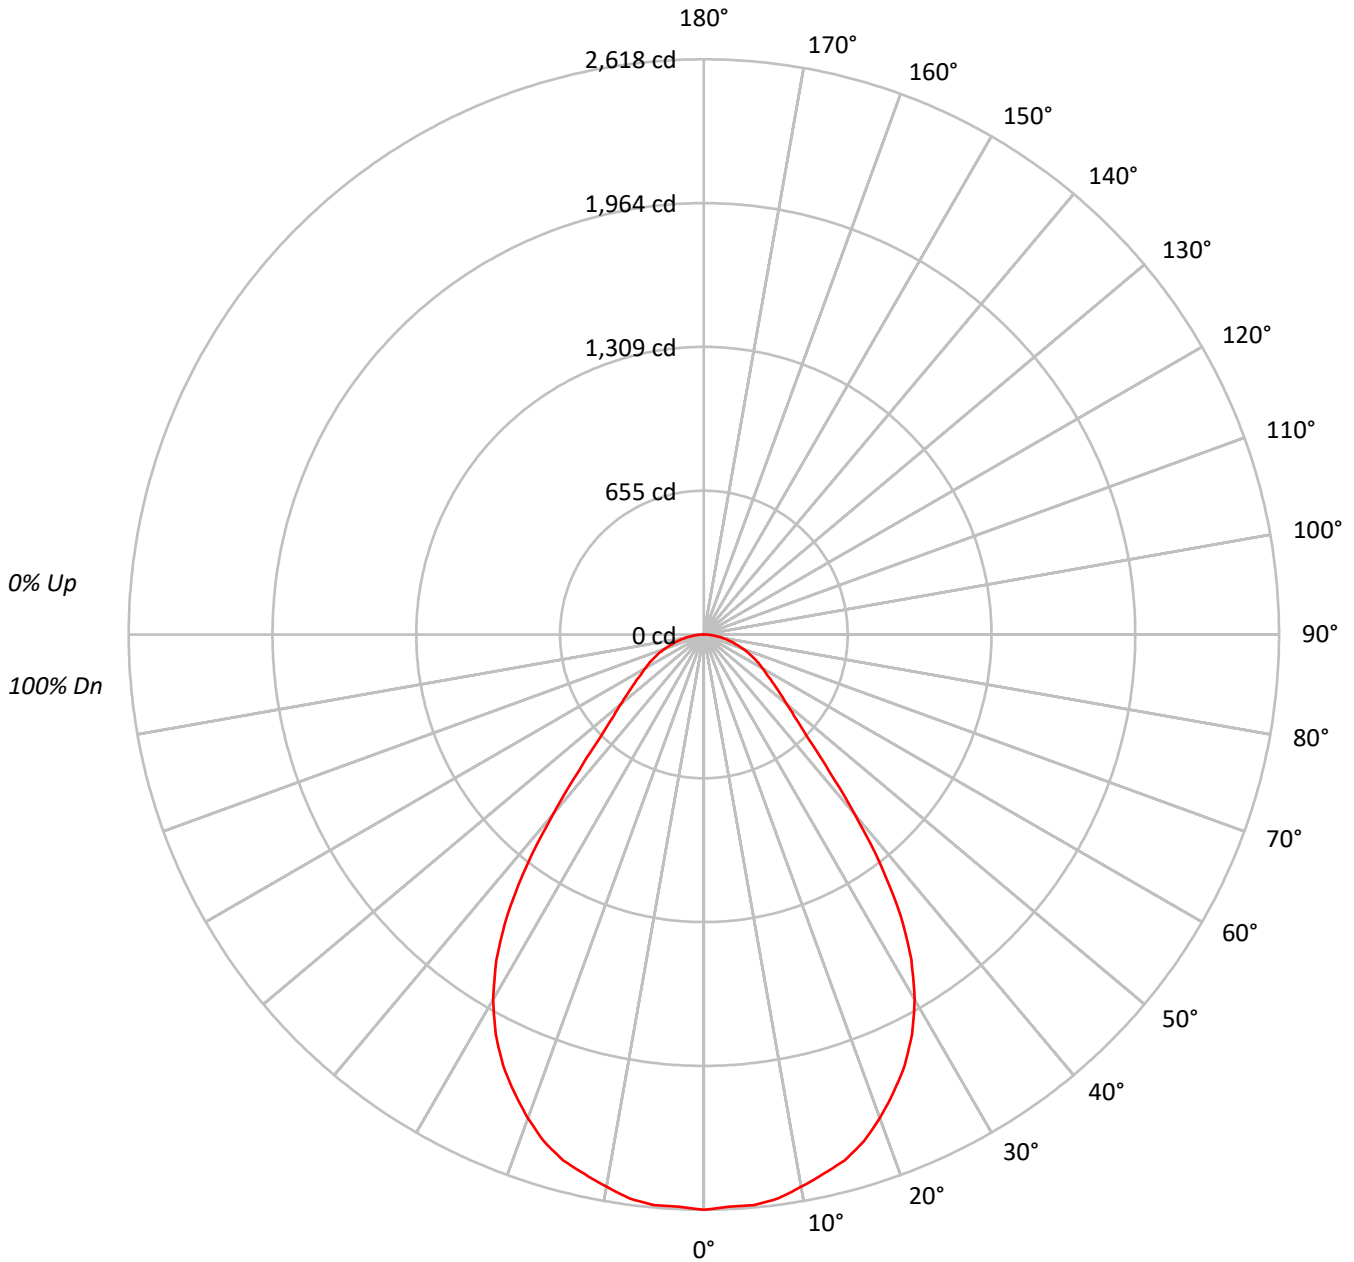

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P593298

CATALOG NUMBER: HCC6W40D010SL-HM63040950-61WDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	89			89
2	103	97	91	87	101	95	90	86	91	87	84	88	85	82	85	83	80	78			78
3	96	87	81	76	94	86	80	75	83	78	74	81	76	72	78	74	71	69			69
4	89	80	72	67	87	78	72	66	76	70	66	74	69	65	72	67	64	62			62
5	84	73	65	60	82	72	65	59	70	64	59	68	63	58	66	61	58	56			56
6	78	67	59	54	76	66	59	54	64	58	53	63	57	53	61	56	52	51			51
7	73	62	54	49	72	61	54	49	60	53	48	58	52	48	57	52	48	46			46
8	69	57	50	45	68	57	50	45	55	49	44	54	48	44	53	48	44	42			42
9	65	53	46	41	64	53	46	41	52	45	41	51	45	41	50	44	41	39			39
10	61	50	43	38	60	49	42	38	48	42	38	47	42	38	47	41	38	36			36

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	143547
5°	143462
10°	142076
15°	140597
20°	136623
25°	130852
30°	121443
35°	104487
40°	76279
45°	52253
50°	42011
55°	36625
60°	33802
65°	32131
70°	30021
75°	28086
80°	25477
85°	21763



TEST NUMBER: P593298
 CATALOG NUMBER: HCC6W40D010SL-HM63040950-61WDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	247.1	5.9
10°-20°	695.7	16.5
20°-30°	989.5	23.5
30°-40°	952.7	22.6
40°-50°	548.1	13.0
50°-60°	347.3	8.3
60°-70°	245.9	5.8
70°-80°	140.2	3.3
80°-90°	40.0	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1932.4	45.9
0°-40°	2885.0	68.6
0°-60°	3780.5	89.9
0°-90°	4206.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4206.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2618	
5°	2607	247
15°	2477	696
25°	2163	990
35°	1561	953
45°	674	548
55°	383	347
65°	248	246
75°	133	140
85°	35	40
90°	0	



TEST NUMBER: P593298
CATALOG NUMBER: HCC6W40D010SL-HM63040950-61WDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2618.5
2.5°	2607.0
5°	2607.0
7.5°	2589.7
10°	2552.3
12.5°	2514.8
15°	2477.3
17.5°	2419.7
20°	2341.9
22.5°	2255.5
25°	2163.3
27.5°	2051.0
30°	1918.5
32.5°	1757.2
35°	1561.3
37.5°	1322.2
40°	1065.9
42.5°	841.1
45°	674.0
47.5°	567.4
50°	492.6
52.5°	432.1
55°	383.2
57.5°	339.9
60°	308.3
62.5°	279.4
65°	247.7
67.5°	219.0
70°	187.3
72.5°	158.4
75°	132.6
77.5°	106.6
80°	80.7
82.5°	57.6
85°	34.6
87.5°	14.4
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)