

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582790

Luminaire Tested: **HCC6W50D010SL-HM64560927-61WWW**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P582790
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W50D010SL-HM64560927-61WWW
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3716.0 lumens
Efficiency: N/A
Efficacy: 77.4 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.06 / 1.14
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 48
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P582790
CATALOG NUMBER: HCC6W50D010SL-HM64560927-61WWW

Luminous Intensity Polar Plot

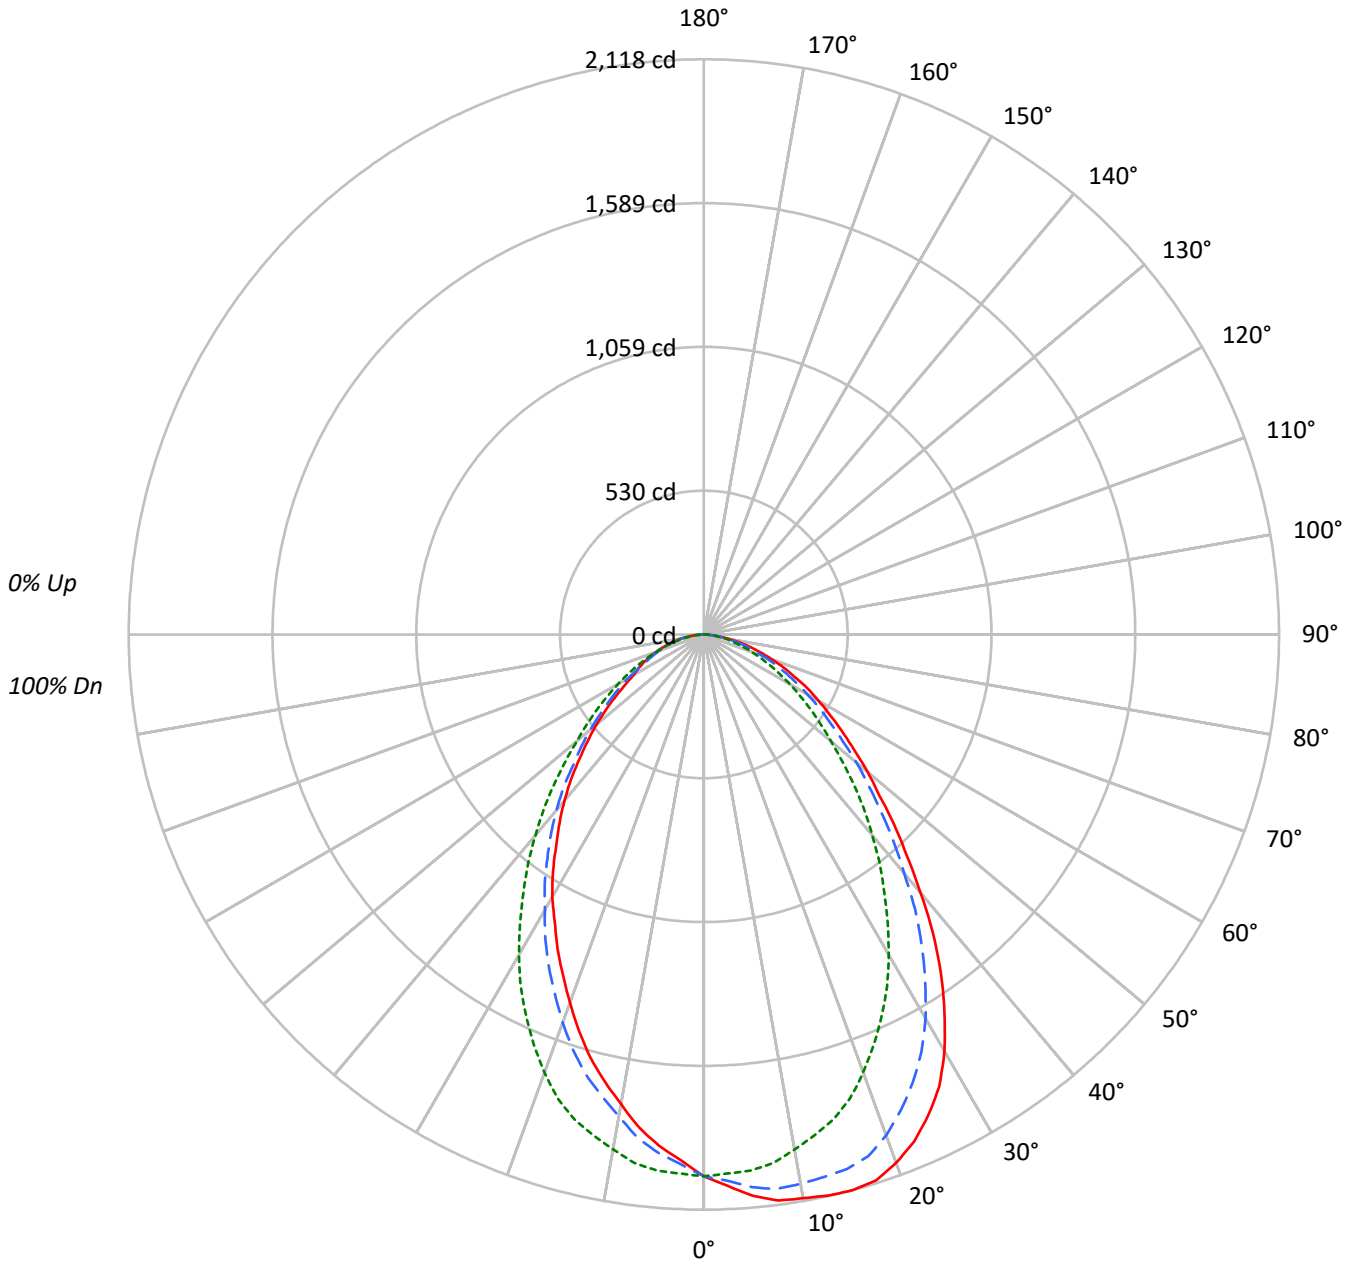



TEST NUMBER: P582790

CATALOG NUMBER: HCC6W50D010SL-HM64560927-61WWW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	110	106	103	99	108	104	101	98	100	97	95	96	94	92	93	91	89	87					87			
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76					76			
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66					66			
4	87	76	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58					58			
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51					51			
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46					46			
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42					42			
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38					38			
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34					34			
10	58	46	39	34	57	45	38	34	44	38	33	44	38	33	43	37	33	32					32			

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	109355	109355	109355
5°	114214	109041	104017
10°	117321	107157	97744
15°	120228	104836	91578
20°	120766	100085	84112
25°	118229	93707	77146
30°	112175	86165	70701
35°	101877	77437	63430
40°	88766	68979	57064
45°	76806	60363	50168
50°	67094	51981	43964
55°	59286	45685	37724
60°	53285	40041	32673
65°	47722	34816	31690
70°	42603	29701	29701
75°	36982	25015	27874
80°	29675	21183	25414
85°	20254	18555	22015



TEST NUMBER: P582790
 CATALOG NUMBER: HCC6W50D010SL-HM64560927-61WWW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	187.5	5.0
10°-20°	521.2	14.0
20°-30°	726.3	19.5
30°-40°	748.4	20.1
40°-50°	620.2	16.7
50°-60°	445.7	12.0
60°-70°	283.9	7.6
70°-80°	145.8	3.9
80°-90°	37.1	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1435.0	38.6
0°-40°	2183.4	58.8
0°-60°	3249.3	87.4
0°-90°	3716.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3716.0	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	1995	1995	1995	1995	1995	
5°	2076	2043	1982	1917	1890	199
15°	2118	2038	1847	1678	1614	597
25°	1955	1820	1549	1350	1275	896
35°	1522	1399	1157	1004	948	946
45°	991	921	779	679	647	767
55°	620	569	478	424	395	559
65°	368	328	268	234	244	368
75°	175	150	118	124	132	186
85°	32	30	30	32	35	41
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P582790

CATALOG NUMBER: HCC6W50D010SL-HM64560927-61WWW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1994.8	1994.8	1994.8	1994.8	1994.8	1994.8	1994.8	1994.8	1994.8
2.5°	2032.5	2024.5	2013.7	2003.0	1986.8	1968.0	1952.0	1946.5	1938.5
5°	2075.5	2064.7	2043.2	2016.3	1981.5	1946.5	1917.0	1898.2	1890.2
7.5°	2102.3	2088.8	2059.3	2013.7	1962.7	1911.7	1868.7	1841.9	1831.1
10°	2107.6	2094.3	2054.0	1992.2	1925.0	1855.2	1801.6	1769.4	1755.9
12.5°	2115.8	2096.9	2045.8	1973.5	1887.5	1806.9	1739.8	1699.6	1686.1
15°	2118.4	2096.9	2037.8	1949.2	1847.2	1750.6	1678.1	1629.8	1613.6
17.5°	2107.6	2083.5	2013.7	1906.3	1790.9	1688.8	1602.9	1551.8	1530.3
20°	2070.1	2043.2	1962.7	1841.9	1715.6	1608.3	1519.7	1466.0	1441.8
22.5°	2021.8	1986.8	1895.5	1766.7	1635.1	1522.3	1433.7	1380.0	1355.9
25°	1954.6	1922.4	1820.4	1683.4	1549.2	1431.0	1350.5	1294.1	1275.4
27.5°	1876.7	1839.2	1734.4	1597.5	1460.5	1342.4	1264.6	1213.6	1189.4
30°	1772.1	1737.1	1632.4	1495.5	1361.2	1251.2	1170.6	1127.6	1116.9
32.5°	1648.6	1619.0	1517.0	1388.1	1259.2	1157.1	1090.1	1044.5	1033.7
35°	1522.3	1487.5	1398.9	1278.0	1157.1	1065.9	1004.2	963.9	947.8
37.5°	1385.4	1353.2	1278.0	1170.6	1063.3	977.3	923.7	888.7	872.6
40°	1240.4	1216.3	1146.4	1060.5	963.9	888.7	843.1	813.5	797.4
42.5°	1106.1	1082.0	1033.7	953.2	872.6	805.4	765.2	738.4	724.9
45°	990.7	969.2	920.9	851.1	778.6	722.2	679.3	660.5	647.1
47.5°	875.2	864.5	821.6	757.1	690.1	641.6	612.1	590.7	580.0
50°	786.7	773.2	732.9	665.8	609.5	571.8	545.0	526.3	515.5
52.5°	695.4	681.9	644.4	588.0	542.3	507.5	480.5	464.5	453.7
55°	620.3	609.5	569.2	518.2	478.0	448.4	424.2	405.4	394.7
57.5°	550.5	539.7	502.0	453.7	418.9	392.0	370.5	354.4	341.0
60°	486.0	478.0	440.3	394.7	365.2	338.4	319.5	306.1	298.0
62.5°	429.5	413.5	381.2	341.0	314.1	292.7	273.9	265.8	271.2
65°	367.9	359.7	327.6	292.7	268.4	247.1	233.6	238.9	244.3
67.5°	316.9	306.1	279.2	247.1	225.6	209.4	201.4	212.1	214.8
70°	265.8	255.1	230.9	204.1	185.3	174.6	174.6	182.6	185.3
72.5°	217.4	209.4	187.9	166.5	153.1	145.0	150.3	155.8	158.4
75°	174.6	166.5	150.3	131.6	118.1	118.1	123.5	128.8	131.6
77.5°	134.3	128.8	112.8	99.3	94.0	94.0	99.3	102.0	104.8
80°	94.0	88.6	80.5	72.5	67.1	72.5	77.8	77.8	80.5
82.5°	61.8	59.0	53.7	48.3	48.3	51.0	53.7	56.3	56.3
85°	32.2	32.2	29.5	26.8	29.5	32.2	32.2	35.0	35.0
87.5°	10.7	10.7	10.7	10.7	13.5	13.5	13.5	13.5	13.5
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180° - - 45°-225° - - - - 90°-270°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)