

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582884

Luminaire Tested: **HCC6W05D010MB-HM60525835-61MDH**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P582884
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-5)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W05D010MB-HM60525835-61MDH
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" MEDIUM DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3500K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 687.4 lumens
Efficiency: N/A
Efficacy: 114.6 lumens/watt
Spacing Criteria (0/90/45): 1.01 / 1.01 / 0.97
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P582884
CATALOG NUMBER: HCC6W05D010MB-HM60525835-61MDH

Luminous Intensity Polar Plot

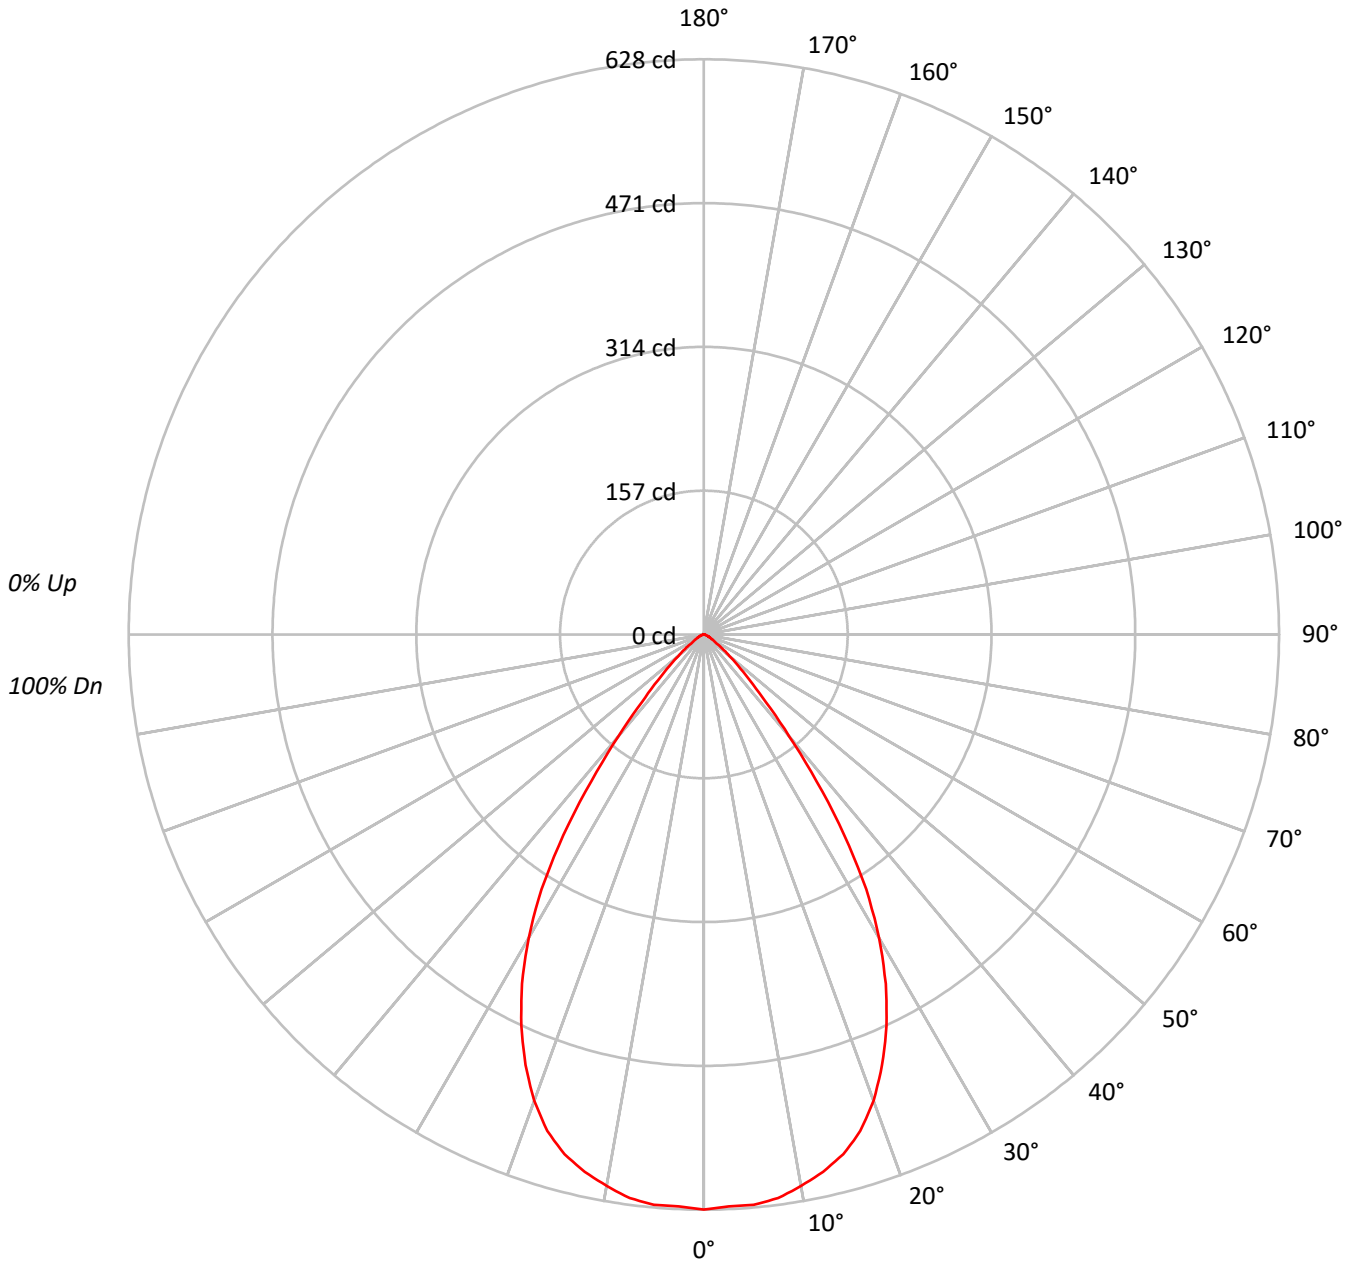

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P582884

CATALOG NUMBER: HCC6W05D010MB-HM60525835-61MDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	103	104	102	100	100	99	97	97	96	94	93	93	93	93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85	85	85	85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	81	86	83	80	79	79	79	79
4	96	88	82	77	94	86	81	77	84	79	76	82	78	75	80	77	74	72	72	72	72
5	90	81	75	71	89	80	75	70	79	74	70	77	73	69	75	72	68	67	67	67	67
6	85	76	70	65	84	75	69	65	74	68	64	72	67	64	71	67	63	62	62	62	62
7	81	71	65	60	79	70	64	60	69	64	60	68	63	59	67	62	59	57	57	57	57
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53	53	53	53
9	73	62	56	52	71	62	56	52	61	56	52	60	55	51	59	55	51	50	50	50	50
10	69	59	53	49	68	58	52	48	57	52	48	57	52	48	56	51	48	47	47	47	47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	34422
5°	34393
10°	34034
15°	33354
20°	31596
25°	28532
30°	24232
35°	17895
40°	10348
45°	5497
50°	3104
55°	1625
60°	1064
65°	765
70°	545
75°	402
80°	316
85°	314



TEST NUMBER: P582884
 CATALOG NUMBER: HCC6W05D010MB-HM60525835-61MDH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	59.2	8.6
10°-20°	164.4	23.9
20°-30°	214.5	31.2
30°-40°	163.9	23.8
40°-50°	59.4	8.6
50°-60°	17.3	2.5
60°-70°	6.2	0.9
70°-80°	2.1	0.3
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	438.1	63.7
0°-40°	602.1	87.6
0°-60°	678.7	98.7
0°-90°	687.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	687.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	628	
5°	625	59
15°	588	164
25°	472	215
35°	267	164
45°	71	59
55°	17	17
65°	6	6
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P582884
CATALOG NUMBER: HCC6W05D010MB-HM60525835-61MDH

CANDELA DISTRIBUTION (FULL):

	0°
0°	627.9
2.5°	625.0
5°	625.0
7.5°	620.7
10°	611.4
12.5°	600.8
15°	587.7
17.5°	568.3
20°	541.6
22.5°	508.6
25°	471.7
27.5°	430.0
30°	382.8
32.5°	330.0
35°	267.4
37.5°	201.8
40°	144.6
42.5°	100.0
45°	70.9
47.5°	51.0
50°	36.4
52.5°	25.8
55°	17.0
57.5°	12.1
60°	9.7
62.5°	7.8
65°	5.9
67.5°	4.9
70°	3.4
72.5°	2.4
75°	1.9
77.5°	1.5
80°	1.0
82.5°	0.5
85°	0.5
87.5°	0.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)