

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582890

Luminaire Tested: **HCC6W05D010MW-HM60525835-61RWWC**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P582890  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-14)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6W05D010MW-HM60525835-61RWWC  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, SPECULAR TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 722.7 lumens  
Efficiency: N/A  
Efficacy: 120.5 lumens/watt  
Spacing Criteria (0/90/45): 1.22 / 1.15 / 1.2  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 6  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P582890  
CATALOG NUMBER: HCC6W05D010MW-HM60525835-61RWWC

### Luminous Intensity Polar Plot

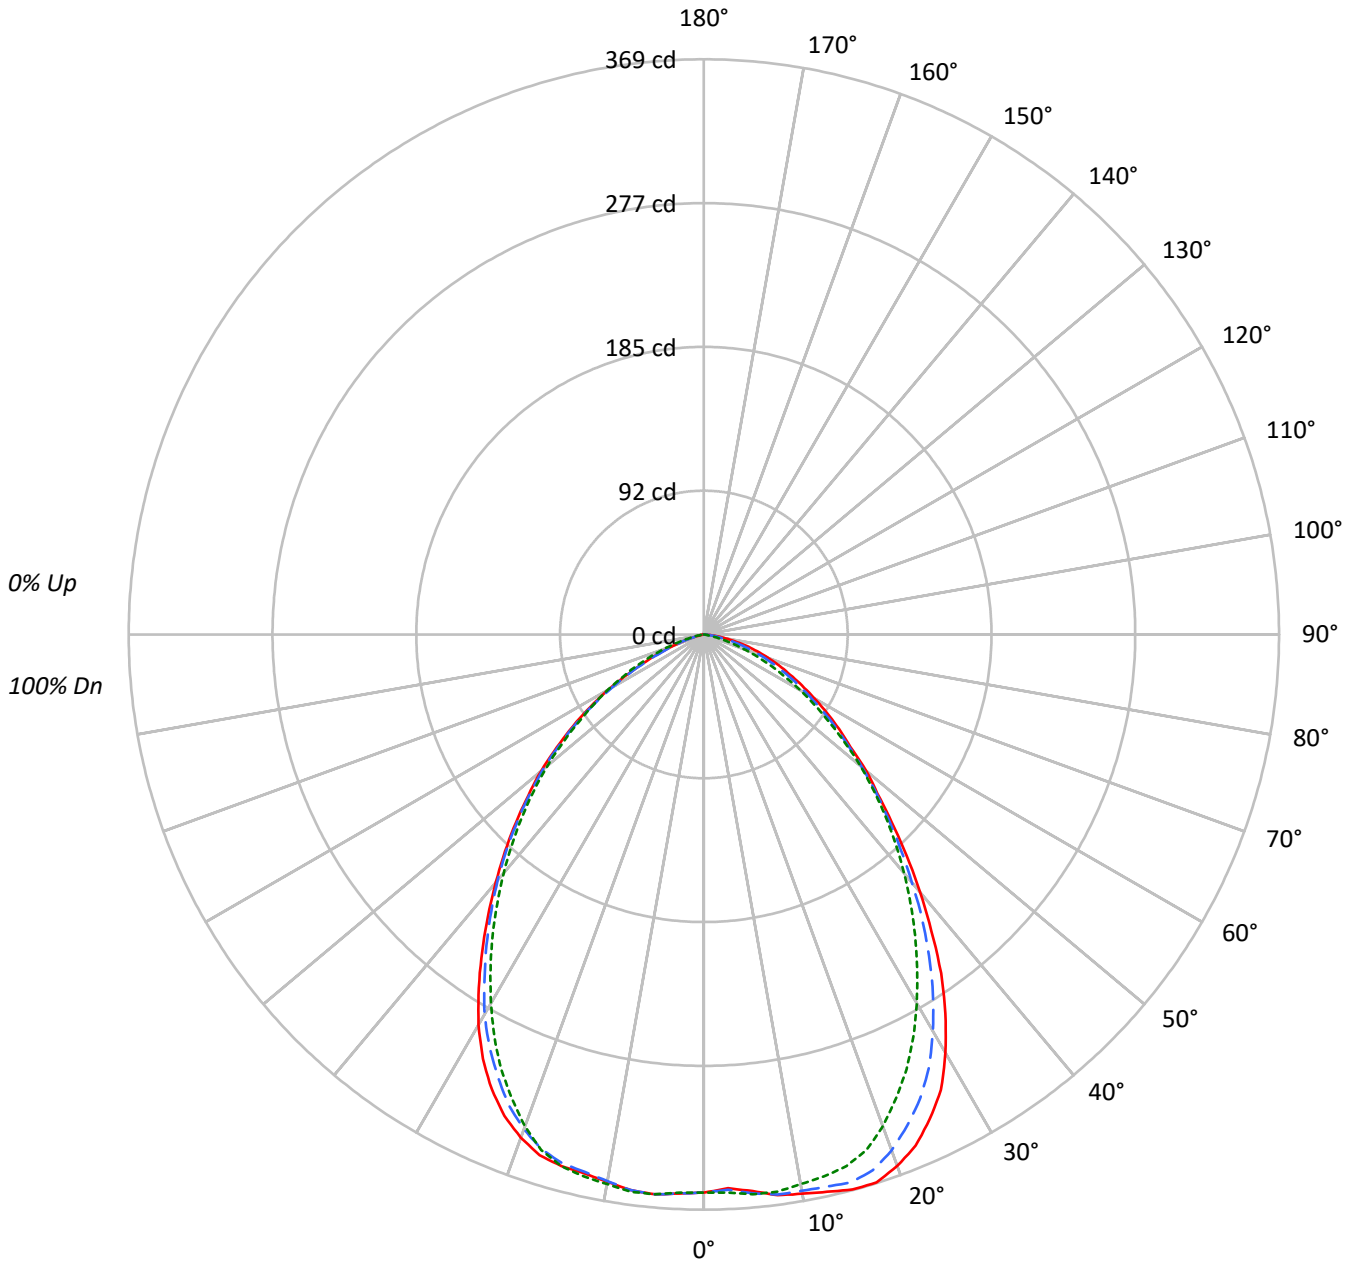

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582890

CATALOG NUMBER: HCC6W05D010MW-HM60525835-61RWWC

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	88																			
2	103	96	90	86	100	94	89	85	91	86	83	88	84	81	85	82	79	77																			
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	69	68																			
4	88	78	70	64	86	76	69	64	74	68	63	72	67	62	70	65	61	60																			
5	82	70	62	57	80	69	62	56	67	61	56	65	60	55	64	59	55	53																			
6	76	64	56	50	74	63	56	50	62	55	50	60	54	49	58	53	49	47																			
7	71	59	51	45	69	58	50	45	56	50	45	55	49	45	54	48	44	42																			
8	66	54	46	41	65	53	46	41	52	45	41	51	45	40	50	44	40	38																			
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35																			
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	19626	19626	19626
5°	19723	19838	19838
10°	20279	19928	19845
15°	20920	20040	20040
20°	21165	19584	20033
25°	20747	18606	19477
30°	19623	17287	18300
35°	17755	15814	16590
40°	15443	14305	14856
45°	13203	12746	13203
50°	11582	11172	11624
55°	10112	9405	9787
60°	8936	7817	7708
65°	7926	6174	5292
70°	6988	4344	3190
75°	5952	2457	1525
80°	4420	758	474
85°	2390	314	314



TEST NUMBER: P582890  
 CATALOG NUMBER: HCC6W05D010MW-HM60525835-61RWWC

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	34.3	4.8
10°-20°	100.5	13.9
20°-30°	146.7	20.3
30°-40°	153.9	21.3
40°-50°	129.6	17.9
50°-60°	90.8	12.6
60°-70°	48.7	6.7
70°-80°	16.3	2.3
80°-90°	1.8	0.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	281.5	39.0
0°-40°	435.4	60.2
0°-60°	655.9	90.8
0°-90°	722.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	722.7	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	358	358	358	358	358	
5°	358	360	360	360	360	34
15°	369	364	353	351	353	104
25°	343	328	308	313	322	157
35°	265	252	236	243	248	165
45°	170	167	164	169	170	133
55°	106	102	98	100	102	95
65°	61	56	48	39	41	61
75°	28	22	12	7	7	30
85°	4	2	0	0	0	5
90°	0	0	0	0	0	



TEST NUMBER: P582890

CATALOG NUMBER: HCC6W05D010MW-HM60525835-61RWWC

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	358.0	358.0	358.0	358.0	358.0	358.0	358.0	358.0	358.0
2.5°	355.6	355.6	356.5	357.5	358.4	358.4	359.0	359.5	359.0
5°	358.4	358.4	359.9	360.5	360.5	359.9	360.5	360.5	360.5
7.5°	362.8	361.8	362.4	361.4	360.5	359.9	359.5	359.5	359.5
10°	364.3	363.3	362.4	360.5	358.0	356.5	356.1	356.5	356.5
12.5°	366.2	365.2	362.8	359.0	356.1	353.6	353.1	354.1	354.1
15°	368.6	367.7	363.9	357.5	353.1	350.8	351.2	352.2	353.1
17.5°	368.6	366.7	360.5	352.2	346.8	344.4	346.3	348.7	350.2
20°	362.8	360.9	352.2	341.9	335.7	334.3	337.6	341.9	343.4
22.5°	355.0	351.2	341.0	328.8	322.0	322.0	326.9	332.3	334.3
25°	343.0	340.0	328.4	314.4	307.6	307.0	312.9	320.1	322.0
27.5°	329.4	325.4	312.9	298.3	291.1	291.5	297.9	305.1	307.0
30°	310.0	305.1	293.9	279.9	273.1	275.0	281.4	286.7	289.1
32.5°	288.2	283.7	273.6	260.5	254.7	256.6	261.9	266.8	268.7
35°	265.3	260.5	251.8	240.1	236.3	238.2	243.1	246.9	247.9
37.5°	239.7	236.3	230.0	220.7	217.8	220.2	224.1	226.6	227.5
40°	215.8	213.0	207.6	200.8	199.9	201.8	205.7	207.1	207.6
42.5°	192.6	190.2	186.8	181.9	181.9	183.9	187.2	188.3	188.7
45°	170.3	168.8	167.4	163.5	164.4	166.9	168.8	170.3	170.3
47.5°	150.9	151.3	149.4	146.4	147.5	149.8	151.3	152.8	152.8
50°	135.8	134.4	132.4	129.5	131.0	132.9	134.8	135.8	136.3
52.5°	118.3	117.9	116.4	113.0	114.0	114.9	117.0	118.3	118.9
55°	105.8	104.3	102.4	98.4	98.4	99.4	100.5	101.4	102.4
57.5°	93.7	92.2	89.3	84.9	84.4	84.4	84.0	84.9	86.3
60°	81.5	81.0	76.6	72.8	71.3	69.8	67.9	68.4	70.3
62.5°	70.9	69.8	66.0	61.1	58.2	55.8	53.3	52.9	54.8
65°	61.1	60.1	55.8	51.0	47.6	43.2	39.3	39.3	40.8
67.5°	52.4	50.4	46.6	41.2	36.8	31.5	27.7	28.6	29.2
70°	43.6	42.1	37.9	32.5	27.1	21.8	19.4	19.9	19.9
72.5°	35.9	33.9	29.6	24.3	18.9	14.0	13.1	12.7	12.7
75°	28.1	26.2	21.8	16.5	11.6	8.2	7.2	7.2	7.2
77.5°	20.3	18.9	15.0	10.2	6.3	3.8	3.4	2.9	2.9
80°	14.0	12.7	9.3	5.3	2.4	1.5	1.5	1.5	1.5
82.5°	8.2	6.8	4.4	2.4	1.0	0.5	0.5	0.5	0.5
85°	3.8	2.9	1.9	1.0	0.5	0.5	0.5	0.5	0.5
87.5°	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)