

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582988

Luminaire Tested: **HCC6S05D010MW-HM60525940-61WWW**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P582988  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6S05D010MW-HM60525940-61WWW  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 603.7 lumens  
Efficiency: N/A  
Efficacy: 100.6 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.06 / 1.14  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 6  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P582988  
CATALOG NUMBER: HCC6S05D010MW-HM60525940-61WWW

### Luminous Intensity Polar Plot

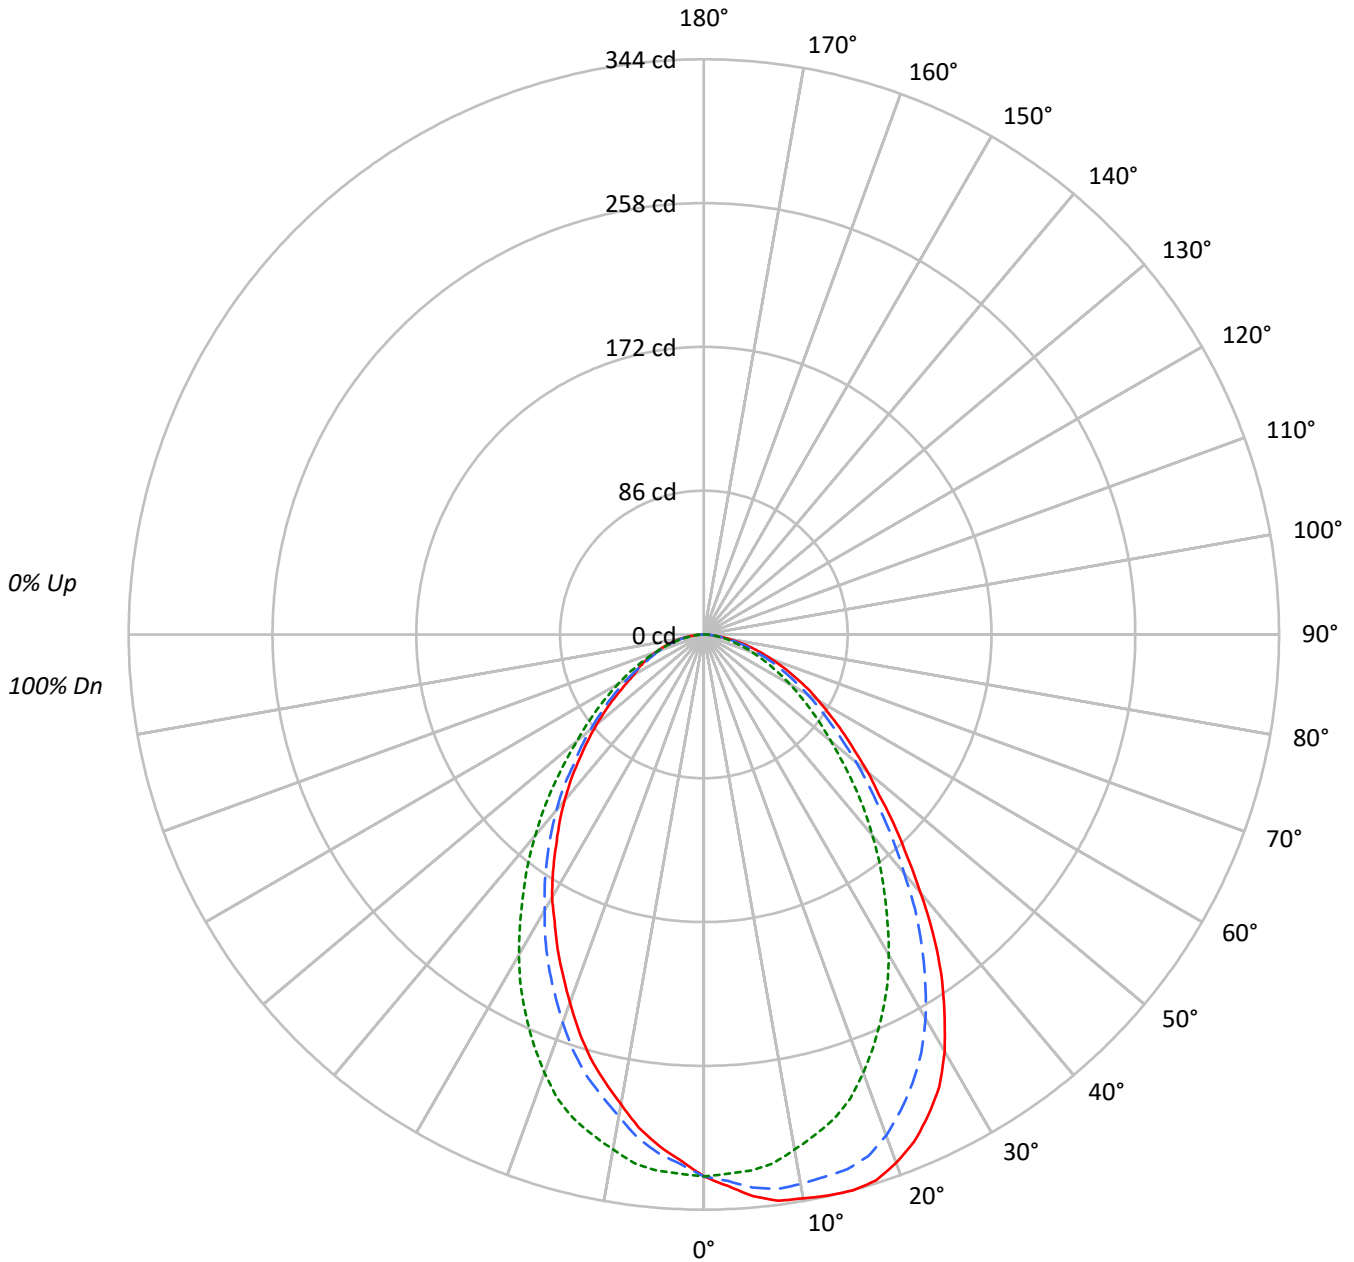

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P582988

CATALOG NUMBER: HCC6S05D010MW-HM60525940-61WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	110	106	103	99	108	104	101	98	100	97	95	96	94	92	93	91	89	87					87			
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76					76			
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66					66			
4	87	76	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58					58			
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51					51			
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46					46			
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42					42			
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38					38			
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34					34			
10	58	46	39	34	57	45	38	34	44	38	33	44	38	33	43	37	33	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	17767	17767	17767
5°	18556	17714	16900
10°	19060	17412	15881
15°	19535	17032	14881
20°	19619	16265	13663
25°	19205	15225	12533
30°	18224	13996	11489
35°	16557	12582	10306
40°	14420	11207	9267
45°	12474	9799	8148
50°	10899	8443	7138
55°	9634	7417	6126
60°	8662	6502	5307
65°	7757	5656	5150
70°	6924	4825	4825
75°	6015	4067	4533
80°	4830	3473	4136
85°	3271	2956	3522



TEST NUMBER: P582988  
 CATALOG NUMBER: HCC6S05D010MW-HM60525940-61WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	30.5	5.0
10°-20°	84.7	14.0
20°-30°	118.0	19.5
30°-40°	121.6	20.1
40°-50°	100.8	16.7
50°-60°	72.4	12.0
60°-70°	46.1	7.6
70°-80°	23.7	3.9
80°-90°	6.0	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	233.1	38.6
0°-40°	354.7	58.8
0°-60°	527.9	87.4
0°-90°	603.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	603.7	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	324	324	324	324	324	
5°	337	332	322	311	307	32
15°	344	331	300	273	262	97
25°	318	296	252	219	207	146
35°	247	227	188	163	154	154
45°	161	150	126	110	105	125
55°	101	92	78	69	64	91
65°	60	53	44	38	40	60
75°	28	24	19	20	21	30
85°	5	5	5	5	6	7
90°	0	0	0	0	0	



TEST NUMBER: P582988

CATALOG NUMBER: HCC6S05D010MW-HM60525940-61WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	324.1	324.1	324.1	324.1	324.1	324.1	324.1	324.1	324.1
2.5°	330.2	328.9	327.1	325.4	322.8	319.7	317.1	316.3	314.9
5°	337.2	335.4	332.0	327.6	321.9	316.3	311.4	308.4	307.1
7.5°	341.6	339.3	334.6	327.1	318.9	310.5	303.6	299.2	297.5
10°	342.4	340.2	333.7	323.6	312.8	301.4	292.7	287.5	285.3
12.5°	343.7	340.7	332.3	320.6	306.7	293.6	282.6	276.1	273.9
15°	344.2	340.7	331.1	316.6	300.1	284.4	272.7	264.8	262.2
17.5°	342.4	338.4	327.1	309.7	291.0	274.4	260.5	252.1	248.6
20°	336.3	332.0	318.9	299.2	278.8	261.3	246.9	238.2	234.2
22.5°	328.5	322.8	307.9	287.0	265.7	247.4	232.9	224.2	220.2
25°	317.5	312.3	295.7	273.5	251.7	232.4	219.4	210.3	207.2
27.5°	304.9	298.8	281.8	259.6	237.3	218.1	205.4	197.2	193.2
30°	287.9	282.3	265.2	243.0	221.1	203.3	190.2	183.2	181.5
32.5°	267.8	263.1	246.5	225.5	204.5	188.0	177.1	169.7	167.9
35°	247.4	241.7	227.2	207.6	188.0	173.1	163.2	156.6	154.0
37.5°	225.1	219.9	207.6	190.2	172.8	158.8	150.1	144.4	141.8
40°	201.5	197.6	186.2	172.3	156.6	144.4	137.0	132.2	129.5
42.5°	179.7	175.8	167.9	154.8	141.8	130.9	124.3	120.0	117.7
45°	160.9	157.5	149.6	138.3	126.4	117.3	110.4	107.4	105.1
47.5°	142.2	140.5	133.5	123.1	112.1	104.3	99.4	95.9	94.2
50°	127.8	125.7	119.1	108.1	99.0	92.9	88.6	85.5	83.7
52.5°	113.0	110.7	104.6	95.5	88.1	82.5	78.1	75.5	73.7
55°	100.8	99.0	92.4	84.2	77.6	72.9	68.9	65.9	64.1
57.5°	89.4	87.7	81.6	73.7	68.0	63.7	60.2	57.6	55.4
60°	79.0	77.6	71.5	64.1	59.3	54.9	51.9	49.7	48.4
62.5°	69.8	67.1	61.9	55.4	51.1	47.6	44.5	43.2	44.1
65°	59.8	58.4	53.2	47.6	43.6	40.1	38.0	38.9	39.7
67.5°	51.4	49.7	45.3	40.1	36.6	34.0	32.8	34.5	34.9
70°	43.2	41.5	37.5	33.1	30.1	28.4	28.4	29.6	30.1
72.5°	35.4	34.0	30.5	27.0	24.9	23.5	24.4	25.3	25.8
75°	28.4	27.0	24.4	21.4	19.2	19.2	20.1	20.9	21.4
77.5°	21.8	20.9	18.3	16.2	15.3	15.3	16.2	16.6	17.1
80°	15.3	14.4	13.1	11.8	11.0	11.8	12.7	12.7	13.1
82.5°	10.1	9.6	8.7	7.8	7.8	8.2	8.7	9.2	9.2
85°	5.2	5.2	4.7	4.4	4.7	5.2	5.2	5.6	5.6
87.5°	1.7	1.7	1.7	1.7	2.1	2.1	2.1	2.1	2.1
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)