

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P583384

Luminaire Tested: **HCC6S07D010MB-HM60525930-61WWW**

Issue Date: 9/16/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P583384  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/16/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC6S07D010MB-HM60525930-61WWW  
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 749.7 lumens  
Efficiency: N/A  
Efficacy: 93.7 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.06 / 1.14  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P583384  
CATALOG NUMBER: HCC6S07D010MB-HM60525930-61WWW

### Luminous Intensity Polar Plot

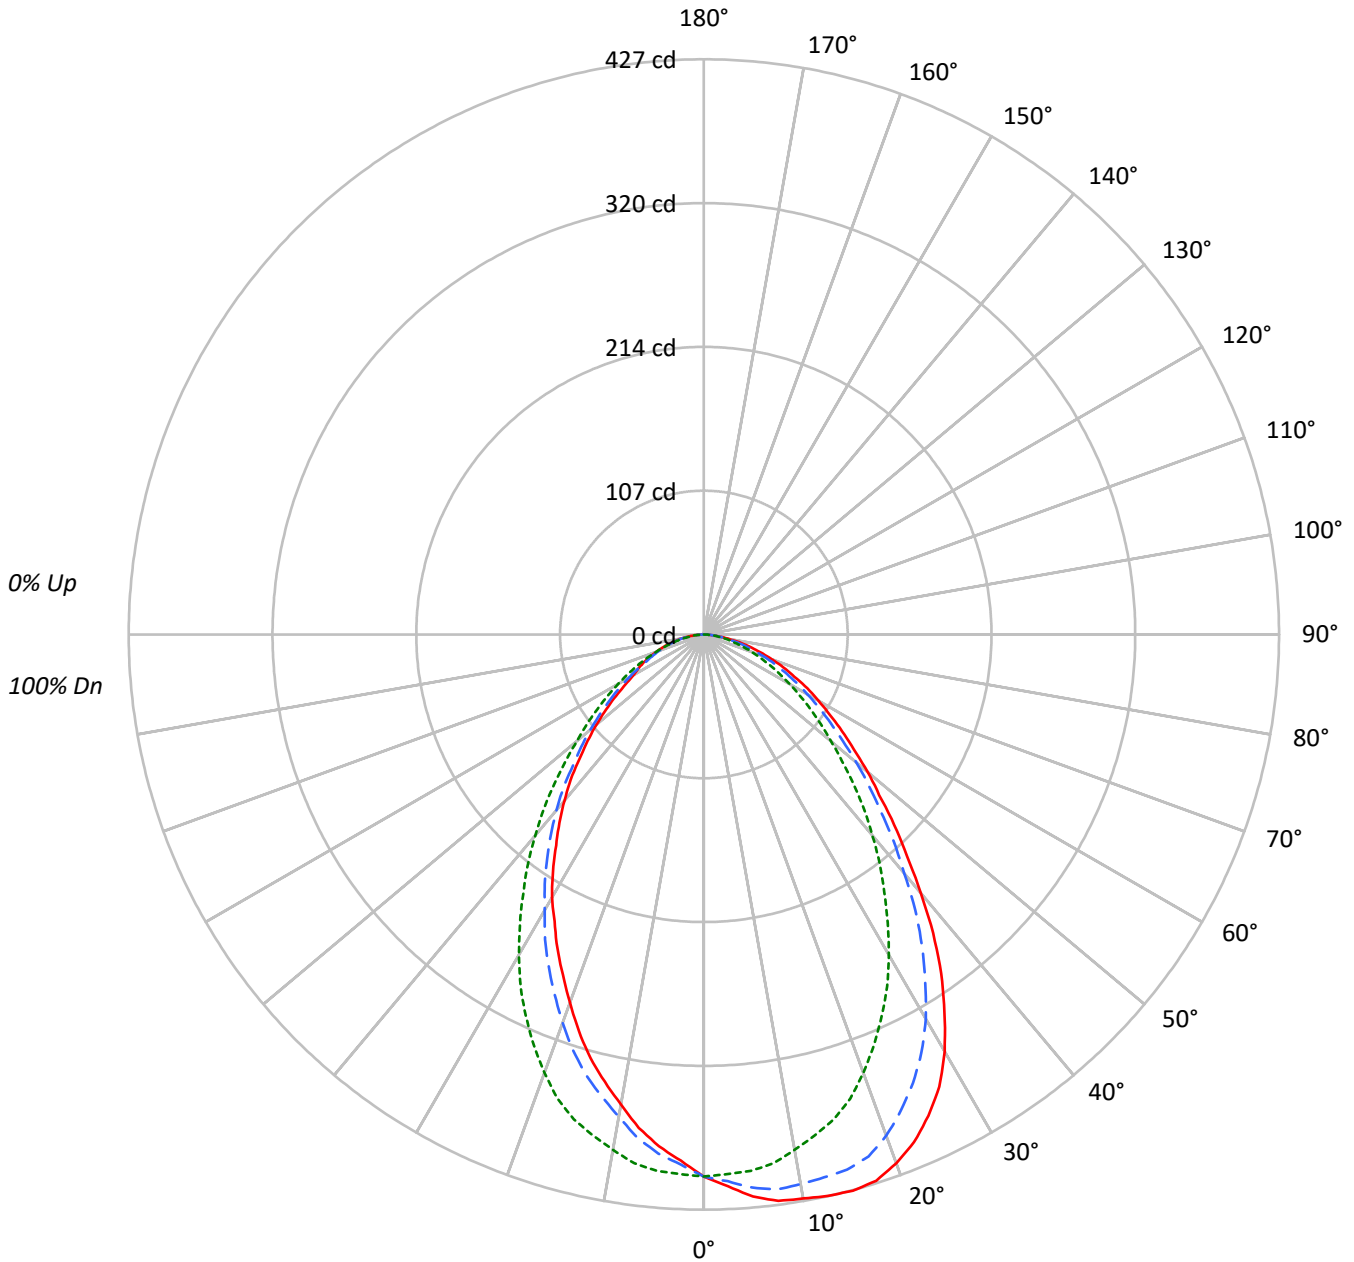

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P583384

CATALOG NUMBER: HCC6S07D010MB-HM60525930-61WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	110	106	103	99	108	104	101	98	100	97	95	96	94	92	93	91	89	87					87			
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76					76			
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66					66			
4	87	76	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58					58			
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51					51			
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46					46			
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42					42			
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38					38			
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34					34			
10	58	46	39	34	57	45	38	34	44	38	33	44	38	33	43	37	33	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	22060	22060	22060
5°	23046	21995	20988
10°	23669	21621	19722
15°	24257	21147	18473
20°	24362	20191	16965
25°	23850	18908	15563
30°	22630	17382	14268
35°	20559	15627	12802
40°	17912	13912	11514
45°	15498	12172	10117
50°	13535	10482	8870
55°	11957	9214	7608
60°	10745	8070	6600
65°	9625	7031	6395
70°	8591	5995	5995
75°	7456	5041	5613
80°	5967	4293	5114
85°	4088	3774	4403



TEST NUMBER: P583384  
 CATALOG NUMBER: HCC6S07D010MB-HM60525930-61WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	37.8	5.0
10°-20°	105.1	14.0
20°-30°	146.5	19.5
30°-40°	151.0	20.1
40°-50°	125.1	16.7
50°-60°	89.9	12.0
60°-70°	57.3	7.6
70°-80°	29.4	3.9
80°-90°	7.5	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	289.5	38.6
0°-40°	440.5	58.8
0°-60°	655.5	87.4
0°-90°	749.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	749.7	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	402	402	402	402	402	
5°	419	412	400	387	381	40
15°	427	411	373	338	326	120
25°	394	367	313	272	257	181
35°	307	282	234	203	191	191
45°	200	186	157	137	130	155
55°	125	115	96	86	80	113
65°	74	66	54	47	49	74
75°	35	30	24	25	26	38
85°	6	6	6	6	7	8
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P583384

CATALOG NUMBER: HCC6S07D010MB-HM60525930-61WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	402.4	402.4	402.4	402.4	402.4	402.4	402.4	402.4	402.4
2.5°	410.0	408.4	406.3	404.1	400.9	397.0	393.8	392.7	391.1
5°	418.8	416.5	412.2	406.7	399.7	392.7	386.8	383.0	381.4
7.5°	424.1	421.5	415.5	406.3	396.0	385.7	376.9	371.6	369.5
10°	425.2	422.5	414.3	401.9	388.4	374.3	363.5	357.0	354.3
12.5°	426.8	423.1	412.8	398.1	380.8	364.6	351.0	342.8	340.1
15°	427.4	423.1	411.2	393.3	372.6	353.2	338.5	328.8	325.5
17.5°	425.2	420.3	406.3	384.5	361.3	340.7	323.4	313.0	308.7
20°	417.6	412.2	396.0	371.6	346.1	324.5	306.6	295.7	290.8
22.5°	407.9	400.9	382.4	356.4	329.9	307.2	289.3	278.4	273.5
25°	394.3	387.8	367.2	339.7	312.6	288.7	272.5	261.0	257.3
27.5°	378.6	371.1	349.9	322.3	294.7	270.8	255.2	244.8	240.0
30°	357.5	350.4	329.4	301.7	274.6	252.4	236.1	227.5	225.4
32.5°	332.5	326.6	306.0	280.1	254.0	233.5	219.9	210.7	208.6
35°	307.2	300.1	282.2	257.9	233.5	215.0	202.6	194.4	191.3
37.5°	279.5	273.1	257.9	236.1	214.5	197.1	186.4	179.2	176.1
40°	250.3	245.4	231.2	213.9	194.4	179.2	170.1	164.2	160.9
42.5°	223.2	218.3	208.6	192.3	176.1	162.5	154.4	149.0	146.3
45°	199.9	195.6	185.8	171.8	157.0	145.7	137.1	133.2	130.5
47.5°	176.6	174.4	165.8	152.7	139.2	129.5	123.5	119.2	117.0
50°	158.7	156.0	147.9	134.4	122.9	115.3	110.0	106.2	104.0
52.5°	140.3	137.5	130.0	118.6	109.4	102.4	97.0	93.7	91.5
55°	125.1	122.9	114.9	104.6	96.4	90.4	85.5	81.8	79.6
57.5°	111.0	108.9	101.3	91.5	84.5	79.1	74.8	71.5	68.8
60°	98.0	96.4	88.8	79.6	73.6	68.2	64.5	61.7	60.2
62.5°	86.7	83.4	76.9	68.8	63.3	59.0	55.3	53.6	54.7
65°	74.2	72.6	66.1	59.0	54.2	49.9	47.1	48.2	49.3
67.5°	63.9	61.7	56.3	49.9	45.5	42.3	40.7	42.8	43.3
70°	53.6	51.4	46.6	41.1	37.4	35.2	35.2	36.8	37.4
72.5°	43.8	42.3	38.0	33.5	30.9	29.2	30.4	31.4	32.0
75°	35.2	33.5	30.4	26.5	23.8	23.8	24.9	25.9	26.5
77.5°	27.1	25.9	22.8	20.1	18.9	18.9	20.1	20.6	21.1
80°	18.9	17.9	16.2	14.6	13.6	14.6	15.7	15.7	16.2
82.5°	12.5	11.9	10.9	9.7	9.7	10.3	10.9	11.3	11.3
85°	6.5	6.5	6.0	5.4	6.0	6.5	6.5	7.0	7.0
87.5°	2.2	2.2	2.2	2.2	2.7	2.7	2.7	2.7	2.7
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)