

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P583979

Luminaire Tested: **HCC8W20D010BZ-HM80520827-81WDW**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P583979
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W20D010BZ-HM80520827-81WDW
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2236.1 lumens
Efficiency: N/A
Efficacy: 111.8 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.06
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct

Input Watts (W): 20
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P583979
CATALOG NUMBER: HCC8W20D010BZ-HM80520827-81WDW

Luminous Intensity Polar Plot

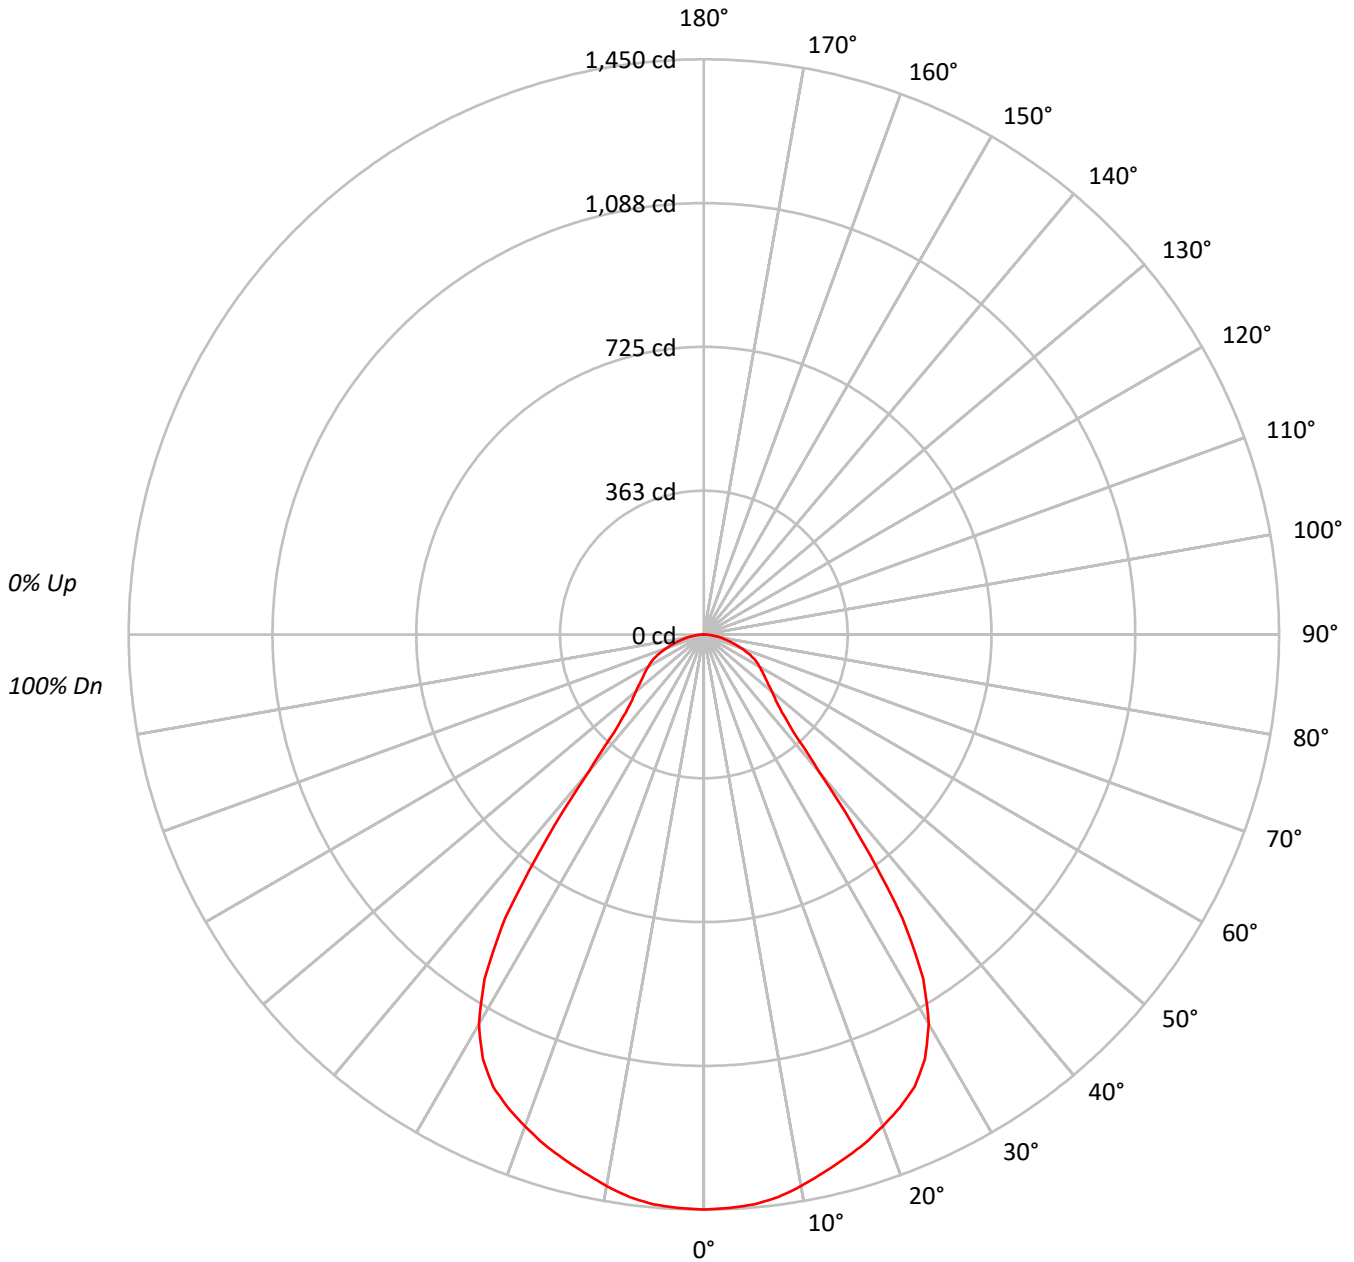

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P583979

CATALOG NUMBER: HCC8W20D010BZ-HM80520827-81WDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89																			
2	104	97	92	87	101	95	90	86	92	88	84	89	85	82	86	83	81	79																			
3	97	88	82	76	94	87	81	76	84	79	75	81	77	73	79	75	72	70																			
4	90	80	73	68	88	79	73	67	77	71	67	75	70	66	73	68	65	63																			
5	84	74	66	61	82	73	66	61	71	65	60	69	64	59	67	63	59	57																			
6	79	68	61	55	77	67	60	55	65	59	55	64	58	54	62	58	54	52																			
7	74	63	56	50	73	62	55	50	61	54	50	59	54	50	58	53	49	48																			
8	70	58	51	46	69	58	51	46	57	50	46	55	50	46	54	49	45	44																			
9	66	54	47	43	65	54	47	42	53	47	42	52	46	42	51	46	42	40																			
10	62	51	44	39	61	50	44	39	49	43	39	49	43	39	48	43	39	37																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	44703
5°	44651
10°	44209
15°	43682
20°	43277
25°	42789
30°	40374
35°	32878
40°	18163
45°	12123
50°	10751
55°	10096
60°	9966
65°	9872
70°	8917
75°	7971
80°	6961
85°	6192



TEST NUMBER: P583979
 CATALOG NUMBER: HCC8W20D010BZ-HM80520827-81WDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	136.7	6.1
10°-20°	386.3	17.3
20°-30°	574.1	25.7
30°-40°	517.0	23.1
40°-50°	229.2	10.2
50°-60°	169.7	7.6
60°-70°	131.9	5.9
70°-80°	71.5	3.2
80°-90°	19.6	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1097.1	49.1
0°-40°	1614.1	72.2
0°-60°	2013.0	90.0
0°-90°	2236.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2236.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1450	
5°	1442	137
15°	1368	386
25°	1258	574
35°	873	517
45°	278	229
55°	188	170
65°	135	132
75°	67	72
85°	18	20
90°	0	



TEST NUMBER: P583979
CATALOG NUMBER: HCC8W20D010BZ-HM80520827-81WDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1449.7
2.5°	1446.9
5°	1442.5
7.5°	1430.8
10°	1411.9
12.5°	1390.0
15°	1368.3
17.5°	1346.4
20°	1318.8
22.5°	1291.1
25°	1257.6
27.5°	1206.7
30°	1133.9
32.5°	1029.0
35°	873.4
37.5°	652.1
40°	451.2
42.5°	333.3
45°	278.0
47.5°	246.0
50°	224.1
52.5°	203.8
55°	187.8
57.5°	174.7
60°	161.6
62.5°	149.9
65°	135.3
67.5°	117.8
70°	98.9
72.5°	83.0
75°	66.9
77.5°	52.4
80°	39.2
82.5°	27.7
85°	17.5
87.5°	7.3
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)