

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584074

Luminaire Tested: **HCC8S20D010MW-HM80520935-81WDBB**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P584074  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-11)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8S20D010MW-HM80520935-81WDBB  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, BLACK BAFFLE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2070.8 lumens  
Efficiency: N/A  
Efficacy: 103.5 lumens/watt  
Spacing Criteria (0/90/45): 1.32 / 1.32 / 1.13  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 20  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P584074  
CATALOG NUMBER: HCC8S20D010MW-HM80520935-81WDBB

### Luminous Intensity Polar Plot

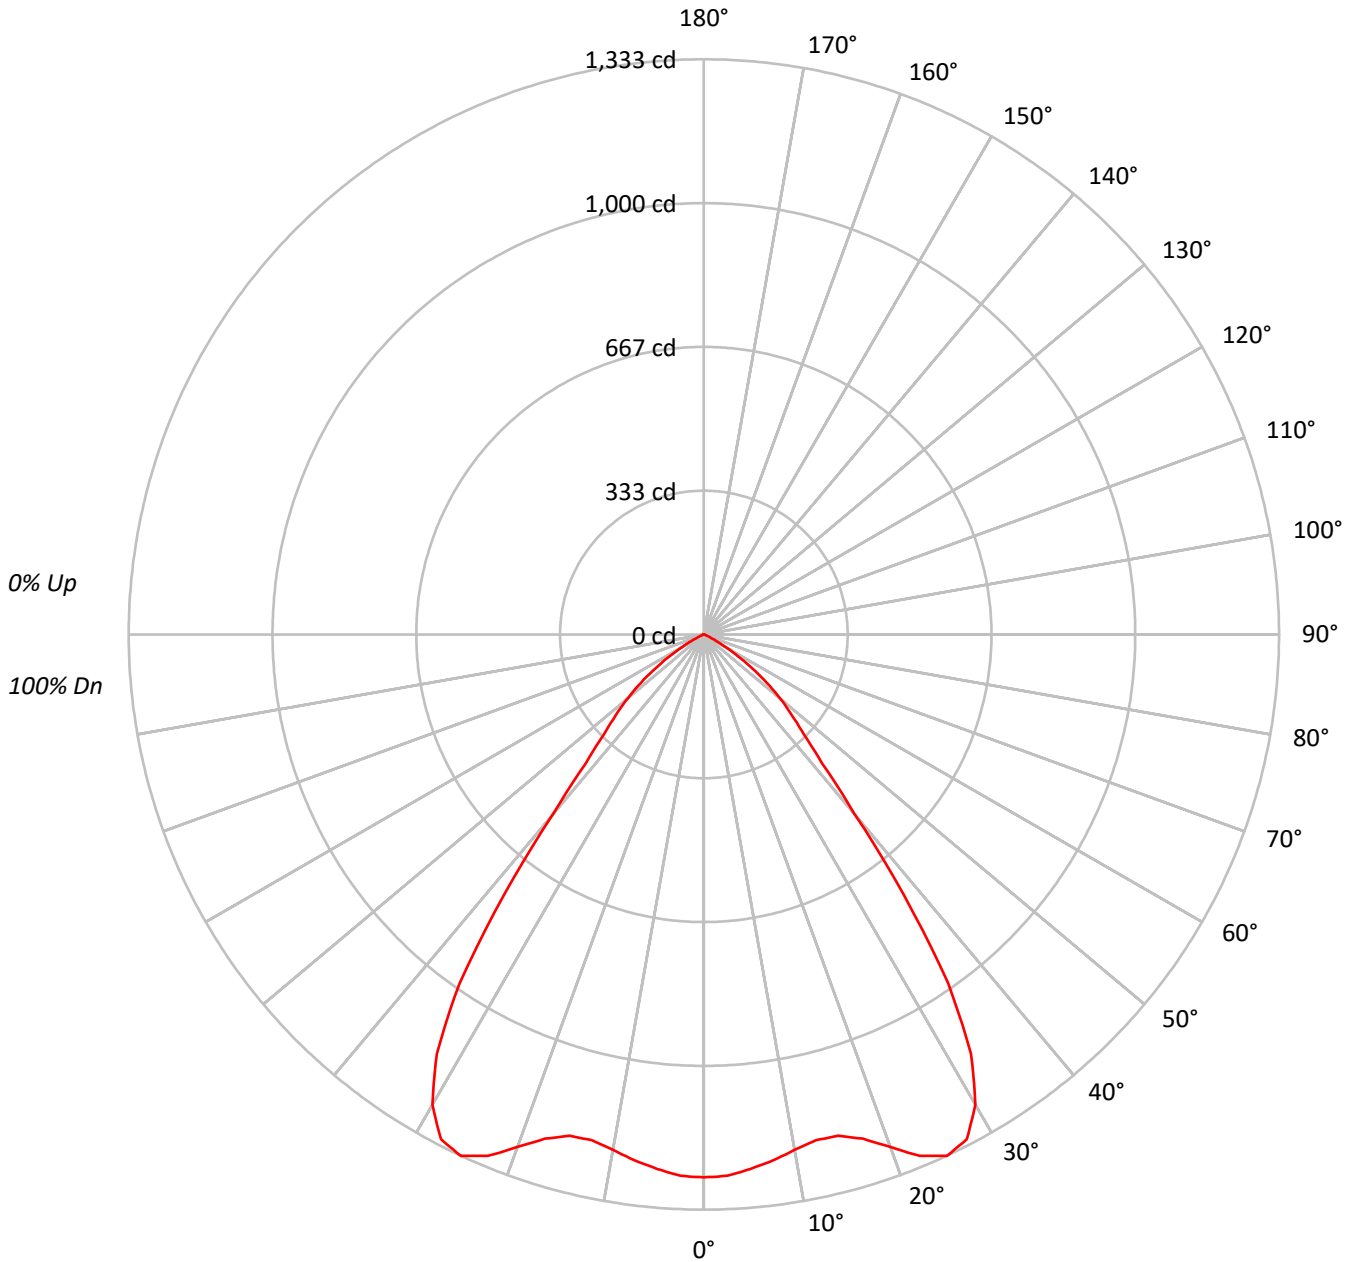

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584074

CATALOG NUMBER: HCC8S20D010MW-HM80520935-81WDBB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	113	109	107	104	110	107	105	102	103	101	99	99	98	96	96	95	93	92								
2	106	100	95	92	104	98	94	91	95	92	89	92	89	87	89	87	85	83								
3	99	92	86	81	97	90	85	81	88	83	79	85	81	78	83	80	77	75								
4	93	84	78	73	91	83	77	72	81	76	71	79	74	71	77	73	70	68								
5	87	77	71	66	85	76	70	65	74	69	65	73	68	64	71	67	63	62								
6	82	71	64	59	80	70	64	59	69	63	59	67	62	58	66	61	58	56								
7	77	66	59	54	75	65	59	54	64	58	54	63	57	53	61	57	53	51								
8	72	61	54	49	71	61	54	49	59	53	49	58	53	49	57	52	49	47								
9	68	57	50	45	67	56	50	45	55	49	45	54	49	45	53	48	45	43								
10	64	53	46	42	63	53	46	42	52	46	42	51	45	42	50	45	41	40								

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	38798
5°	38479
10°	37969
15°	38402
20°	41472
25°	45351
30°	44800
35°	37162
40°	21874
45°	14291
50°	11082
55°	7360
60°	3577
65°	1109
70°	370
75°	322
80°	249
85°	495



TEST NUMBER: P584074  
 CATALOG NUMBER: HCC8S20D010MW-HM80520935-81WDBB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	117.7	5.7
10°-20°	345.6	16.7
20°-30°	604.2	29.2
30°-40°	587.8	28.4
40°-50°	267.3	12.9
50°-60°	123.9	6.0
60°-70°	20.7	1.0
70°-80°	2.5	0.1
80°-90°	1.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1067.6	51.6
0°-40°	1655.3	79.9
0°-60°	2046.6	98.8
0°-90°	2070.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2070.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1258	
5°	1243	118
15°	1203	346
25°	1333	604
35°	987	588
45°	328	267
55°	137	124
65°	15	21
75°	3	3
85°	1	1
90°	0	



TEST NUMBER: P584074

CATALOG NUMBER: HCC8S20D010MW-HM80520935-81WDBB

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1258.2
2.5°	1255.5
5°	1243.1
7.5°	1229.3
10°	1212.6
12.5°	1200.2
15°	1202.9
17.5°	1225.1
20°	1263.8
22.5°	1308.0
25°	1332.9
27.5°	1319.1
30°	1258.2
32.5°	1151.9
35°	987.2
37.5°	760.5
40°	543.4
42.5°	405.2
45°	327.7
47.5°	276.6
50°	231.0
52.5°	183.9
55°	136.9
57.5°	94.0
60°	58.0
62.5°	31.8
65°	15.2
67.5°	6.9
70°	4.1
72.5°	2.7
75°	2.7
77.5°	1.4
80°	1.4
82.5°	1.4
85°	1.4
87.5°	0.0
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)