

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584317

Luminaire Tested: **HCC8S30D010MW-HM82555927-81WWBB**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P584317  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-17)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8S30D010MW-HM82555927-81WWBB  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WALLWASH DISTRIBUTION, WHITE BAFFLE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2232.1 lumens  
Efficiency: N/A  
Efficacy: 79.7 lumens/watt  
Spacing Criteria (0/90/45): 1.15 / 1.07 / 1.16  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P584317  
CATALOG NUMBER: HCC8S30D010MW-HM82555927-81WWBB

### Luminous Intensity Polar Plot

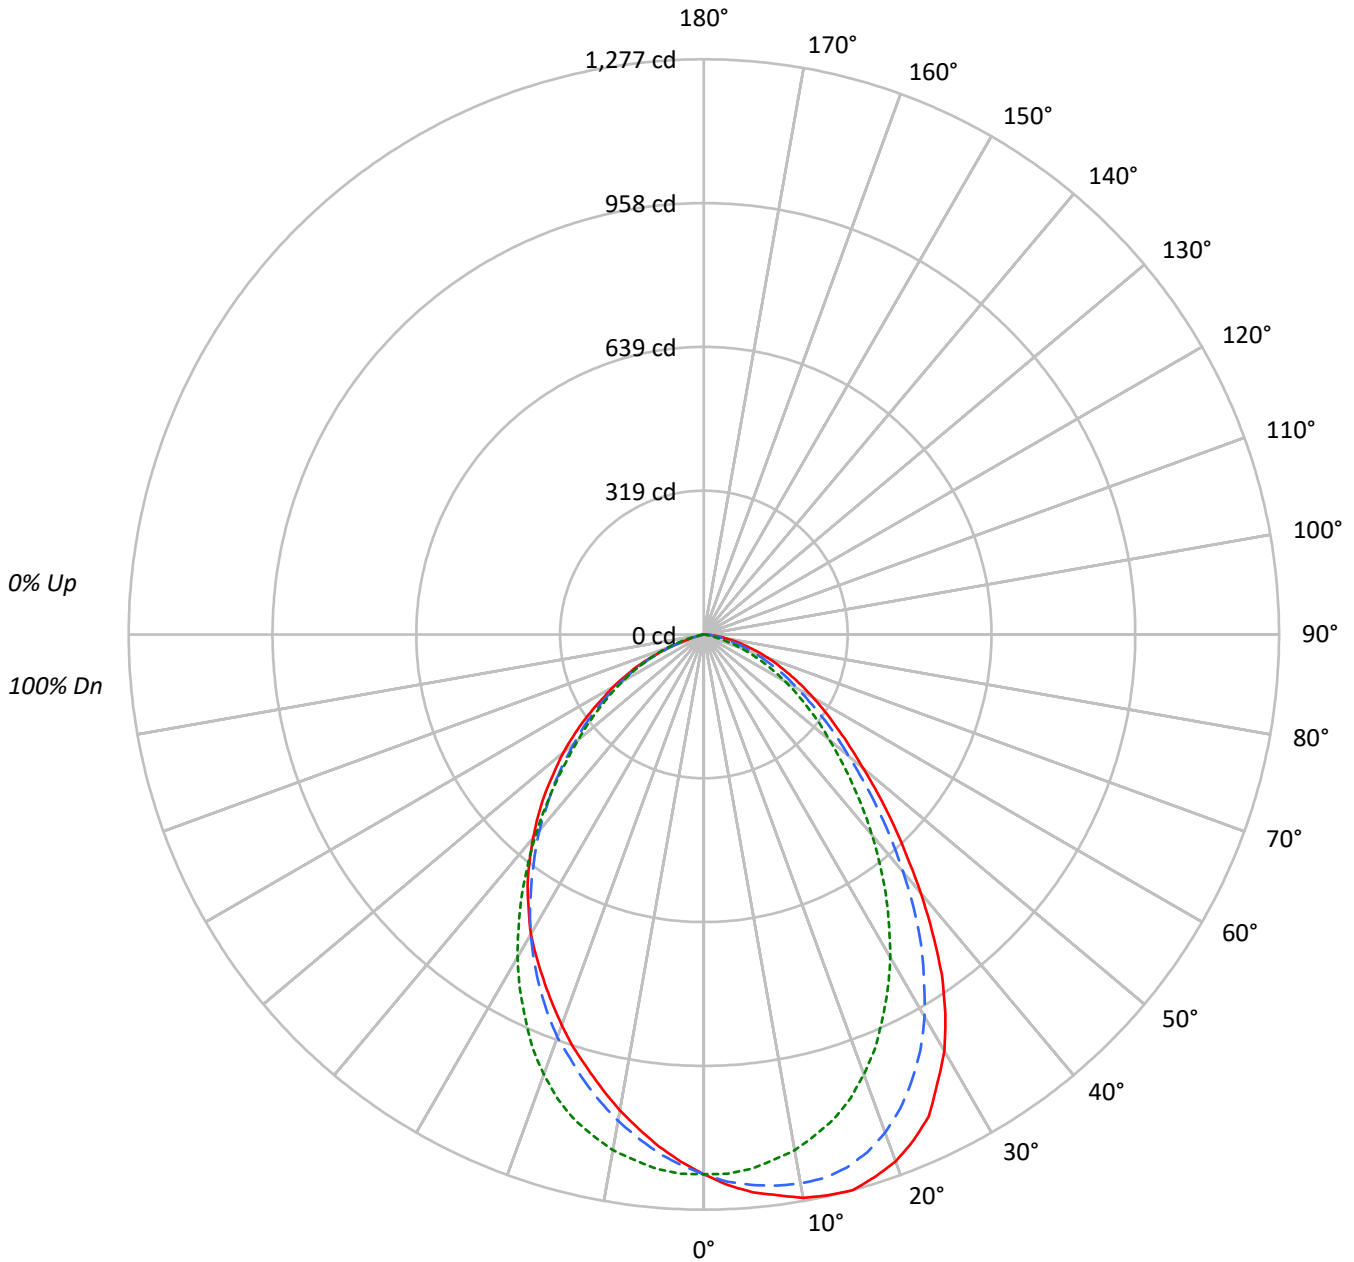

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584317

CATALOG NUMBER: HCC8S30D010MW-HM82555927-81WWBB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	93	92	90	88					88			
2	103	96	90	86	100	94	89	85	91	86	83	88	84	81	85	82	79	77					77			
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67					67			
4	88	78	70	64	86	76	69	64	74	68	63	72	66	62	70	65	61	59					59			
5	82	70	63	57	80	69	62	56	67	61	56	65	60	55	64	59	55	53					53			
6	76	64	56	51	74	63	56	50	62	55	50	60	54	50	58	53	49	47					47			
7	71	59	51	45	69	58	51	45	57	50	45	55	49	45	54	49	44	43					43			
8	66	54	46	41	65	53	46	41	52	46	41	51	45	41	50	44	40	39					39			
9	62	50	43	37	61	50	42	37	48	42	37	47	41	37	46	41	37	35					35			
10	59	47	39	34	57	46	39	34	45	39	34	44	38	34	43	38	34	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	36954	36954	36954
5°	38479	36869	35319
10°	39766	36400	33598
15°	40770	35567	31851
20°	40852	34092	30272
25°	40162	31935	28706
30°	38014	29465	27364
35°	34655	26502	25692
40°	30138	23363	23722
45°	25860	20230	21717
50°	22087	17443	19506
55°	19354	15021	16946
60°	17231	12816	14246
65°	15293	10456	11375
70°	13560	7754	6464
75°	11307	4051	1930
80°	8914	1261	320
85°	6369	637	0



TEST NUMBER: P584317  
 CATALOG NUMBER: HCC8S30D010MW-HM82555927-81WWBB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	112.9	5.1
10°-20°	316.5	14.2
20°-30°	447.9	20.1
30°-40°	468.6	21.0
40°-50°	390.9	17.5
50°-60°	277.2	12.4
60°-70°	159.6	7.2
70°-80°	51.4	2.3
80°-90°	7.1	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	877.3	39.3
0°-40°	1346.0	60.3
0°-60°	2014.0	90.2
0°-90°	2232.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2232.1	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	1198	1198	1198	1198	1198	
5°	1243	1227	1191	1155	1141	119
15°	1277	1225	1114	1026	998	359
25°	1180	1093	939	863	844	539
35°	921	840	704	666	682	571
45°	593	545	464	469	498	459
55°	360	322	279	294	315	325
65°	210	176	143	143	156	209
75°	95	70	34	16	16	103
85°	18	9	2	0	0	22
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584317

CATALOG NUMBER: HCC8S30D010MW-HM82555927-81WWBB

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4
2.5°	1223.4	1221.6	1219.8	1221.6	1219.8	1221.6	1219.8	1219.8	1218.0	1216.2	1216.2
5°	1243.1	1241.3	1241.3	1241.3	1239.5	1237.7	1237.7	1236.0	1232.4	1230.6	1227.0
7.5°	1255.7	1257.5	1257.5	1257.5	1253.9	1253.9	1250.2	1246.7	1243.1	1239.5	1234.2
10°	1270.0	1270.0	1268.2	1266.4	1262.8	1261.1	1259.3	1255.7	1250.2	1243.1	1237.7
12.5°	1275.3	1275.3	1273.5	1270.0	1268.2	1266.4	1264.6	1259.3	1252.0	1243.1	1236.0
15°	1277.1	1273.5	1271.8	1270.0	1266.4	1261.1	1261.1	1253.9	1244.9	1234.2	1225.3
17.5°	1262.8	1264.6	1261.1	1257.5	1252.0	1248.4	1243.1	1237.7	1227.0	1214.4	1205.5
20°	1244.9	1243.1	1241.3	1236.0	1228.8	1227.0	1221.6	1212.7	1203.7	1189.4	1176.9
22.5°	1216.2	1214.4	1210.9	1207.3	1200.2	1196.5	1191.1	1180.4	1167.8	1153.6	1139.2
25°	1180.4	1176.9	1171.5	1164.3	1158.9	1155.4	1148.2	1137.4	1123.1	1107.0	1092.7
27.5°	1123.1	1128.5	1124.9	1114.1	1108.7	1101.6	1099.8	1085.4	1073.0	1056.8	1040.7
30°	1067.6	1067.6	1062.3	1056.8	1047.9	1042.5	1035.4	1024.6	1012.1	992.3	979.9
32.5°	997.7	995.9	988.8	987.0	979.9	969.0	967.3	953.0	940.4	926.1	909.9
35°	920.6	917.1	909.9	904.6	901.0	895.7	890.2	877.7	865.1	850.8	840.1
37.5°	832.9	832.9	831.1	822.2	818.6	815.1	809.6	797.1	790.0	775.6	764.9
40°	748.7	746.9	741.6	739.8	736.2	730.9	727.2	720.1	709.4	698.5	687.8
42.5°	666.3	668.1	661.0	662.7	655.6	652.0	650.3	639.4	634.1	623.4	614.4
45°	593.0	591.1	587.5	585.7	582.1	578.6	575.0	569.6	560.6	549.9	544.6
47.5°	524.8	519.5	519.5	517.7	515.9	508.7	506.9	501.5	496.2	485.5	478.2
50°	460.4	460.4	460.4	458.6	453.1	451.3	447.8	442.4	437.1	429.9	419.1
52.5°	408.4	408.4	408.4	406.6	399.5	397.6	395.8	388.7	381.6	376.2	368.9
55°	360.0	361.8	360.0	356.5	351.1	351.1	345.8	342.1	334.9	329.6	322.5
57.5°	318.9	318.9	315.2	313.4	309.9	308.1	304.5	300.9	292.0	286.5	277.6
60°	279.4	277.6	277.6	274.1	270.5	266.9	265.1	259.7	256.1	247.2	240.1
62.5°	243.6	243.6	240.1	240.1	232.8	232.8	231.0	225.7	220.3	211.4	207.8
65°	209.6	209.6	207.8	205.9	200.6	198.8	197.0	191.7	186.3	181.0	175.5
67.5°	179.2	179.2	175.5	173.7	170.1	168.4	164.8	161.2	155.9	150.4	145.1
70°	150.4	148.6	146.8	145.1	141.5	139.7	136.1	132.6	127.2	123.5	118.2
72.5°	121.8	121.8	120.0	116.4	114.6	112.8	111.1	107.5	102.1	96.8	93.1
75°	94.9	94.9	94.9	91.3	87.7	86.0	86.0	82.4	78.8	73.5	69.9
77.5°	73.5	71.7	69.9	69.9	66.2	64.4	62.7	60.9	55.5	53.7	50.2
80°	50.2	52.0	50.2	48.4	46.6	44.8	44.8	41.1	39.4	35.8	32.2
82.5°	34.0	32.2	32.2	30.4	30.4	28.7	28.7	25.1	23.3	21.5	19.7
85°	18.0	18.0	16.2	16.2	16.2	14.4	14.4	12.5	12.5	10.7	8.9
87.5°	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	3.6	3.6	3.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584317

CATALOG NUMBER: HCC8S30D010MW-HM82555927-81WWBB

**CANDELA DISTRIBUTION (continued):**

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°	95°
0°	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4
2.5°	1214.4	1210.9	1209.1	1209.1	1207.3	1205.5	1203.7	1202.0	1198.4	1198.4	1194.7
5°	1223.4	1219.8	1218.0	1212.7	1209.1	1209.1	1202.0	1200.2	1194.7	1191.1	1187.6
7.5°	1230.6	1223.4	1218.0	1212.7	1209.1	1205.5	1198.4	1191.1	1184.0	1176.9	1173.3
10°	1230.6	1223.4	1214.4	1205.5	1202.0	1198.4	1189.4	1178.7	1169.6	1162.5	1153.6
12.5°	1227.0	1216.2	1205.5	1198.4	1191.1	1185.8	1175.1	1164.3	1153.6	1139.2	1132.0
15°	1216.2	1202.0	1191.1	1178.7	1173.3	1164.3	1155.4	1139.2	1126.7	1114.1	1105.2
17.5°	1194.7	1176.9	1164.3	1151.8	1142.9	1137.4	1123.1	1108.7	1094.5	1080.1	1069.4
20°	1162.5	1146.4	1132.0	1116.0	1108.7	1101.6	1083.7	1069.4	1055.0	1038.9	1028.1
22.5°	1123.1	1107.0	1087.2	1074.7	1064.0	1055.0	1038.9	1022.8	1008.5	994.1	979.9
25°	1074.7	1058.6	1040.7	1021.0	1013.9	1004.9	987.0	970.8	954.8	938.6	926.1
27.5°	1022.8	1001.3	987.0	965.5	958.3	949.3	929.7	911.7	897.5	884.9	870.6
30°	960.1	943.9	924.3	904.6	897.5	888.4	872.4	856.2	841.9	827.5	813.3
32.5°	892.0	875.9	856.2	841.9	831.1	824.0	807.8	793.5	779.2	764.9	752.3
35°	820.4	802.5	788.2	773.8	764.9	755.8	739.8	727.2	716.5	704.0	691.4
37.5°	746.9	734.4	720.1	704.0	695.0	687.8	675.4	661.0	652.0	641.2	632.3
40°	675.4	661.0	648.5	634.1	627.0	621.6	609.0	598.3	589.3	580.4	575.0
42.5°	601.9	589.3	576.8	567.9	562.4	557.0	548.1	535.5	530.2	521.3	515.9
45°	533.7	523.0	514.1	501.5	498.0	494.4	483.7	474.6	469.3	463.9	460.4
47.5°	469.3	462.2	451.3	444.2	438.9	435.3	428.2	420.9	415.6	412.0	408.4
50°	413.8	404.9	397.6	390.5	386.9	381.6	374.4	370.7	367.2	363.6	363.6
52.5°	361.8	352.9	345.8	340.3	336.7	333.2	327.8	326.0	322.5	322.5	320.7
55°	313.4	308.1	300.9	293.8	292.0	290.2	286.5	283.0	281.2	279.4	281.2
57.5°	272.3	266.9	259.7	254.3	252.5	250.8	249.0	245.4	243.6	243.6	243.6
60°	234.7	229.2	223.9	218.5	218.5	215.0	213.2	211.4	209.6	207.8	207.8
62.5°	200.6	195.2	189.9	186.3	184.5	182.7	179.2	177.3	175.5	175.5	173.7
65°	170.1	163.0	161.2	155.9	154.1	152.3	150.4	146.8	145.1	143.3	141.5
67.5°	139.7	136.1	130.8	127.2	125.4	123.5	121.8	118.2	116.4	114.6	111.1
70°	112.8	109.3	105.7	102.1	100.4	98.6	94.9	91.3	89.5	86.0	80.6
72.5°	87.7	84.2	80.6	77.0	75.3	73.5	69.9	66.2	62.7	59.1	55.5
75°	66.2	62.7	57.3	53.7	52.0	52.0	46.6	43.0	39.4	34.0	30.4
77.5°	46.6	41.1	39.4	35.8	34.0	30.4	26.9	23.3	19.7	18.0	14.4
80°	30.4	26.9	23.3	21.5	19.7	18.0	16.2	12.5	8.9	7.1	5.4
82.5°	18.0	16.2	14.4	12.5	10.7	8.9	7.1	7.1	5.4	3.6	1.8
85°	8.9	7.1	5.4	5.4	3.6	3.6	3.6	1.8	1.8	1.8	1.8
87.5°	3.6	1.8	1.8	1.8	1.8	1.8	1.8	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584317

CATALOG NUMBER: HCC8S30D010MW-HM82555927-81WWBB

**CANDELA DISTRIBUTION (continued):**

	100°	105°	110°	112.5°	115°	120°	125°	130°	135°	140°	145°
0°	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4
2.5°	1192.9	1191.1	1189.4	1187.6	1187.6	1184.0	1184.0	1182.2	1178.7	1176.9	1176.9
5°	1182.2	1176.9	1173.3	1171.5	1169.6	1164.3	1162.5	1158.9	1155.4	1151.8	1150.0
7.5°	1166.1	1157.1	1153.6	1151.8	1146.4	1141.0	1137.4	1132.0	1126.7	1121.3	1119.6
10°	1146.4	1137.4	1128.5	1124.9	1119.6	1116.0	1108.7	1101.6	1096.3	1090.9	1085.4
12.5°	1121.3	1110.5	1101.6	1098.0	1092.7	1085.4	1074.7	1071.2	1062.3	1058.6	1051.4
15°	1092.7	1080.1	1071.2	1065.8	1060.5	1049.6	1042.5	1035.4	1026.3	1022.8	1015.6
17.5°	1056.8	1042.5	1033.6	1028.1	1024.6	1015.6	1004.9	995.9	987.0	983.4	978.1
20°	1013.9	1004.9	992.3	987.0	983.4	972.6	961.9	958.3	951.2	943.9	938.6
22.5°	965.5	956.6	943.9	938.6	936.8	927.9	918.9	913.5	908.2	902.8	897.5
25°	915.3	904.6	893.8	890.2	886.6	879.5	872.4	868.8	863.3	859.8	856.2
27.5°	861.5	850.8	841.9	836.5	832.9	827.5	824.0	820.4	816.8	813.3	811.4
30°	804.2	793.5	786.4	782.7	779.2	777.4	772.0	770.2	768.5	764.9	766.7
32.5°	746.9	738.0	730.9	725.4	725.4	721.8	720.1	720.1	718.3	718.3	718.3
35°	684.3	678.9	673.4	671.7	669.9	668.1	666.3	668.1	666.3	668.1	669.9
37.5°	627.0	621.6	617.9	616.1	614.4	616.1	614.4	614.4	616.1	619.8	621.6
40°	567.9	564.2	560.6	562.4	560.6	560.6	560.6	566.1	567.9	569.6	571.4
42.5°	512.3	508.7	506.9	506.9	508.7	506.9	510.6	512.3	515.9	521.3	524.8
45°	458.6	456.8	456.8	458.6	456.8	460.4	460.4	463.9	469.3	472.9	476.4
47.5°	408.4	408.4	408.4	410.2	410.2	412.0	415.6	417.3	420.9	424.5	428.2
50°	361.8	363.6	365.4	365.4	365.4	368.9	372.6	374.4	376.2	378.0	383.3
52.5°	320.7	322.5	322.5	324.2	326.0	327.8	329.6	333.2	334.9	338.5	340.3
55°	281.2	281.2	284.8	286.5	286.5	286.5	290.2	290.2	293.8	295.6	299.2
57.5°	243.6	245.4	245.4	247.2	247.2	249.0	250.8	252.5	254.3	256.1	257.9
60°	207.8	207.8	207.8	209.6	211.4	213.2	211.4	215.0	215.0	218.5	220.3
62.5°	173.7	175.5	175.5	175.5	175.5	175.5	175.5	177.3	179.2	181.0	182.7
65°	141.5	141.5	141.5	139.7	141.5	139.7	141.5	143.3	143.3	145.1	146.8
67.5°	109.3	109.3	105.7	105.7	107.5	107.5	107.5	107.5	105.7	109.3	109.3
70°	78.8	77.0	75.3	73.5	73.5	71.7	71.7	69.9	69.9	69.9	69.9
72.5°	52.0	48.4	44.8	43.0	41.1	41.1	37.6	35.8	37.6	37.6	37.6
75°	26.9	23.3	21.5	19.7	18.0	18.0	16.2	16.2	16.2	16.2	16.2
77.5°	10.7	8.9	7.1	7.1	5.4	5.4	5.4	5.4	5.4	5.4	5.4
80°	3.6	3.6	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
82.5°	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
85°	1.8	0.0	0.0	1.8	0.0	1.8	1.8	1.8	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584317

CATALOG NUMBER: HCC8S30D010MW-HM82555927-81WWBB

**CANDELA DISTRIBUTION (continued):**

	150°	155°	157.5°	160°	165°	170°	175°	180°
0°	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4	1198.4
2.5°	1175.1	1175.1	1173.3	1175.1	1171.5	1173.3	1171.5	1171.5
5°	1148.2	1144.7	1144.7	1144.7	1142.9	1142.9	1141.0	1141.0
7.5°	1116.0	1114.1	1112.3	1110.5	1108.7	1107.0	1107.0	1107.0
10°	1083.7	1080.1	1080.1	1078.3	1074.7	1073.0	1073.0	1073.0
12.5°	1046.1	1044.3	1042.5	1042.5	1035.4	1037.2	1035.4	1035.4
15°	1010.3	1008.5	1008.5	1003.0	999.5	999.5	999.5	997.7
17.5°	972.6	970.8	969.0	965.5	961.9	961.9	960.1	961.9
20°	933.2	931.5	927.9	927.9	926.1	924.3	920.6	922.5
22.5°	893.8	890.2	888.4	888.4	886.6	886.6	883.1	883.1
25°	852.6	850.8	849.1	850.8	847.3	847.3	843.7	843.7
27.5°	809.6	807.8	807.8	807.8	806.0	807.8	806.0	806.0
30°	766.7	766.7	764.9	764.9	766.7	764.9	766.7	768.5
32.5°	720.1	720.1	721.8	721.8	723.6	723.6	723.6	723.6
35°	671.7	675.4	675.4	677.1	678.9	680.7	680.7	682.5
37.5°	627.0	628.7	630.5	632.3	635.9	635.9	635.9	635.9
40°	578.6	580.4	583.9	582.1	589.3	591.1	589.3	589.3
42.5°	528.4	532.0	533.7	537.4	539.2	542.8	544.6	544.6
45°	481.9	483.7	487.3	490.8	492.6	498.0	498.0	498.0
47.5°	433.5	437.1	438.9	442.4	444.2	449.6	451.3	449.6
50°	386.9	390.5	394.0	394.0	399.5	401.3	404.9	406.6
52.5°	342.1	343.9	347.5	349.3	352.9	356.5	358.2	360.0
55°	299.2	300.9	304.5	304.5	309.9	311.6	315.2	315.2
57.5°	259.7	261.5	265.1	263.4	266.9	270.5	270.5	268.7
60°	222.1	222.1	222.1	225.7	227.5	229.2	231.0	231.0
62.5°	182.7	186.3	188.1	188.1	189.9	191.7	191.7	189.9
65°	146.8	150.4	152.3	152.3	154.1	154.1	154.1	155.9
67.5°	111.1	111.1	111.1	112.8	111.1	111.1	111.1	111.1
70°	69.9	69.9	69.9	69.9	68.0	69.9	69.9	71.7
72.5°	37.6	37.6	37.6	37.6	37.6	37.6	37.6	37.6
75°	16.2	16.2	16.2	18.0	16.2	16.2	16.2	16.2
77.5°	7.1	5.4	7.1	7.1	5.4	5.4	5.4	5.4
80°	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
82.5°	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
85°	0.0	1.8	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)