

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P593680

Luminaire Tested: **HCC8W30D010SL-HM82555950-81WDW**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P593680  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-9)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8W30D010SL-HM82555950-81WDW  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 3641.4 lumens  
Efficiency: N/A  
Efficacy: 130.1 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.06  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P593680  
CATALOG NUMBER: HCC8W30D010SL-HM82555950-81WDW

### Luminous Intensity Polar Plot

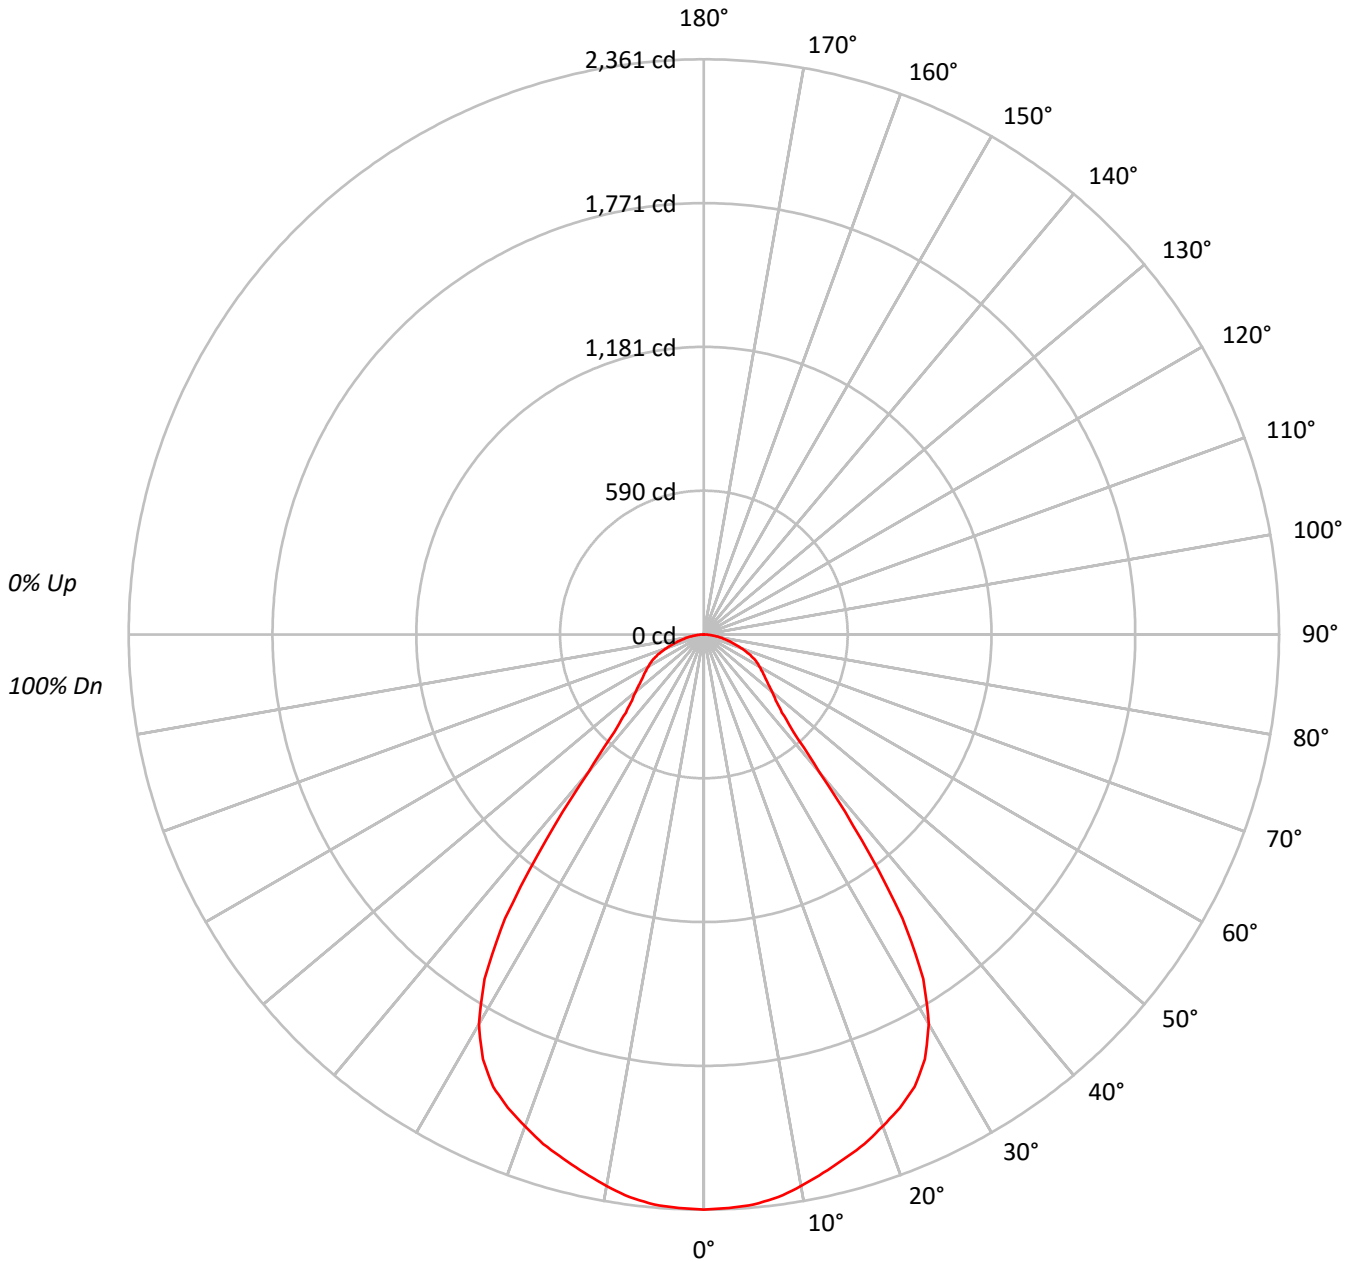

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P593680

CATALOG NUMBER: HCC8W30D010SL-HM82555950-81WDW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89			89
2	104	97	92	87	101	95	90	86	92	88	84	89	85	82	86	83	81	79			79
3	97	88	82	76	94	87	81	76	84	79	75	81	77	73	79	75	72	70			70
4	90	80	73	68	88	79	73	67	77	71	67	75	70	66	73	68	65	63			63
5	84	74	66	61	82	73	66	61	71	65	60	69	64	59	67	63	59	57			57
6	79	68	61	55	77	67	60	55	65	59	55	64	58	54	62	58	54	52			52
7	74	63	56	50	73	62	55	50	61	54	50	59	54	50	58	53	49	48			48
8	70	58	51	46	69	58	51	46	57	50	46	55	50	46	54	49	45	44			44
9	66	54	47	43	65	54	47	42	53	47	42	52	46	42	51	46	42	40			40
10	62	51	44	39	61	50	44	39	49	43	39	49	43	39	48	43	39	37			37

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	72801
5°	72711
10°	71993
15°	71130
20°	70474
25°	69678
30°	65748
35°	53538
40°	29579
45°	19746
50°	17510
55°	16440
60°	16226
65°	16081
70°	14534
75°	12987
80°	11365
85°	10048



TEST NUMBER: P593680  
 CATALOG NUMBER: HCC8W30D010SL-HM82555950-81WDW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	222.6	6.1
10°-20°	629.1	17.3
20°-30°	934.8	25.7
30°-40°	841.9	23.1
40°-50°	373.2	10.2
50°-60°	276.4	7.6
60°-70°	214.9	5.9
70°-80°	116.5	3.2
80°-90°	31.9	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1786.5	49.1
0°-40°	2628.4	72.2
0°-60°	3278.0	90.0
0°-90°	3641.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3641.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2361	
5°	2349	223
15°	2228	629
25°	2048	935
35°	1422	842
45°	453	373
55°	306	276
65°	220	215
75°	109	117
85°	28	32
90°	0	



TEST NUMBER: P593680  
CATALOG NUMBER: HCC8W30D010SL-HM82555950-81WDW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2360.9
2.5°	2356.1
5°	2349.0
7.5°	2330.1
10°	2299.2
12.5°	2263.6
15°	2228.1
17.5°	2192.5
20°	2147.6
22.5°	2102.5
25°	2047.9
27.5°	1964.9
30°	1846.5
32.5°	1675.8
35°	1422.2
37.5°	1061.9
40°	734.8
42.5°	542.8
45°	452.8
47.5°	400.6
50°	365.0
52.5°	331.8
55°	305.8
57.5°	284.4
60°	263.1
62.5°	244.1
65°	220.4
67.5°	192.0
70°	161.2
72.5°	135.1
75°	109.0
77.5°	85.4
80°	64.0
82.5°	45.1
85°	28.4
87.5°	11.9
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)