

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P593686

Luminaire Tested: **HCC8S35D010BZ-HM82555850-81WDBB**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P593686
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-11)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8S35D010BZ-HM82555850-81WDBB
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, BLACK BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 5000K CCT CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4484.2 lumens
Efficiency: N/A
Efficacy: 133.1 lumens/watt
Spacing Criteria (0/90/45): 1.32 / 1.32 / 1.13
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct

Input Watts (W): 33.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P593686
CATALOG NUMBER: HCC8S35D010BZ-HM82555850-81WDBB

Luminous Intensity Polar Plot

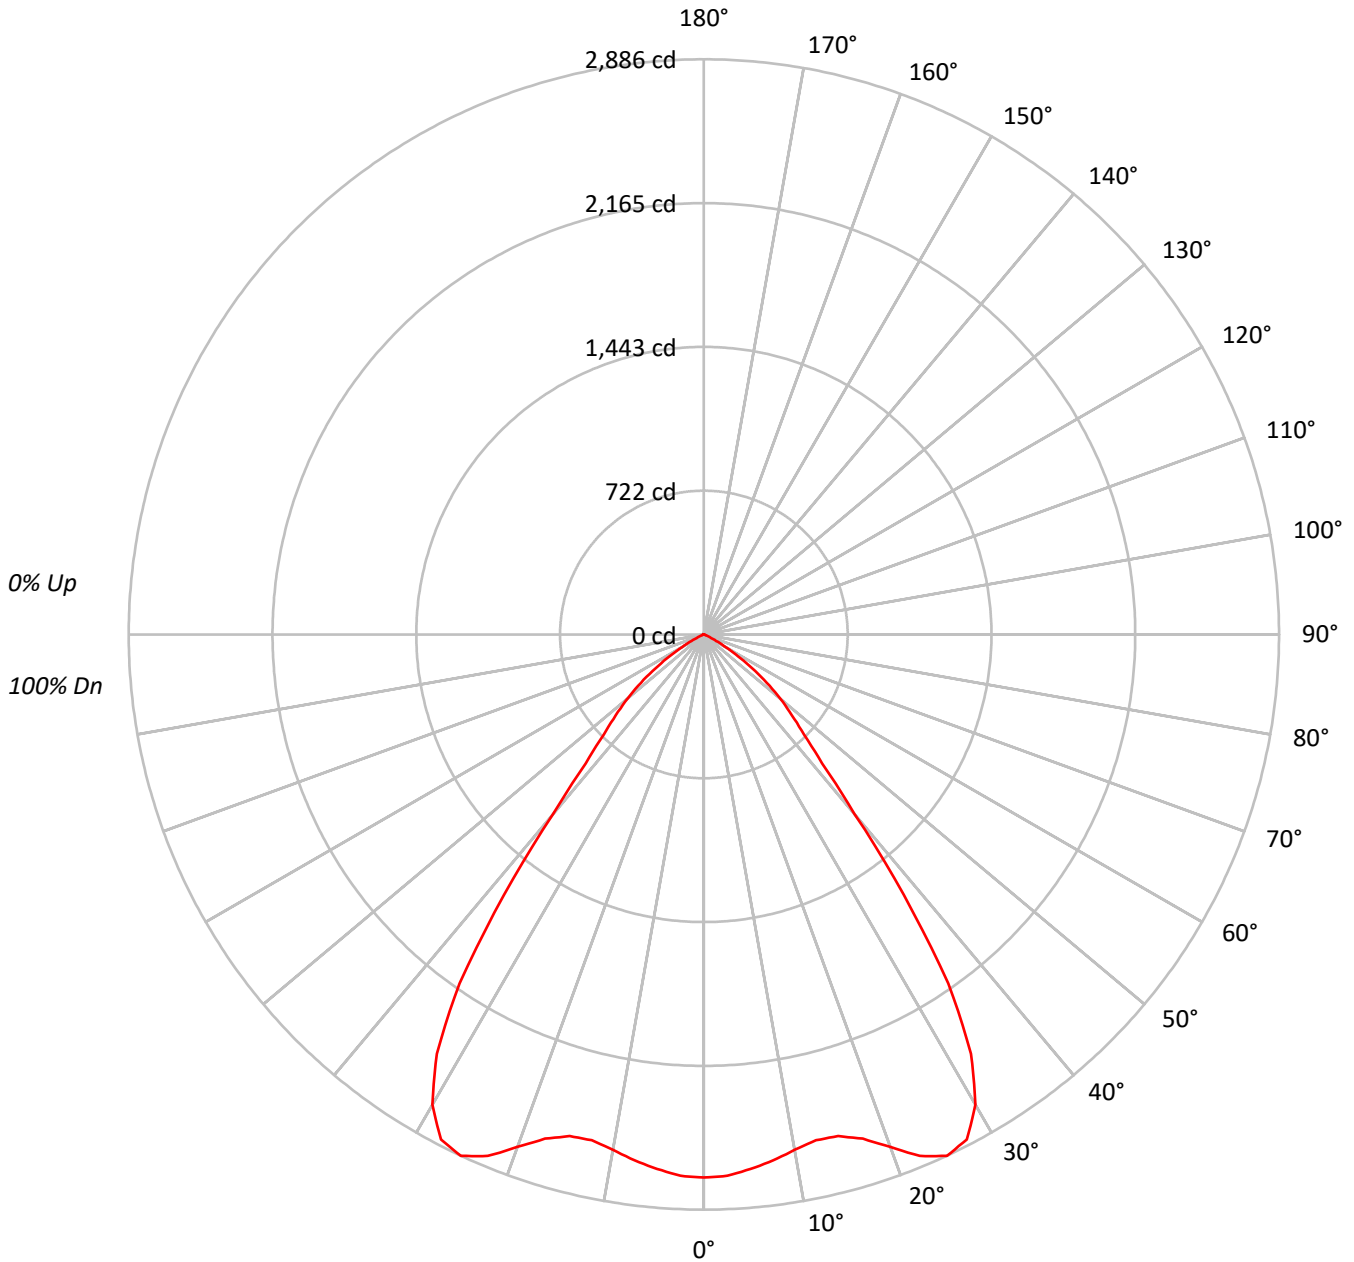

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P593686

CATALOG NUMBER: HCC8S35D010BZ-HM82555850-81WDBB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	109	107	104	110	107	105	102	103	101	99	99	98	96	96	95	93	92			
2	106	100	95	92	104	98	94	91	95	92	89	92	89	87	89	87	85	83			
3	99	92	86	81	97	90	85	81	88	83	79	85	81	78	83	80	77	75			
4	93	84	78	73	91	83	77	72	81	76	71	79	74	71	77	73	70	68			
5	87	77	71	66	85	76	70	65	74	69	65	73	68	64	71	67	63	62			
6	82	71	64	59	80	70	64	59	69	63	59	67	62	58	66	61	58	56			
7	77	66	59	54	75	65	59	54	64	58	54	63	57	53	61	57	53	51			
8	72	61	54	49	71	61	54	49	59	53	49	58	53	49	57	52	49	47			
9	68	57	50	45	67	56	50	45	55	49	45	54	49	45	53	48	45	43			
10	64	53	46	42	63	53	46	42	52	46	42	51	45	42	50	45	41	40			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	84017
5°	83319
10°	82219
15°	83156
20°	89802
25°	98204
30°	97014
35°	80476
40°	47367
45°	30945
50°	23986
55°	15935
60°	7758
65°	2401
70°	811
75°	715
80°	533
85°	1061



TEST NUMBER: P593686
 CATALOG NUMBER: HCC8S35D010BZ-HM82555850-81WDBB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	254.9	5.7
10°-20°	748.3	16.7
20°-30°	1308.4	29.2
30°-40°	1272.8	28.4
40°-50°	578.8	12.9
50°-60°	268.4	6.0
60°-70°	45.0	1.0
70°-80°	5.5	0.1
80°-90°	2.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2311.7	51.6
0°-40°	3584.5	79.9
0°-60°	4431.6	98.8
0°-90°	4484.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4484.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2725	
5°	2692	255
15°	2605	748
25°	2886	1308
35°	2138	1273
45°	710	579
55°	296	268
65°	33	45
75°	6	6
85°	3	2
90°	0	



TEST NUMBER: P593686
CATALOG NUMBER: HCC8S35D010BZ-HM82555850-81WDBB

CANDELA DISTRIBUTION (FULL):

	0°
0°	2724.6
2.5°	2718.6
5°	2691.7
7.5°	2661.7
10°	2625.8
12.5°	2598.8
15°	2604.8
17.5°	2652.7
20°	2736.6
22.5°	2832.4
25°	2886.3
27.5°	2856.4
30°	2724.6
32.5°	2494.1
35°	2137.8
37.5°	1646.8
40°	1176.7
42.5°	877.3
45°	709.6
47.5°	598.8
50°	500.0
52.5°	398.2
55°	296.4
57.5°	203.5
60°	125.8
62.5°	68.9
65°	32.9
67.5°	15.0
70°	9.0
72.5°	6.0
75°	6.0
77.5°	3.0
80°	3.0
82.5°	3.0
85°	3.0
87.5°	0.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)