

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584441

Luminaire Tested: **HCC8W35D010BZ-HM82555927-81MDW**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P584441
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W35D010BZ-HM82555927-81MDW
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" MEDIUM DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3188.5 lumens
Efficiency: N/A
Efficacy: 94.6 lumens/watt
Spacing Criteria (0/90/45): 1 / 1 / 0.95
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct

Input Watts (W): 33.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P584441
CATALOG NUMBER: HCC8W35D010BZ-HM82555927-81MDW

Luminous Intensity Polar Plot

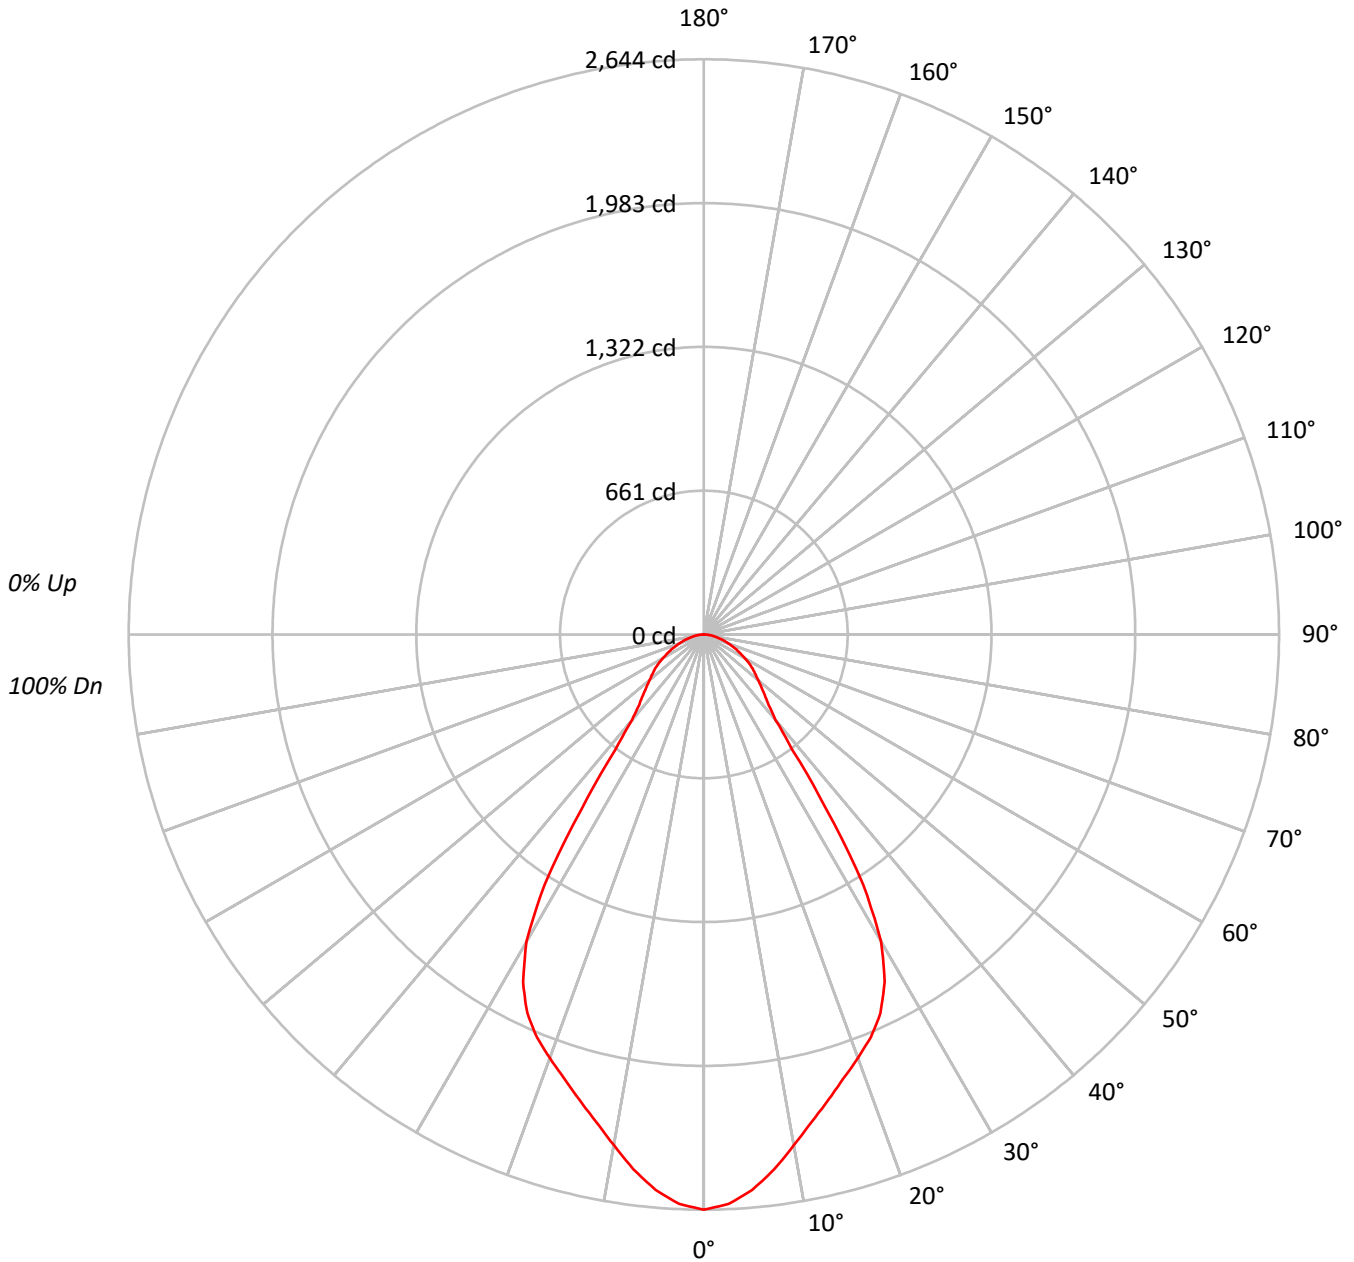

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P584441

CATALOG NUMBER: HCC8W35D010BZ-HM82555927-81MDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	92	90																			
2	104	98	93	89	102	96	92	88	93	89	86	90	87	84	87	84	82	80																			
3	98	89	83	78	95	88	82	78	85	80	76	83	78	75	80	77	74	72																			
4	91	82	75	70	89	81	74	69	78	73	69	76	72	68	74	70	67	65																			
5	86	76	68	63	84	75	68	63	73	67	62	71	66	62	69	65	61	59																			
6	81	70	63	58	79	69	62	57	67	61	57	66	61	56	64	60	56	54																			
7	76	65	58	53	74	64	57	53	63	57	52	62	56	52	60	55	52	50																			
8	72	61	54	49	70	60	53	49	59	53	48	58	52	48	57	52	48	46																			
9	68	57	50	45	67	56	50	45	55	49	45	54	49	45	53	48	45	43																			
10	64	53	46	42	63	53	46	42	52	46	42	51	46	42	50	45	42	40																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	81528
5°	79304
10°	74629
15°	70658
20°	67967
25°	65343
30°	58035
35°	36959
40°	20626
45°	17278
50°	15596
55°	14698
60°	13408
65°	12098
70°	10675
75°	9496
80°	8399
85°	7642



TEST NUMBER: P584441
 CATALOG NUMBER: HCC8W35D010BZ-HM82555927-81MDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	238.8	7.5
10°-20°	624.2	19.6
20°-30°	870.8	27.3
30°-40°	626.6	19.7
40°-50°	310.5	9.7
50°-60°	243.0	7.6
60°-70°	164.5	5.2
70°-80°	85.4	2.7
80°-90°	24.6	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1733.9	54.4
0°-40°	2360.5	74.0
0°-60°	2913.9	91.4
0°-90°	3188.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3188.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2644	
5°	2562	239
15°	2213	624
25°	1920	871
35°	982	627
45°	396	311
55°	273	243
65°	166	164
75°	80	85
85°	22	25
90°	0	



TEST NUMBER: P584441
CATALOG NUMBER: HCC8W35D010BZ-HM82555927-81MDW

CANDELA DISTRIBUTION (FULL):

0°	
0°	2643.9
2.5°	2620.3
5°	2562.0
7.5°	2480.2
10°	2383.4
12.5°	2293.0
15°	2213.3
17.5°	2138.0
20°	2071.2
22.5°	2004.5
25°	1920.5
27.5°	1799.9
30°	1629.9
32.5°	1362.8
35°	981.8
37.5°	669.6
40°	512.4
42.5°	441.3
45°	396.2
47.5°	357.4
50°	325.1
52.5°	297.1
55°	273.4
57.5°	245.5
60°	217.4
62.5°	189.5
65°	165.8
67.5°	142.1
70°	118.4
72.5°	99.1
75°	79.7
77.5°	62.4
80°	47.3
82.5°	34.5
85°	21.6
87.5°	10.8
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)