

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584566

Luminaire Tested: **HCC8S40D010MB-HM82555840-81RWWH**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P584566  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-15)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8S40D010MB-HM82555840-81RWWH  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WALLWASH DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 4800.1 lumens  
Efficiency: N/A  
Efficacy: 117.1 lumens/watt  
Spacing Criteria (0/90/45): 1.13 / 1.07 / 1.16  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P584566  
CATALOG NUMBER: HCC8S40D010MB-HM82555840-81RWWH

### Luminous Intensity Polar Plot

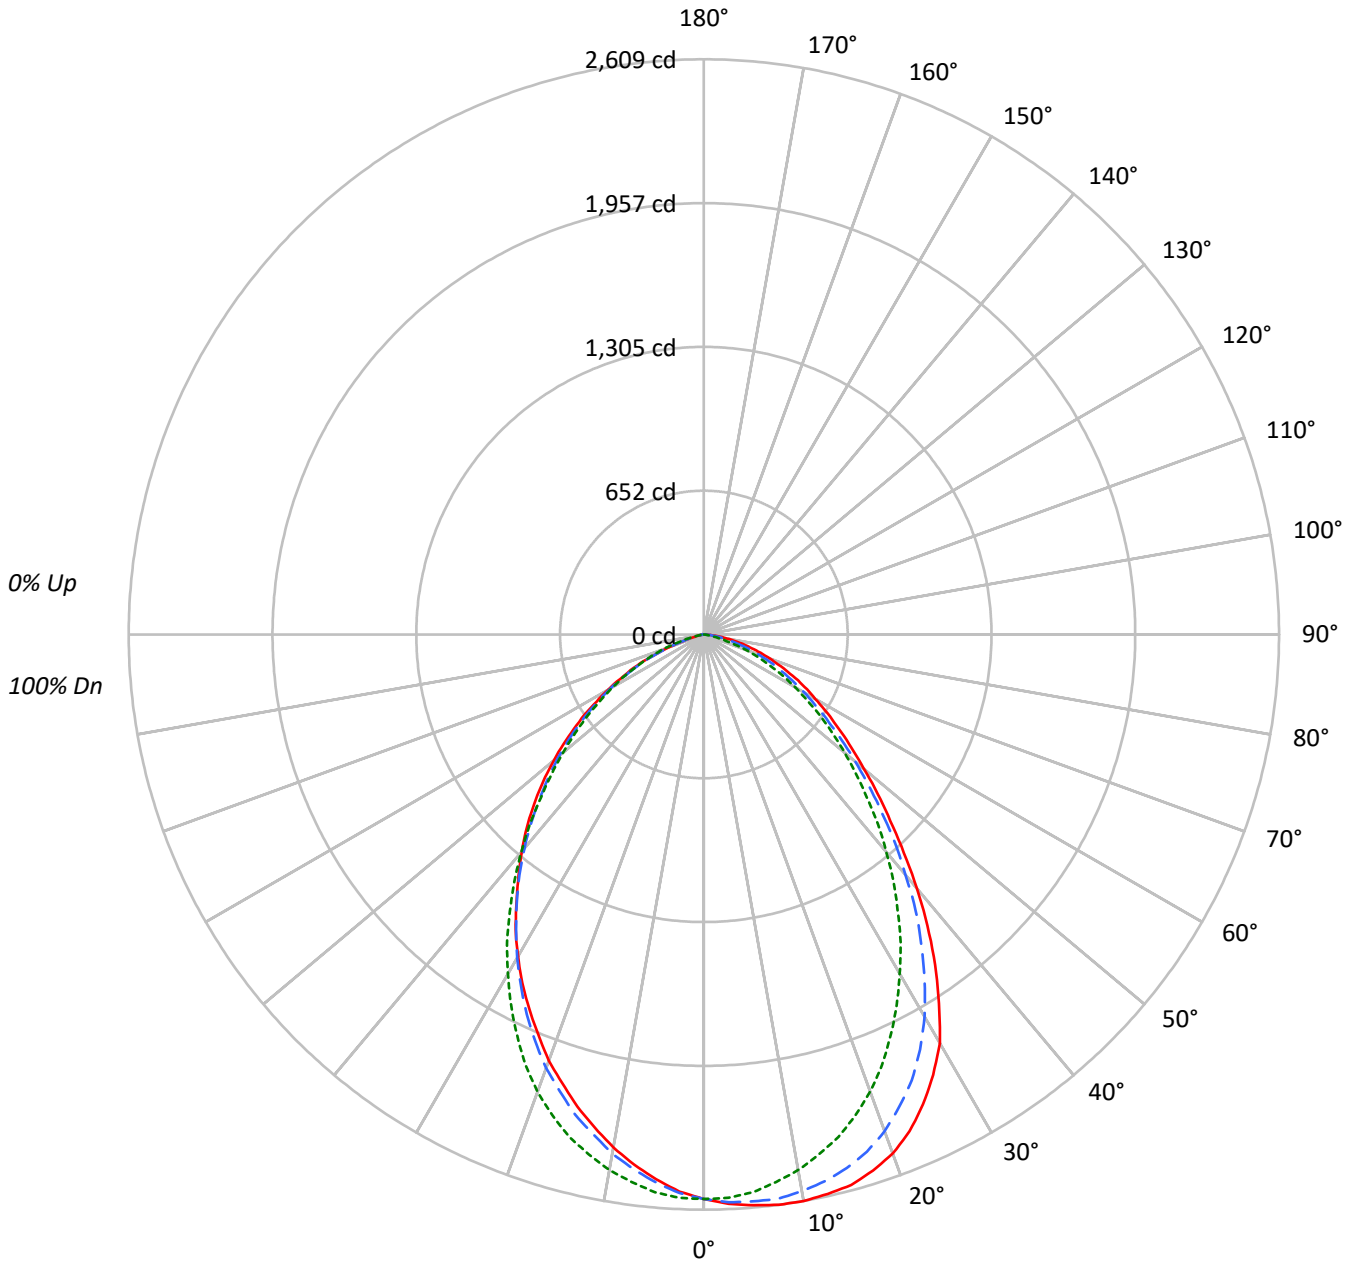

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584566

CATALOG NUMBER: HCC8S40D010MB-HM82555840-81RWWH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	107	104	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88					88			
2	103	96	90	85	100	94	89	84	90	86	82	87	84	80	84	81	79	77					77			
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67					67			
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59					59			
5	81	70	62	56	79	69	62	56	67	60	55	65	59	55	63	58	54	52					52			
6	76	64	56	50	74	63	55	50	61	54	49	60	54	49	58	53	49	47					47			
7	71	58	51	45	69	58	50	45	56	49	45	55	49	44	54	48	44	42					42			
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38					38			
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	41	36	35					35			
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	78956	78956	78956
5°	80440	78614	76788
10°	81696	77244	73981
15°	82517	75319	70776
20°	82202	72410	67514
25°	80035	68232	63744
30°	76223	63252	60040
35°	68829	57731	55766
40°	60474	51815	51678
45°	52200	45541	47508
50°	45435	39942	42609
55°	40294	34692	37117
60°	35949	29313	30812
65°	32404	23801	24305
70°	28779	17834	14389
75°	24794	10342	6195
80°	19108	3694	1847
85°	12277	1238	1238



TEST NUMBER: P584566  
 CATALOG NUMBER: HCC8S40D010MB-HM82555840-81RWWH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	240.4	5.0
10°-20°	669.1	13.9
20°-30°	946.4	19.7
30°-40°	997.3	20.8
40°-50°	847.5	17.7
50°-60°	610.3	12.7
60°-70°	352.1	7.3
70°-80°	120.5	2.5
80°-90°	16.6	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1855.9	38.7
0°-40°	2853.2	59.4
0°-60°	4311.0	89.8
0°-90°	4800.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4800.1	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	2560	2560	2560	2560	2560	
5°	2599	2581	2540	2495	2481	248
15°	2585	2505	2359	2255	2217	728
25°	2352	2231	2005	1901	1874	1079
35°	1828	1721	1534	1478	1481	1139
45°	1197	1141	1044	1051	1089	930
55°	750	690	645	670	690	674
65°	444	382	326	319	333	442
75°	208	156	87	56	52	220
85°	35	21	4	4	4	47
90°	0	0	0	0	0	



TEST NUMBER: P584566

CATALOG NUMBER: HCC8S40D010MB-HM82555840-81RWWH

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5
2.5°	2584.8	2588.2	2584.8	2584.8	2581.3	2577.9	2574.3	2570.9	2564.0	2557.1	2557.1
5°	2598.7	2605.6	2598.7	2598.7	2588.2	2581.3	2574.3	2564.0	2550.1	2539.7	2539.7
7.5°	2609.1	2609.1	2609.1	2598.7	2591.7	2581.3	2564.0	2546.6	2529.2	2512.0	2505.0
10°	2609.1	2609.1	2605.6	2591.7	2584.8	2564.0	2546.6	2522.3	2498.0	2473.8	2466.9
12.5°	2598.7	2602.2	2595.2	2581.3	2564.0	2539.7	2515.4	2484.1	2456.4	2428.7	2414.7
15°	2584.8	2581.3	2574.3	2557.1	2536.2	2505.0	2480.7	2446.0	2407.8	2373.1	2359.3
17.5°	2550.1	2550.1	2539.7	2522.3	2494.6	2459.8	2421.8	2383.6	2341.9	2303.7	2286.5
20°	2505.0	2505.0	2491.1	2470.3	2442.6	2397.4	2355.8	2310.7	2262.1	2224.0	2206.6
22.5°	2439.0	2442.6	2425.2	2400.9	2369.6	2317.6	2276.0	2220.5	2171.9	2126.8	2113.0
25°	2352.3	2359.3	2341.9	2317.6	2276.0	2230.9	2178.9	2126.8	2071.3	2026.2	2005.4
27.5°	2251.7	2255.2	2237.8	2213.5	2171.9	2123.3	2071.3	2015.7	1963.7	1915.2	1894.4
30°	2140.7	2126.8	2119.9	2088.7	2043.6	2001.9	1942.9	1897.8	1842.4	1800.7	1776.4
32.5°	1984.6	1991.5	1970.6	1946.4	1911.7	1863.2	1814.5	1762.5	1710.5	1679.2	1662.0
35°	1828.4	1835.3	1825.0	1800.7	1762.5	1720.9	1672.3	1634.1	1589.0	1550.9	1533.6
37.5°	1665.4	1665.4	1658.4	1644.6	1616.7	1578.7	1530.1	1491.9	1453.7	1422.5	1412.1
40°	1502.3	1495.4	1491.9	1481.4	1457.2	1422.5	1391.2	1360.1	1321.9	1301.0	1287.2
42.5°	1342.7	1342.7	1335.8	1325.3	1301.0	1283.8	1252.5	1217.8	1190.0	1169.2	1169.2
45°	1197.0	1200.5	1190.0	1183.1	1169.2	1141.4	1113.7	1089.4	1065.2	1051.2	1044.3
47.5°	1068.6	1068.6	1058.1	1051.2	1037.4	1013.0	988.8	967.9	950.7	940.2	936.8
50°	947.1	947.1	947.1	929.9	912.5	895.1	877.7	853.5	843.1	836.1	832.6
52.5°	843.1	839.7	839.7	825.7	808.4	787.5	770.3	749.5	739.0	732.1	735.5
55°	749.5	749.5	745.9	728.6	711.3	690.4	673.1	655.7	648.8	641.9	645.3
56°	711.3	711.3	707.8	693.9	673.1	655.7	634.9	617.6	607.1	610.6	610.6
57°	683.5	676.5	676.5	659.3	641.9	617.6	600.2	582.9	576.0	572.5	572.5
58°	648.8	645.3	641.9	624.5	607.1	586.3	569.1	551.7	541.2	541.2	537.8
59°	614.2	614.2	607.1	593.3	576.0	555.1	537.8	520.4	510.0	506.6	506.6
60°	582.9	586.3	576.0	562.0	548.2	523.8	503.1	489.2	478.7	475.3	475.3
61°	555.1	555.1	548.2	530.9	513.5	496.1	475.3	458.0	451.0	444.1	444.1
62°	530.9	523.8	520.4	503.1	485.8	464.9	447.6	430.2	419.8	412.9	416.4
63°	499.6	496.1	489.2	475.3	458.0	437.2	416.4	402.5	392.1	381.6	385.1
64°	475.3	471.8	461.5	447.6	430.2	409.4	388.5	374.7	367.7	357.4	353.9
65°	444.1	440.7	437.2	419.8	402.5	381.6	364.3	350.5	340.0	333.1	326.2
66°	416.4	419.8	412.9	399.0	378.2	360.8	336.5	322.6	315.7	305.4	298.3
67°	392.1	392.1	385.1	371.3	350.5	333.1	315.7	298.3	288.0	277.5	274.1
67.5°	378.2	378.2	371.3	353.9	340.0	319.2	301.9	288.0	274.1	267.2	260.3
68°	364.3	364.3	360.8	347.0	329.6	308.8	291.4	274.1	260.3	249.8	246.3
69°	340.0	343.4	336.5	322.6	305.4	284.5	267.2	253.2	239.4	229.0	222.1
70°	319.2	315.7	308.8	294.9	277.5	263.7	246.3	229.0	215.2	201.2	197.8
71°	291.4	291.4	284.5	274.1	256.8	239.4	222.1	208.1	194.3	177.0	173.5
72°	270.6	270.6	263.7	249.8	236.0	218.6	201.2	183.9	173.5	156.1	149.2
72.5°	256.8	260.3	253.2	239.4	225.5	204.7	190.9	177.0	159.6	145.8	138.8
73°	249.8	246.3	242.9	229.0	211.6	197.8	180.4	166.5	149.2	135.3	128.4



TEST NUMBER: P584566  
 CATALOG NUMBER: HCC8S40D010MB-HM82555840-81RWWH

**CANDELA DISTRIBUTION (continued):**

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
77.5°	156.1	156.1	152.7	138.8	125.0	111.0	97.1	83.3	69.4	55.5	48.6
80°	107.6	111.0	104.1	97.1	86.8	72.8	59.0	48.6	34.7	27.7	20.8
82.5°	69.4	69.4	65.9	59.0	52.0	41.6	34.7	24.3	17.4	13.9	10.4
85°	34.7	38.2	34.7	31.2	24.3	20.8	17.4	10.4	6.9	3.5	3.5
87.5°	13.9	13.9	13.9	10.4	10.4	6.9	3.5	3.5	3.5	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P584566

CATALOG NUMBER: HCC8S40D010MB-HM82555840-81RWWH

**CANDELA DISTRIBUTION (continued):**

	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5	2560.5
2.5°	2550.1	2550.1	2543.1	2539.7	2536.2	2532.8	2529.2	2525.8	2525.8	2529.2
5°	2529.2	2522.3	2508.4	2505.0	2494.6	2491.1	2484.1	2480.7	2484.1	2480.7
7.5°	2498.0	2484.1	2466.9	2459.8	2446.0	2439.0	2428.7	2428.7	2421.8	2425.2
10°	2456.4	2435.6	2414.7	2400.9	2390.5	2380.1	2373.1	2366.2	2362.7	2362.7
12.5°	2404.4	2380.1	2359.3	2338.5	2321.1	2314.2	2300.3	2300.3	2293.4	2289.9
15°	2345.4	2314.2	2289.9	2269.1	2255.2	2241.2	2230.9	2224.0	2217.0	2217.0
17.5°	2269.1	2241.2	2217.0	2192.7	2171.9	2161.5	2151.0	2140.7	2140.7	2133.8
20°	2185.8	2154.6	2133.8	2109.5	2092.1	2074.8	2060.8	2060.8	2053.9	2057.4
22.5°	2092.1	2053.9	2033.1	2015.7	1998.5	1984.6	1970.6	1970.6	1967.2	1963.7
25°	1988.0	1956.8	1932.6	1911.7	1901.3	1887.5	1883.9	1877.0	1873.5	1873.5
27.5°	1877.0	1852.7	1821.5	1811.1	1797.3	1790.2	1790.2	1786.8	1779.9	1783.3
30°	1759.1	1731.3	1714.0	1707.1	1693.1	1693.1	1689.7	1682.7	1682.7	1686.2
32.5°	1644.6	1616.7	1602.9	1599.5	1585.6	1585.6	1582.1	1585.6	1585.6	1589.0
35°	1519.6	1495.4	1491.9	1481.4	1478.0	1478.0	1478.0	1485.0	1491.9	1481.4
37.5°	1401.7	1384.3	1374.0	1370.4	1374.0	1374.0	1377.4	1387.8	1384.3	1380.9
40°	1280.2	1266.4	1259.4	1259.4	1266.4	1273.3	1273.3	1283.8	1287.2	1283.8
42.5°	1158.8	1148.4	1148.4	1151.9	1158.8	1162.3	1172.7	1183.1	1186.5	1190.0
45°	1044.3	1044.3	1044.3	1047.8	1051.2	1058.1	1072.1	1082.5	1086.0	1089.4
47.5°	933.3	929.9	940.2	943.7	954.1	957.6	967.9	981.9	985.3	988.8
50°	829.2	836.1	839.7	850.0	856.9	856.9	870.8	877.7	888.2	888.2
52.5°	732.1	742.4	745.9	756.4	759.8	763.3	770.3	780.6	787.5	787.5
55°	645.3	648.8	655.7	659.3	669.6	673.1	680.0	683.5	693.9	690.4
56°	607.1	614.2	617.6	624.5	631.4	634.9	641.9	645.3	652.2	655.7
57°	572.5	576.0	586.3	589.8	596.8	596.8	600.2	610.6	610.6	614.2
58°	537.8	544.7	548.2	551.7	558.6	562.0	569.1	572.5	576.0	572.5
59°	506.6	510.0	513.5	513.5	520.4	520.4	530.9	537.8	541.2	541.2
60°	475.3	475.3	478.7	482.3	489.2	492.7	492.7	499.6	499.6	499.6
61°	444.1	444.1	447.6	451.0	454.5	454.5	461.5	461.5	464.9	468.4
62°	416.4	412.9	412.9	416.4	416.4	423.3	426.7	430.2	433.6	430.2
63°	385.1	381.6	381.6	381.6	381.6	388.5	388.5	392.1	399.0	395.6
64°	350.5	350.5	350.5	350.5	353.9	353.9	360.8	364.3	367.7	371.3
65°	326.2	319.2	315.7	315.7	319.2	322.6	326.2	329.6	333.1	333.1
66°	298.3	291.4	288.0	288.0	288.0	288.0	294.9	294.9	301.9	301.9
67°	267.2	260.3	256.8	253.2	253.2	253.2	263.7	260.3	260.3	260.3
67.5°	256.8	246.3	242.9	239.4	236.0	242.9	239.4	242.9	242.9	239.4
68°	242.9	236.0	229.0	222.1	222.1	222.1	225.5	229.0	225.5	222.1
69°	215.2	211.6	201.2	194.3	190.9	194.3	190.9	194.3	190.9	194.3
70°	190.9	180.4	170.1	166.5	163.0	163.0	163.0	159.6	163.0	159.6
71°	166.5	156.1	145.8	138.8	135.3	135.3	131.9	135.3	131.9	135.3
72°	142.2	131.9	117.9	111.0	111.0	111.0	111.0	107.6	111.0	107.6
72.5°	131.9	117.9	107.6	100.7	97.1	97.1	97.1	97.1	93.7	97.1
73°	121.4	107.6	93.7	90.2	90.2	90.2	86.8	83.3	86.8	86.8





TEST NUMBER: P584566  
 CATALOG NUMBER: HCC8S40D010MB-HM82555840-81RWWH

**CANDELA DISTRIBUTION (continued):**

	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
77.5°	41.6	31.2	27.7	27.7	27.7	27.7	27.7	27.7	24.3	24.3
80°	17.4	13.9	10.4	10.4	10.4	10.4	10.4	10.4	10.4	10.4
82.5°	6.9	6.9	6.9	6.9	6.9	6.9	6.9	6.9	6.9	6.9
85°	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



74°	225.5	225.5	218.6	208.1	190.9	173.5	159.6	145.8	128.4	111.0	104.1
75°	208.1	204.7	197.8	187.3	173.5	156.1	142.2	125.0	111.0	93.7	86.8

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



74°	100.7	83.3	76.3	69.4	69.4	69.4	65.9	65.9	65.9	69.4
75°	79.8	65.9	59.0	52.0	55.5	52.0	55.5	52.0	52.0	52.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)