

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584620

Luminaire Tested: **HCC8S40D010MW-HM82555935-81WDH**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P584620  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-8)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8S40D010MW-HM82555935-81WDH  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 4751.3 lumens  
Efficiency: N/A  
Efficacy: 115.9 lumens/watt  
Spacing Criteria (0/90/45): 1.12 / 1.12 / 1.06  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P584620  
CATALOG NUMBER: HCC8S40D010MW-HM82555935-81WDH

### Luminous Intensity Polar Plot

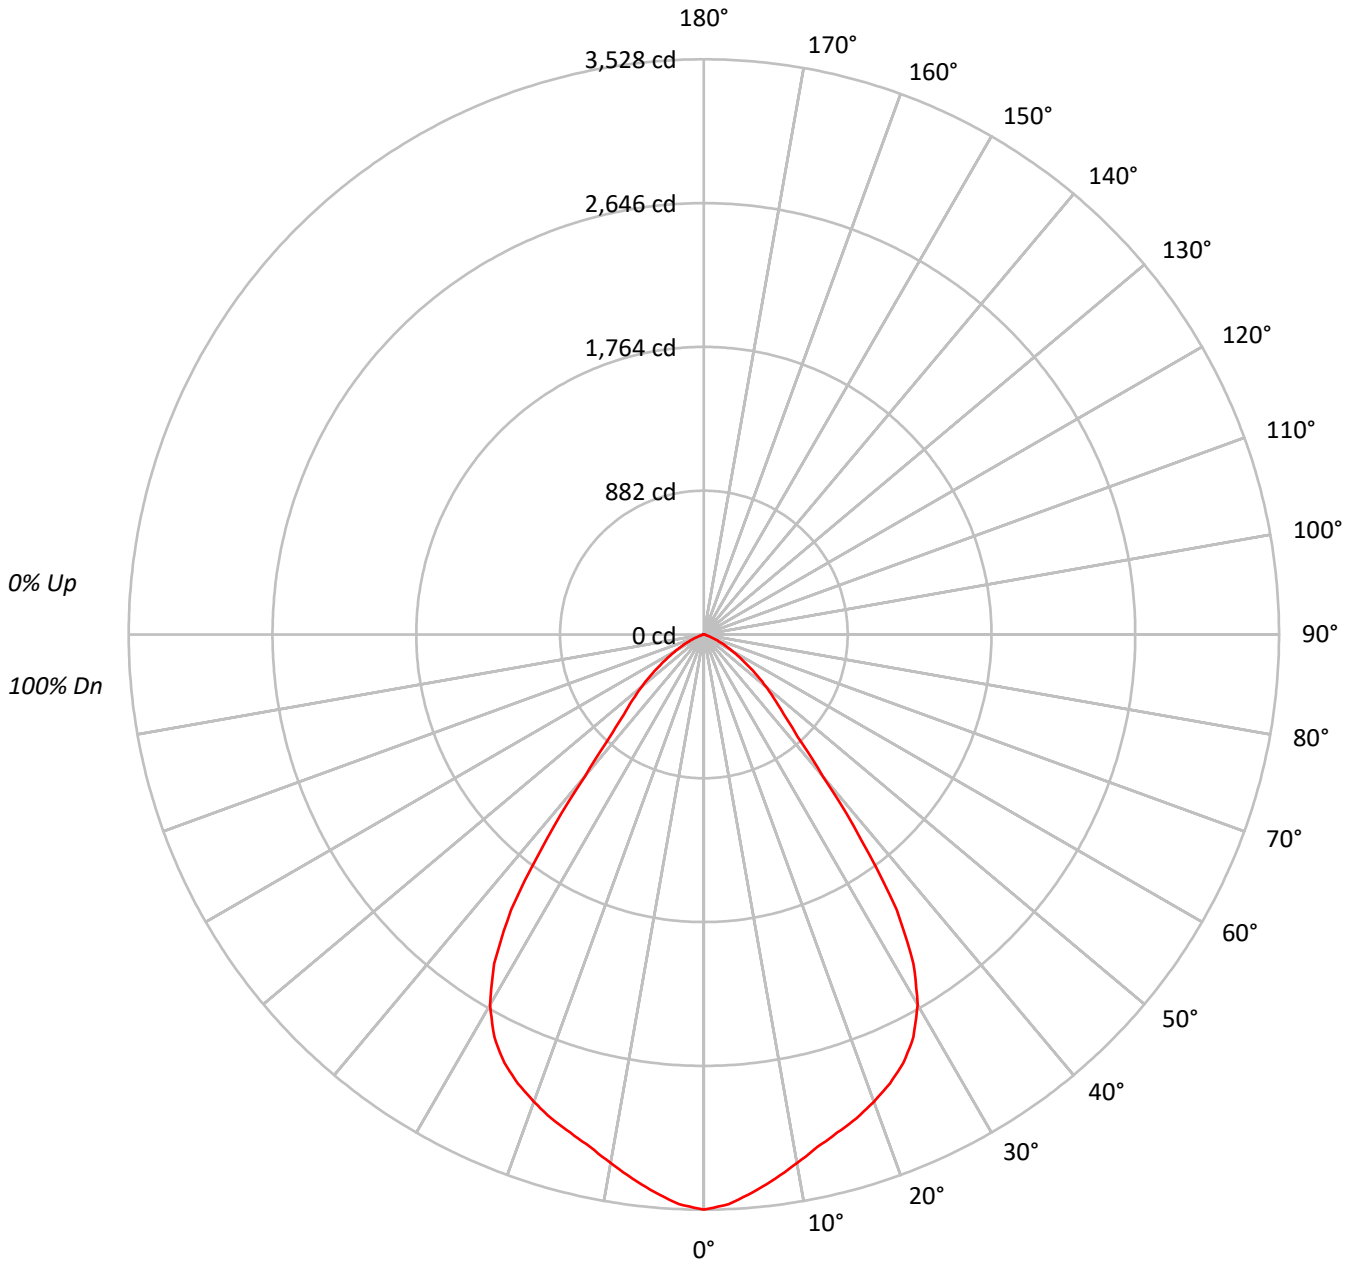

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584620

CATALOG NUMBER: HCC8S40D010MW-HM82555935-81WDH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	109	107	104	110	107	105	102	103	101	99	99	98	96	96	95	93	92			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			
3	99	92	86	81	97	90	85	81	88	83	79	85	81	78	83	80	77	75			
4	93	84	78	73	91	83	77	72	81	76	72	79	74	71	77	73	70	68			
5	87	78	71	66	86	77	70	66	75	69	65	73	68	64	71	67	64	62			
6	82	72	65	60	80	71	64	60	69	64	59	68	63	59	66	62	58	57			
7	77	67	60	55	76	66	59	55	64	59	54	63	58	54	62	57	54	52			
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48			
9	69	58	51	46	67	57	51	46	56	50	46	55	50	46	54	49	46	44			
10	65	54	47	43	64	53	47	43	53	47	43	52	46	43	51	46	42	41			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	108775
5°	106324
10°	103063
15°	100979
20°	100074
25°	98578
30°	93379
35°	77585
40°	45688
45°	30217
50°	23790
55°	17505
60°	12162
65°	7406
70°	3228
75°	1418
80°	1048
85°	0



TEST NUMBER: P584620  
 CATALOG NUMBER: HCC8S40D010MW-HM82555935-81WDH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	323.5	6.8
10°-20°	894.2	18.8
20°-30°	1324.9	27.9
30°-40°	1224.3	25.8
40°-50°	564.5	11.9
50°-60°	296.9	6.2
60°-70°	104.9	2.2
70°-80°	16.4	0.3
80°-90°	1.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2542.6	53.5
0°-40°	3766.9	79.3
0°-60°	4628.3	97.4
0°-90°	4751.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4751.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3528	
5°	3435	323
15°	3163	894
25°	2897	1325
35°	2061	1224
45°	693	564
55°	326	297
65°	102	105
75°	12	16
85°	0	2
90°	0	



TEST NUMBER: P584620  
CATALOG NUMBER: HCC8S40D010MW-HM82555935-81WDH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3527.5
2.5°	3497.6
5°	3434.9
7.5°	3366.2
10°	3291.5
12.5°	3219.9
15°	3163.1
17.5°	3112.3
20°	3049.6
22.5°	2981.0
25°	2897.3
27.5°	2783.8
30°	2622.5
32.5°	2392.5
35°	2061.0
37.5°	1583.1
40°	1135.0
42.5°	851.2
45°	692.9
47.5°	588.5
50°	495.9
52.5°	406.3
55°	325.6
57.5°	256.9
60°	197.2
62.5°	149.3
65°	101.5
67.5°	59.7
70°	35.8
72.5°	20.9
75°	11.9
77.5°	8.9
80°	5.9
82.5°	3.0
85°	0.0
87.5°	0.0
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)