

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584804

Luminaire Tested: **HCC8S50D010BZ-HM82555830-81RWWH**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P584804  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-15)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8S50D010BZ-HM82555830-81RWWH  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WALLWASH DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 4688.1 lumens  
Efficiency: N/A  
Efficacy: 97.7 lumens/watt  
Spacing Criteria (0/90/45): 1.13 / 1.07 / 1.16  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 48  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P584804  
CATALOG NUMBER: HCC8S50D010BZ-HM82555830-81RWWH

### Luminous Intensity Polar Plot

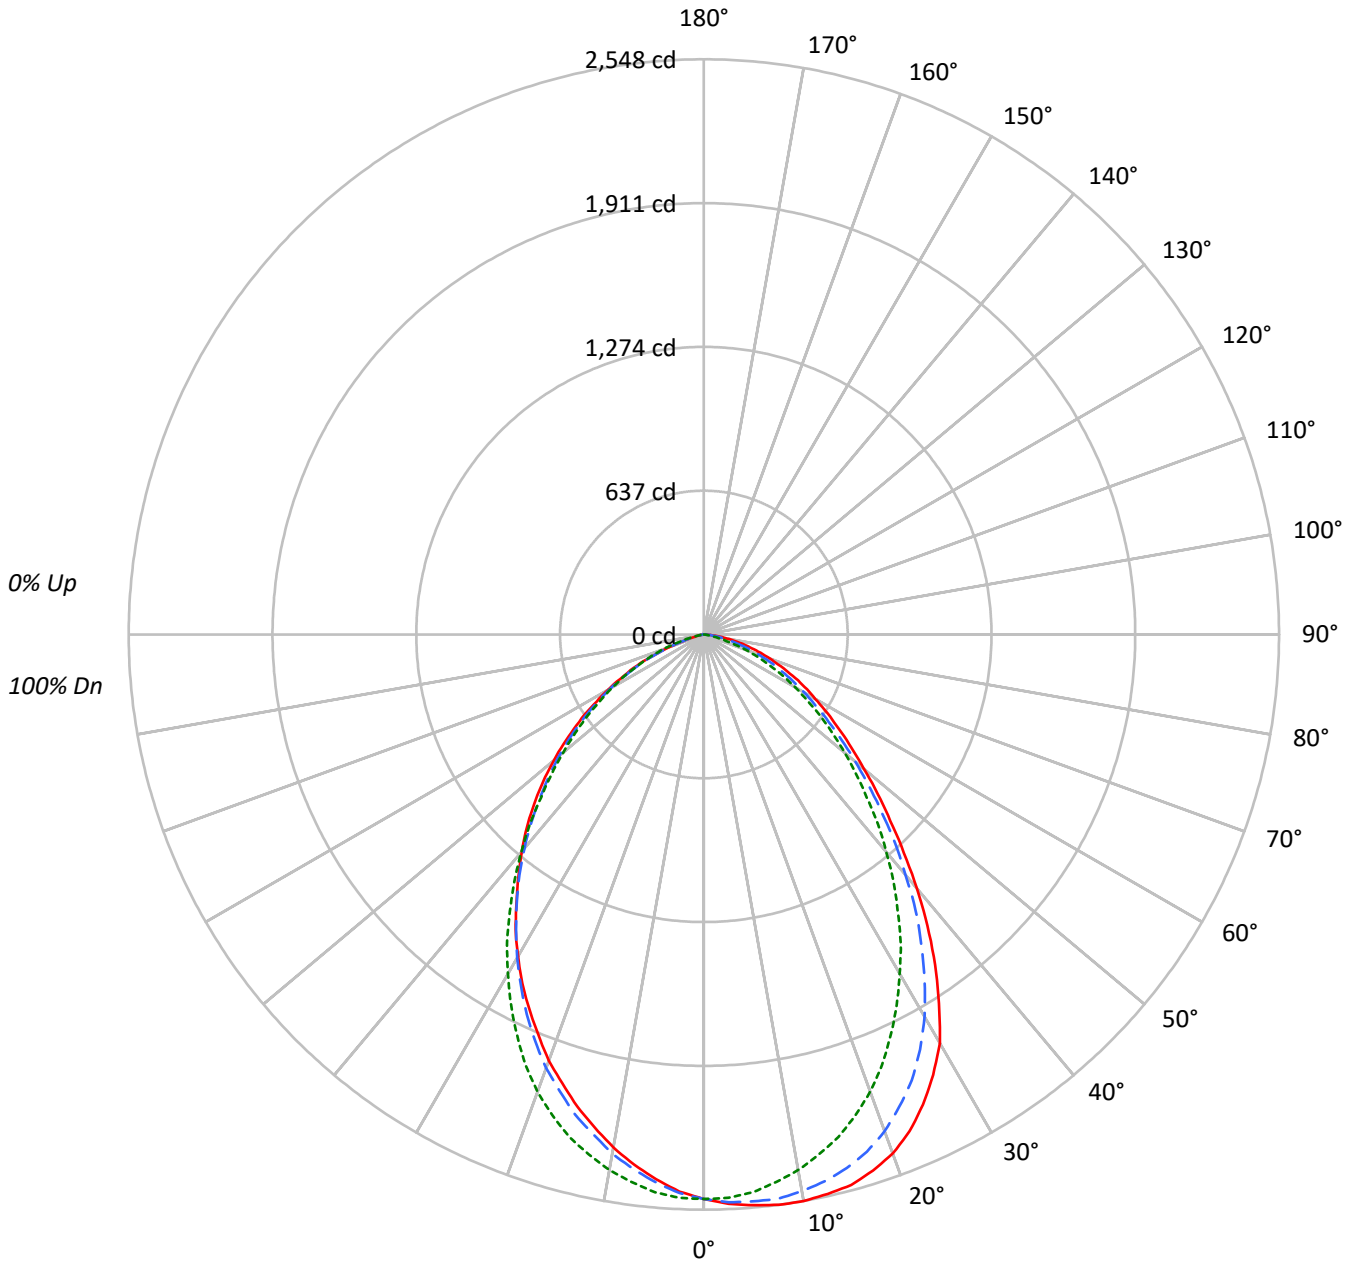

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584804

CATALOG NUMBER: HCC8S50D010BZ-HM82555830-81RWWH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	107	104	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88					88			
2	103	96	90	85	100	94	89	84	90	86	82	87	84	80	84	81	79	77					77			
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67					67			
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59					59			
5	81	70	62	56	79	69	62	56	67	60	55	65	59	55	63	58	54	52					52			
6	76	64	56	50	74	63	55	50	61	54	49	60	54	49	58	53	49	47					47			
7	71	58	51	45	69	58	50	45	56	49	45	55	49	44	54	48	44	42					42			
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38					38			
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	41	36	35					35			
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	77112	77112	77112
5°	78562	76779	74996
10°	79789	75437	72256
15°	80592	73560	69122
20°	80283	70720	65939
25°	78167	66636	62257
30°	74447	61774	58637
35°	67225	56380	54467
40°	59061	50603	50470
45°	50979	44481	46400
50°	44375	39016	41616
55°	39348	33880	36251
60°	35110	28628	30090
65°	31645	23247	23735
70°	28112	17410	14047
75°	24222	10103	6064
80°	18664	3605	1811
85°	11994	1203	1203



TEST NUMBER: P584804  
 CATALOG NUMBER: HCC8S50D010BZ-HM82555830-81RWWH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	234.8	5.0
10°-20°	653.5	13.9
20°-30°	924.3	19.7
30°-40°	974.0	20.8
40°-50°	827.8	17.7
50°-60°	596.1	12.7
60°-70°	343.8	7.3
70°-80°	117.7	2.5
80°-90°	16.2	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1812.6	38.7
0°-40°	2786.6	59.4
0°-60°	4210.4	89.8
0°-90°	4688.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4688.1	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	2501	2501	2501	2501	2501	
5°	2538	2521	2480	2436	2423	243
15°	2524	2446	2304	2202	2165	711
25°	2297	2179	1958	1857	1830	1054
35°	1786	1681	1498	1444	1447	1112
45°	1169	1115	1020	1027	1064	908
55°	732	674	630	654	674	659
65°	434	373	319	312	325	431
75°	203	152	85	54	51	215
85°	34	20	3	3	3	46
90°	0	0	0	0	0	



TEST NUMBER: P584804

CATALOG NUMBER: HCC8S50D010BZ-HM82555830-81RWWH

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7
2.5°	2524.5	2527.8	2524.5	2524.5	2521.1	2517.7	2514.3	2510.9	2504.1	2497.3	2497.3
5°	2538.0	2544.8	2538.0	2538.0	2527.8	2521.1	2514.3	2504.1	2490.6	2480.4	2480.4
7.5°	2548.2	2548.2	2548.2	2538.0	2531.2	2521.1	2504.1	2487.2	2470.2	2453.3	2446.5
10°	2548.2	2548.2	2544.8	2531.2	2524.5	2504.1	2487.2	2463.4	2439.7	2416.0	2409.2
12.5°	2538.0	2541.4	2534.6	2521.1	2504.1	2480.4	2456.7	2426.1	2399.0	2372.0	2358.5
15°	2524.5	2521.1	2514.3	2497.3	2477.0	2446.5	2422.8	2388.9	2351.7	2317.8	2304.2
17.5°	2490.6	2490.6	2480.4	2463.4	2436.3	2402.4	2365.2	2327.9	2287.3	2250.0	2233.0
20°	2446.5	2446.5	2432.9	2412.6	2385.6	2341.5	2300.8	2256.8	2209.3	2172.0	2155.1
22.5°	2382.2	2385.6	2368.6	2344.9	2314.4	2263.5	2222.9	2168.6	2121.3	2077.2	2063.6
25°	2297.4	2304.2	2287.3	2263.5	2222.9	2178.8	2128.0	2077.2	2023.0	1978.9	1958.5
27.5°	2199.1	2202.5	2185.6	2161.8	2121.3	2073.8	2023.0	1968.7	1917.9	1870.5	1850.2
30°	2090.8	2077.2	2070.4	2039.9	1995.8	1955.2	1897.5	1853.6	1799.3	1758.6	1734.9
32.5°	1938.2	1945.0	1924.6	1900.9	1867.1	1819.7	1772.2	1721.4	1670.5	1640.0	1623.2
35°	1785.8	1792.5	1782.4	1758.6	1721.4	1680.7	1633.2	1596.0	1552.0	1514.7	1497.7
37.5°	1626.5	1626.5	1619.8	1606.2	1579.1	1541.8	1494.3	1457.0	1419.8	1389.2	1379.2
40°	1467.2	1460.4	1457.0	1446.9	1423.1	1389.2	1358.8	1328.3	1291.0	1270.7	1257.1
42.5°	1311.4	1311.4	1304.6	1294.4	1270.7	1253.8	1223.2	1189.3	1162.2	1141.9	1141.9
45°	1169.0	1172.4	1162.2	1155.4	1141.9	1114.9	1087.8	1064.0	1040.3	1026.7	1020.0
47.5°	1043.7	1043.7	1033.5	1026.7	1013.2	989.4	965.7	945.4	928.4	918.2	914.9
50°	925.0	925.0	925.0	908.1	891.1	874.3	857.3	833.6	823.4	816.7	813.3
52.5°	823.4	820.1	820.1	806.5	789.5	769.2	752.3	731.9	721.7	715.0	718.4
55°	731.9	731.9	728.5	711.6	694.6	674.3	657.3	640.4	633.6	626.9	630.2
56°	694.6	694.6	691.2	677.7	657.3	640.4	620.2	603.2	593.0	596.4	596.4
57°	667.5	660.7	660.7	643.8	626.9	603.2	586.3	569.3	562.5	559.1	559.1
58°	633.6	630.2	626.9	610.0	593.0	572.7	555.7	538.8	528.6	528.6	525.2
59°	599.8	599.8	593.0	579.5	562.5	542.2	525.2	508.3	498.1	494.7	494.7
60°	569.3	572.7	562.5	549.0	535.4	511.7	491.3	477.8	467.6	464.2	464.2
61°	542.2	542.2	535.4	518.5	501.5	484.6	464.2	447.3	440.5	433.7	433.7
62°	518.5	511.7	508.3	491.3	474.4	454.0	437.1	420.1	410.0	403.2	406.6
63°	487.9	484.6	477.8	464.2	447.3	426.9	406.6	393.0	382.8	372.8	376.2
64°	464.2	460.8	450.6	437.1	420.1	399.8	379.5	366.0	359.2	349.1	345.7
65°	433.7	430.3	426.9	410.0	393.0	372.8	355.8	342.3	332.1	325.3	318.6
66°	406.6	410.0	403.2	389.6	369.4	352.5	328.7	315.2	308.4	298.2	291.4
67°	382.8	382.8	376.2	362.6	342.3	325.3	308.4	291.4	281.3	271.1	267.7
67.5°	369.4	369.4	362.6	345.7	332.1	311.8	294.8	281.3	267.7	260.9	254.1
68°	355.8	355.8	352.5	338.9	321.9	301.6	284.7	267.7	254.1	244.0	240.6
69°	332.1	335.5	328.7	315.2	298.2	277.9	260.9	247.4	233.8	223.6	216.8
70°	311.8	308.4	301.6	288.0	271.1	257.5	240.6	223.6	210.1	196.5	193.1
71°	284.7	284.7	277.9	267.7	250.8	233.8	216.8	203.3	189.7	172.8	169.4
72°	264.3	264.3	257.5	244.0	230.4	213.5	196.5	179.6	169.4	152.4	145.7
72.5°	250.8	254.1	247.4	233.8	220.2	199.9	186.3	172.8	155.8	142.3	135.5
73°	244.0	240.6	237.2	223.6	206.7	193.1	176.2	162.6	145.7	132.1	125.4



TEST NUMBER: P584804  
 CATALOG NUMBER: HCC8S50D010BZ-HM82555830-81RWWH

**CANDELA DISTRIBUTION (continued):**

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
77.5°	152.4	152.4	149.0	135.5	122.0	108.5	94.9	81.4	67.8	54.2	47.5
80°	105.1	108.5	101.7	94.9	84.8	71.2	57.6	47.5	33.9	27.1	20.3
82.5°	67.8	67.8	64.4	57.6	50.9	40.7	33.9	23.7	17.0	13.6	10.2
85°	33.9	37.3	33.9	30.5	23.7	20.3	17.0	10.2	6.8	3.4	3.4
87.5°	13.6	13.6	13.6	10.2	10.2	6.8	3.4	3.4	3.4	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P584804

CATALOG NUMBER: HCC8S50D010BZ-HM82555830-81RWWH

**CANDELA DISTRIBUTION (continued):**

	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7	2500.7
2.5°	2490.6	2490.6	2483.8	2480.4	2477.0	2473.6	2470.2	2466.8	2466.8	2470.2
5°	2470.2	2463.4	2449.9	2446.5	2436.3	2432.9	2426.1	2422.8	2426.1	2422.8
7.5°	2439.7	2426.1	2409.2	2402.4	2388.9	2382.2	2372.0	2372.0	2365.2	2368.6
10°	2399.0	2378.8	2358.5	2344.9	2334.7	2324.6	2317.8	2311.0	2307.6	2307.6
12.5°	2348.3	2324.6	2304.2	2283.9	2266.9	2260.1	2246.6	2246.6	2239.8	2236.4
15°	2290.7	2260.1	2236.4	2216.1	2202.5	2189.0	2178.8	2172.0	2165.2	2165.2
17.5°	2216.1	2189.0	2165.2	2141.5	2121.3	2111.1	2100.9	2090.8	2090.8	2084.0
20°	2134.7	2104.3	2084.0	2060.2	2043.3	2026.3	2012.8	2012.8	2006.0	2009.4
22.5°	2043.3	2006.0	1985.7	1968.7	1951.8	1938.2	1924.6	1924.6	1921.3	1917.9
25°	1941.6	1911.1	1887.4	1867.1	1857.0	1843.4	1840.0	1833.2	1829.8	1829.8
27.5°	1833.2	1809.5	1779.0	1768.8	1755.3	1748.5	1748.5	1745.1	1738.3	1741.7
30°	1718.0	1690.8	1673.9	1667.1	1653.6	1653.6	1650.2	1643.4	1643.4	1646.8
32.5°	1606.2	1579.1	1565.5	1562.1	1548.6	1548.6	1545.2	1548.6	1548.6	1552.0
35°	1484.2	1460.4	1457.0	1446.9	1443.5	1443.5	1443.5	1450.3	1457.0	1446.9
37.5°	1369.0	1352.1	1341.9	1338.5	1341.9	1341.9	1345.3	1355.5	1352.1	1348.7
40°	1250.4	1236.8	1230.0	1230.0	1236.8	1243.6	1243.6	1253.8	1257.1	1253.8
42.5°	1131.7	1121.7	1121.7	1125.0	1131.7	1135.1	1145.3	1155.4	1158.8	1162.2
45°	1020.0	1020.0	1020.0	1023.3	1026.7	1033.5	1047.1	1057.2	1060.6	1064.0
47.5°	911.5	908.1	918.2	921.6	931.8	935.2	945.4	958.9	962.3	965.7
50°	809.9	816.7	820.1	830.2	837.0	837.0	850.6	857.3	867.5	867.5
52.5°	715.0	725.1	728.5	738.7	742.1	745.5	752.3	762.4	769.2	769.2
55°	630.2	633.6	640.4	643.8	653.9	657.3	664.1	667.5	677.7	674.3
56°	593.0	599.8	603.2	610.0	616.8	620.2	626.9	630.2	637.0	640.4
57°	559.1	562.5	572.7	576.1	582.9	582.9	586.3	596.4	596.4	599.8
58°	525.2	532.0	535.4	538.8	545.6	549.0	555.7	559.1	562.5	559.1
59°	494.7	498.1	501.5	501.5	508.3	508.3	518.5	525.2	528.6	528.6
60°	464.2	464.2	467.6	471.0	477.8	481.2	481.2	487.9	487.9	487.9
61°	433.7	433.7	437.1	440.5	443.9	443.9	450.6	450.6	454.0	457.4
62°	406.6	403.2	403.2	406.6	406.6	413.4	416.7	420.1	423.5	420.1
63°	376.2	372.8	372.8	372.8	372.8	379.5	379.5	382.8	389.6	386.2
64°	342.3	342.3	342.3	342.3	345.7	345.7	352.5	355.8	359.2	362.6
65°	318.6	311.8	308.4	308.4	311.8	315.2	318.6	321.9	325.3	325.3
66°	291.4	284.7	281.3	281.3	281.3	281.3	288.0	288.0	294.8	294.8
67°	260.9	254.1	250.8	247.4	247.4	247.4	257.5	254.1	254.1	254.1
67.5°	250.8	240.6	237.2	233.8	230.4	237.2	233.8	237.2	237.2	233.8
68°	237.2	230.4	223.6	216.8	216.8	216.8	220.2	223.6	220.2	216.8
69°	210.1	206.7	196.5	189.7	186.3	189.7	186.3	189.7	186.3	189.7
70°	186.3	176.2	166.0	162.6	159.2	159.2	159.2	155.8	159.2	155.8
71°	162.6	152.4	142.3	135.5	132.1	132.1	128.7	132.1	128.7	132.1
72°	138.9	128.7	115.3	108.5	108.5	108.5	108.5	105.1	108.5	105.1
72.5°	128.7	115.3	105.1	98.3	94.9	94.9	94.9	94.9	91.5	94.9
73°	118.7	105.1	91.5	88.1	88.1	88.1	84.8	81.4	84.8	84.8





TEST NUMBER: P584804  
 CATALOG NUMBER: HCC8S50D010BZ-HM82555830-81RWWH

**CANDELA DISTRIBUTION (continued):**

	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
77.5°	40.7	30.5	27.1	27.1	27.1	27.1	27.1	27.1	23.7	23.7
80°	17.0	13.6	10.2	10.2	10.2	10.2	10.2	10.2	10.2	10.2
82.5°	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8
85°	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



74°	220.2	220.2	213.5	203.3	186.3	169.4	155.8	142.3	125.4	108.5	101.7
75°	203.3	199.9	193.1	182.9	169.4	152.4	138.9	122.0	108.5	91.5	84.8

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



74°	98.3	81.4	74.6	67.8	67.8	67.8	64.4	64.4	64.4	67.8
75°	78.0	64.4	57.6	50.9	54.2	50.9	54.2	50.9	50.9	50.9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)