

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584911

Luminaire Tested: **HCC8S50D010SL-HM82555940-81WDWB**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P584911  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-10)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8S50D010SL-HM82555940-81WDWB  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, WHITE BAFFLE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 6095.9 lumens  
Efficiency: N/A  
Efficacy: 127.0 lumens/watt  
Spacing Criteria (0/90/45): 1.32 / 1.32 / 1.14  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 48  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P584911  
CATALOG NUMBER: HCC8S50D010SL-HM82555940-81WDWB

### Luminous Intensity Polar Plot

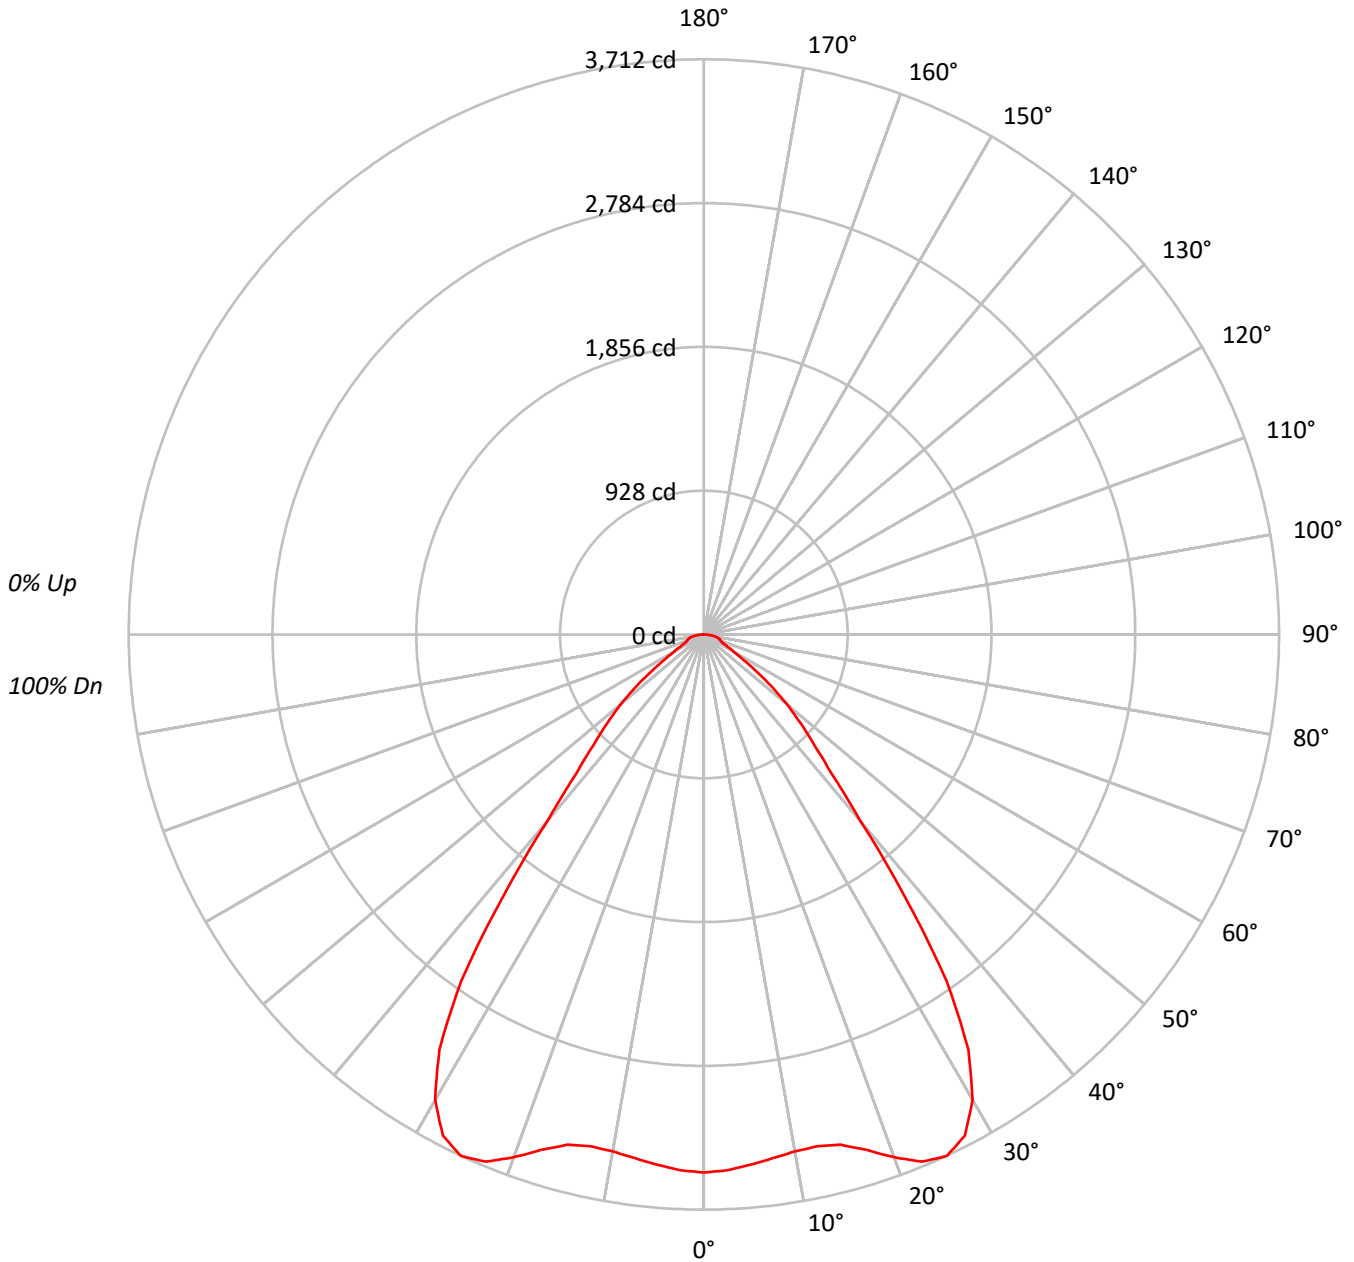

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P584911

CATALOG NUMBER: HCC8S50D010SL-HM82555940-81WDWB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	112	108	105	103	109	106	103	101	102	100	98	98	97	95	95	93	92	90				
2	105	99	94	89	102	97	92	88	93	90	86	90	87	84	88	85	83	81				
3	98	90	84	79	96	88	83	78	86	81	77	83	79	76	81	77	74	73				
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65				
5	86	75	68	63	84	74	68	63	73	67	62	71	66	62	69	65	61	59				
6	80	69	62	57	79	69	62	57	67	61	56	65	60	56	64	59	56	54				
7	75	64	57	52	74	63	57	52	62	56	51	61	55	51	59	55	51	49				
8	71	59	52	47	69	59	52	47	58	51	47	56	51	47	55	50	47	45				
9	67	55	48	43	65	55	48	43	54	47	43	53	47	43	52	47	43	41				
10	63	51	45	40	62	51	44	40	50	44	40	49	44	40	48	43	40	38				

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	107058
5°	106324
10°	106044
15°	108826
20°	117817
25°	126311
30°	123491
35°	102829
40°	63175
45°	43744
50°	33384
55°	21892
60°	13697
65°	10259
70°	10350
75°	11902
80°	13141
85°	11782



TEST NUMBER: P584911  
 CATALOG NUMBER: HCC8S50D010SL-HM82555940-81WDWB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	326.4	5.4
10°-20°	978.6	16.1
20°-30°	1684.7	27.6
30°-40°	1632.2	26.8
40°-50°	803.9	13.2
50°-60°	379.4	6.2
60°-70°	149.5	2.5
70°-80°	103.1	1.7
80°-90°	38.2	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2989.6	49.0
0°-40°	4621.8	75.8
0°-60°	5805.1	95.2
0°-90°	6095.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6095.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3472	
5°	3435	326
15°	3409	979
25°	3712	1685
35°	2732	1632
45°	1003	804
55°	407	379
65°	141	149
75°	100	103
85°	33	38
90°	0	



TEST NUMBER: P584911  
CATALOG NUMBER: HCC8S50D010SL-HM82555940-81WDWB

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3471.8
2.5°	3460.7
5°	3434.9
7.5°	3408.9
10°	3386.7
12.5°	3383.0
15°	3408.9
17.5°	3486.7
20°	3590.3
22.5°	3682.8
25°	3712.4
27.5°	3645.9
30°	3468.2
32.5°	3175.7
35°	2731.6
37.5°	2120.9
40°	1569.4
42.5°	1217.7
45°	1003.1
47.5°	843.9
50°	695.9
52.5°	547.8
55°	407.2
57.5°	296.1
60°	222.1
62.5°	173.9
65°	140.6
67.5°	122.2
70°	114.8
72.5°	107.3
75°	99.9
77.5°	88.8
80°	74.0
82.5°	55.5
85°	33.3
87.5°	14.8
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)