

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584994

Luminaire Tested: **HCC8W55D010SL-HM82555927-81WDH**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P584994
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-8)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W55D010SL-HM82555927-81WDH
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4657.9 lumens
Efficiency: N/A
Efficacy: 89.6 lumens/watt
Spacing Criteria (0/90/45): 1.12 / 1.12 / 1.06
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct

Input Watts (W): 52
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P584994
CATALOG NUMBER: HCC8W55D010SL-HM82555927-81WDH

Luminous Intensity Polar Plot

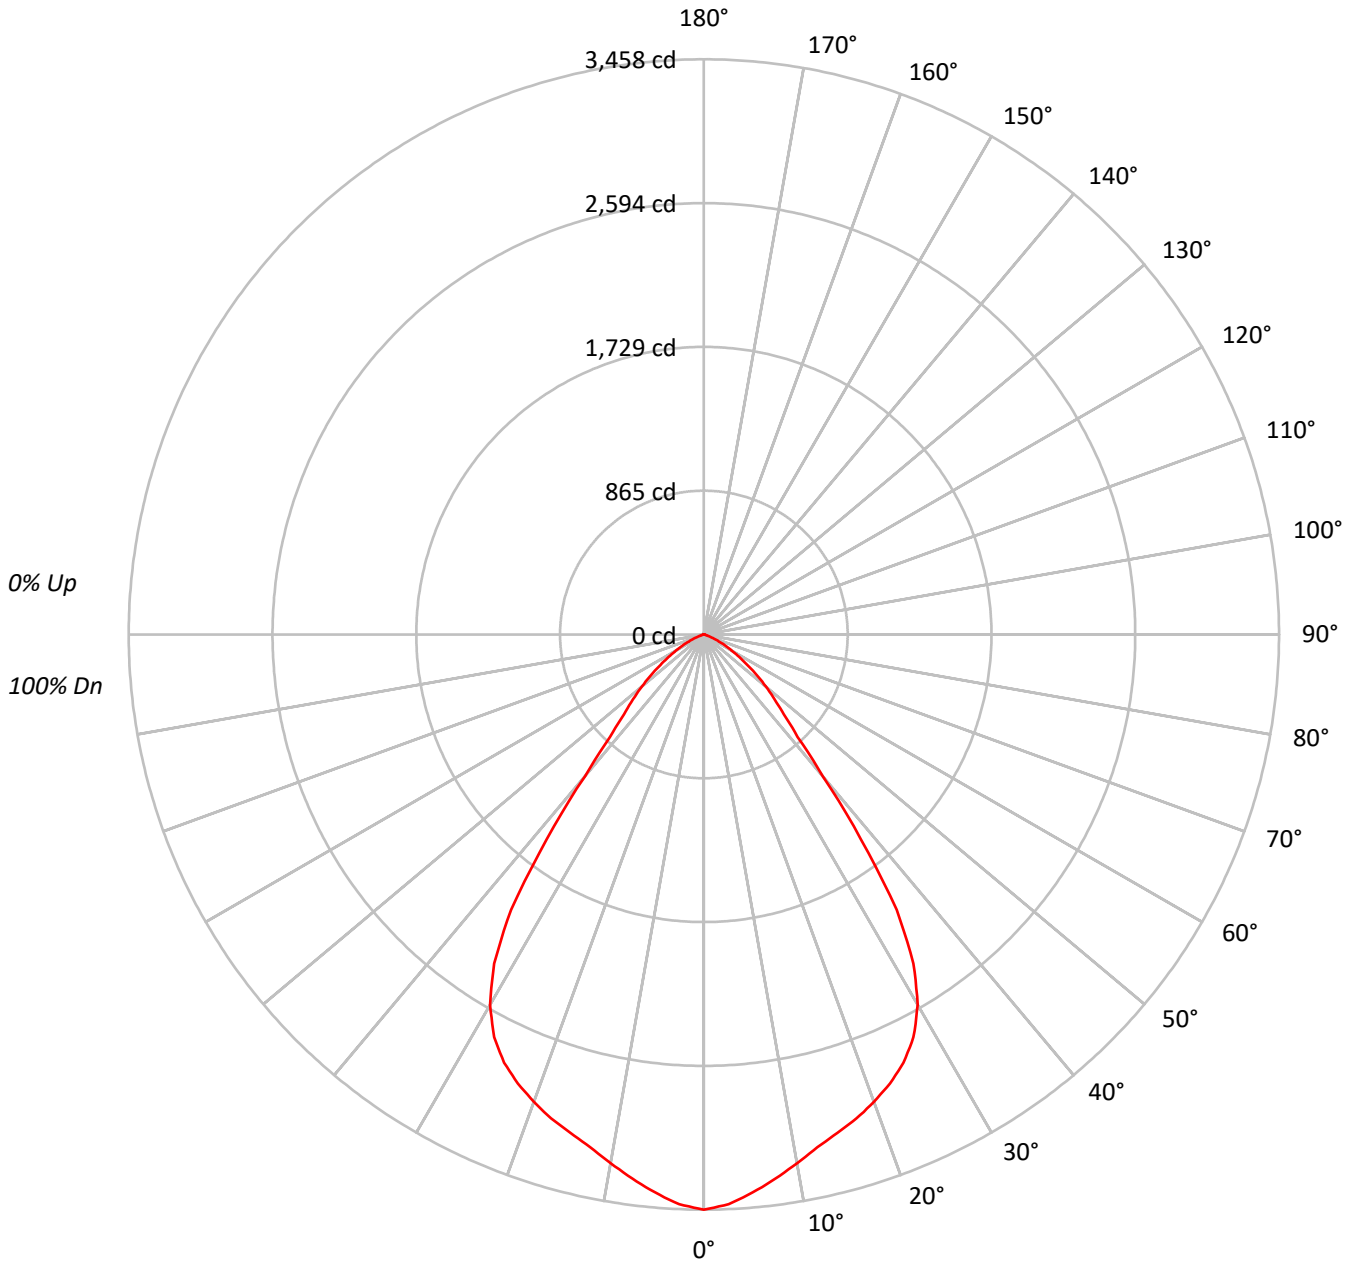

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P584994

CATALOG NUMBER: HCC8W55D010SL-HM82555927-81WDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	113	109	107	104	110	107	105	102	103	101	99	99	98	96	96	95	93	92				92
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83				83
3	99	92	86	81	97	90	85	81	88	83	79	85	81	78	83	80	77	75				75
4	93	84	78	73	91	83	77	72	81	76	72	79	74	71	77	73	70	68				68
5	87	78	71	66	86	77	70	66	75	69	65	73	68	64	71	67	64	62				62
6	82	72	65	60	80	71	64	60	69	64	59	68	63	59	66	62	58	57				57
7	77	67	60	55	76	66	59	55	64	59	54	63	58	54	62	57	54	52				52
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48				48
9	69	58	51	46	67	57	51	46	56	50	46	55	50	46	54	49	46	44				44
10	65	54	47	43	64	53	47	43	53	47	43	52	46	43	51	46	42	41				41

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	106638
5°	104235
10°	101041
15°	98997
20°	98108
25°	96639
30°	91541
35°	76056
40°	44791
45°	29624
50°	23315
55°	17155
60°	11921
65°	7260
70°	3174
75°	1394
80°	1048
85°	0



TEST NUMBER: P584994
 CATALOG NUMBER: HCC8W55D010SL-HM82555927-81WDH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	317.1	6.8
10°-20°	876.7	18.8
20°-30°	1298.9	27.9
30°-40°	1200.2	25.8
40°-50°	553.4	11.9
50°-60°	291.0	6.2
60°-70°	102.9	2.2
70°-80°	16.2	0.3
80°-90°	1.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2492.6	53.5
0°-40°	3692.8	79.3
0°-60°	4537.3	97.4
0°-90°	4657.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4657.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3458	
5°	3367	317
15°	3101	877
25°	2840	1299
35°	2020	1200
45°	679	553
55°	319	291
65°	100	103
75°	12	16
85°	0	2
90°	0	



TEST NUMBER: P584994
CATALOG NUMBER: HCC8W55D010SL-HM82555927-81WDH

CANDELA DISTRIBUTION (FULL):

0°	
0°	3458.2
2.5°	3428.9
5°	3367.4
7.5°	3300.0
10°	3226.9
12.5°	3156.5
15°	3101.0
17.5°	3051.2
20°	2989.7
22.5°	2922.3
25°	2840.3
27.5°	2729.0
30°	2570.9
32.5°	2345.5
35°	2020.4
37.5°	1552.0
40°	1112.7
42.5°	834.6
45°	679.3
47.5°	576.9
50°	486.0
52.5°	398.2
55°	319.1
57.5°	251.9
60°	193.3
62.5°	146.4
65°	99.5
67.5°	58.6
70°	35.2
72.5°	20.5
75°	11.7
77.5°	8.8
80°	5.9
82.5°	2.9
85°	0.0
87.5°	0.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)