

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P585069

Luminaire Tested: **HCC8S60D010MW-HM86080830-81MDH**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P585069
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-5)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8S60D010MW-HM86080830-81MDH
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" MEDIUM DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5112.4 lumens
Efficiency: N/A
Efficacy: 91.3 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.81
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct

Input Watts (W): 56
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P585069
CATALOG NUMBER: HCC8S60D010MW-HM86080830-81MDH

Luminous Intensity Polar Plot

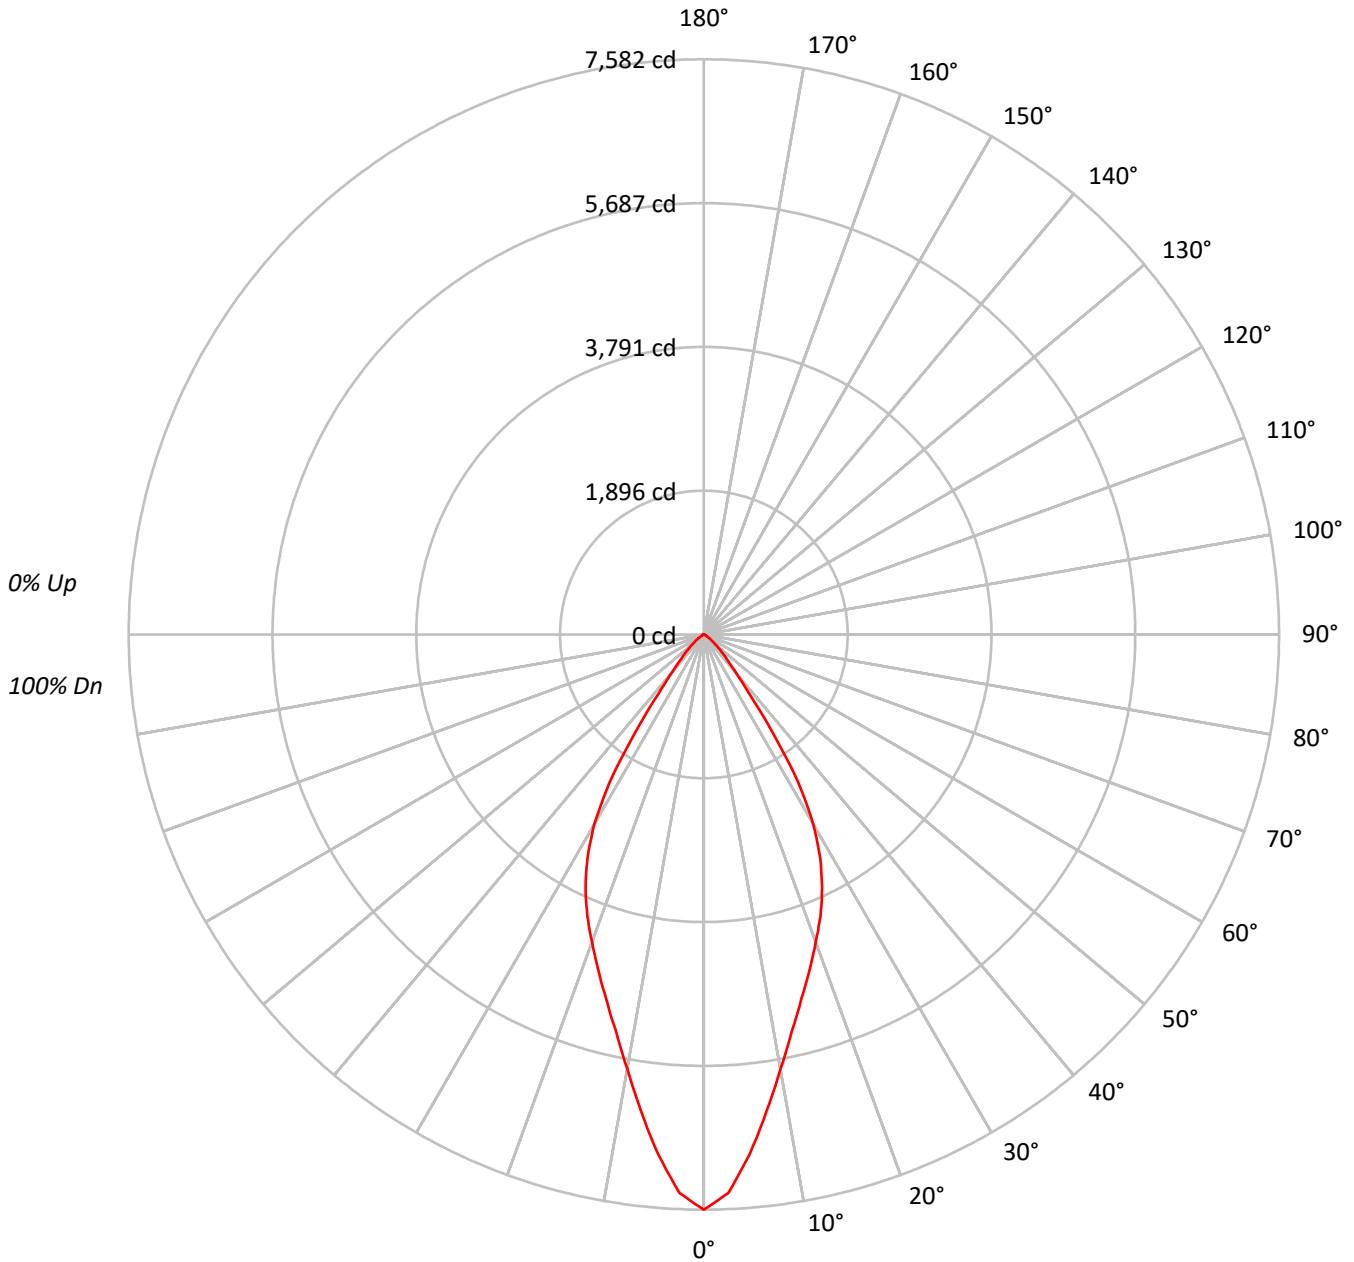

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P585069

CATALOG NUMBER: HCC8S60D010MW-HM86080830-81MDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									20																	
RC	80									70									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																								
RCR																																																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																																				
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																																				
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	90	89	87																																				
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81																																				
4	97	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76																																				
5	93	84	79	74	91	83	78	74	82	77	73	80	76	73	78	75	72	71																																				
6	88	79	73	69	87	78	73	69	77	72	68	76	71	68	74	70	67	66																																				
7	84	75	69	64	82	74	68	64	73	68	64	71	67	64	70	66	63	62																																				
8	80	70	64	60	79	70	64	60	69	64	60	68	63	60	67	63	60	58																																				
9	76	67	61	57	75	66	61	57	65	60	56	64	60	56	63	59	56	55																																				
10	73	63	57	54	72	63	57	53	62	57	53	61	56	53	60	56	53	52																																				

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	233804
5°	213057
10°	182039
15°	158752
20°	141496
25°	125512
30°	102768
35°	59011
40°	26189
45°	15241
50°	8798
55°	5021
60°	2775
65°	1766
70°	1244
75°	822
80°	622
85°	1238



TEST NUMBER: P585069
 CATALOG NUMBER: HCC8S60D010MW-HM86080830-81MDH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	623.1	12.2
10°-20°	1397.8	27.3
20°-30°	1673.2	32.7
30°-40°	1012.2	19.8
40°-50°	283.7	5.5
50°-60°	88.1	1.7
60°-70°	25.1	0.5
70°-80°	6.8	0.1
80°-90°	2.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3694.1	72.3
0°-40°	4706.3	92.1
0°-60°	5078.1	99.3
0°-90°	5112.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5112.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7582	
5°	6883	623
15°	4973	1398
25°	3689	1673
35°	1568	1012
45°	350	284
55°	93	88
65°	24	25
75°	7	7
85°	4	2
90°	0	



TEST NUMBER: P585069
CATALOG NUMBER: HCC8S60D010MW-HM86080830-81MDH

CANDELA DISTRIBUTION (FULL):

0°	
0°	7582.1
2.5°	7367.5
5°	6883.0
7.5°	6336.3
10°	5813.7
12.5°	5357.0
15°	4972.8
17.5°	4633.7
20°	4311.9
22.5°	4014.3
25°	3688.9
27.5°	3322.1
30°	2886.2
32.5°	2322.0
35°	1567.6
37.5°	975.9
40°	650.6
42.5°	467.1
45°	349.5
47.5°	256.1
50°	183.4
52.5°	128.0
55°	93.4
57.5°	62.3
60°	45.0
62.5°	31.1
65°	24.2
67.5°	17.3
70°	13.8
72.5°	6.9
75°	6.9
77.5°	3.5
80°	3.5
82.5°	3.5
85°	3.5
87.5°	0.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)