

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P585073

Luminaire Tested: **HCC8S60D010BZ-HM86080830-81NDW**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P585073
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-3)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8S60D010BZ-HM86080830-81NDW
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" NARROW DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4634.8 lumens
Efficiency: N/A
Efficacy: 82.8 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 0.92
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct

Input Watts (W): 56
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P585073
CATALOG NUMBER: HCC8S60D010BZ-HM86080830-81NDW

Luminous Intensity Polar Plot

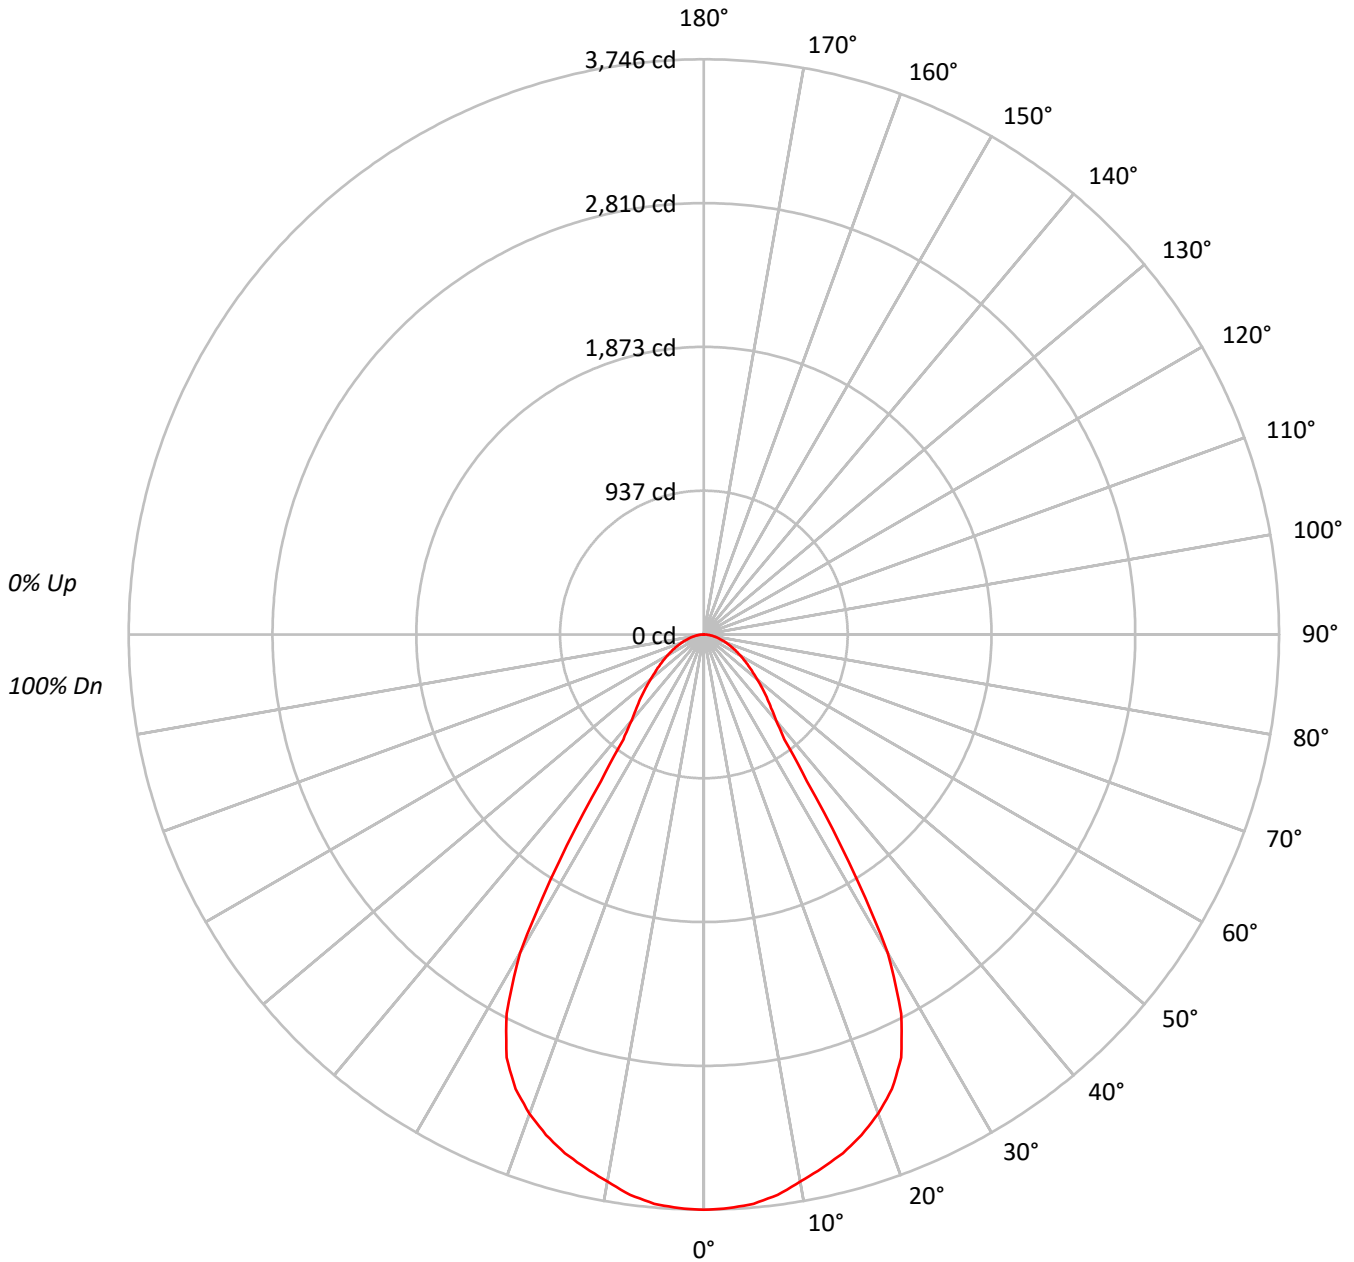



TEST NUMBER: P585073

CATALOG NUMBER: HCC8S60D010BZ-HM86080830-81NDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									20								
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR	0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100	100	100	100	100	100	100	100																
	1	112	108	105	102	109	106	103	101	102	100	98	98	96	95	95	93	92	90	90	90	90	90	90	90	90	90	90	90																
	2	105	99	94	90	102	97	92	88	94	90	87	91	87	85	88	85	83	81	81	81	81	81	81	81	81	81	81	81																
	3	98	90	84	79	96	89	83	79	86	81	77	84	80	76	81	78	75	73	73	73	73	73	73	73	73	73	73	73																
	4	92	83	76	71	90	82	76	71	80	74	70	77	73	69	75	72	68	67	67	67	67	67	67	67	67	67	67	67																
	5	87	77	70	65	85	76	69	64	74	68	64	72	67	63	70	66	63	61	61	61	61	61	61	61	61	61	61	61																
	6	82	71	64	59	80	70	64	59	69	63	58	67	62	58	66	61	58	56	56	56	56	56	56	56	56	56	56	56																
	7	77	66	59	54	76	66	59	54	64	58	54	63	58	54	62	57	53	52	52	52	52	52	52	52	52	52	52	52																
	8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48	48	48	48	48	48	48	48	48	48	48																
	9	69	58	51	47	68	57	51	47	56	51	46	55	50	46	55	50	46	45	45	45	45	45	45	45	45	45	45	45																
	10	65	55	48	44	64	54	48	44	53	47	43	52	47	43	52	47	43	42	42	42	42	42	42	42	42	42	42	42																

AVERAGE LUMINANCE (cd/sqm):

	0°	115525
	5°	115214
	10°	113293
	15°	111642
	20°	108963
	25°	103433
	30°	85314
	35°	43927
	40°	29410
	45°	25215
	50°	21760
	55°	18989
	60°	16874
	65°	15155
	70°	13740
	75°	12379
	80°	11063
	85°	11003



TEST NUMBER: P585073
 CATALOG NUMBER: HCC8S60D010BZ-HM86080830-81NDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	351.9	7.6
10°-20°	983.9	21.2
20°-30°	1363.2	29.4
30°-40°	818.8	17.7
40°-50°	448.3	9.7
50°-60°	318.5	6.9
60°-70°	206.7	4.5
70°-80°	110.5	2.4
80°-90°	32.9	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2699.1	58.2
0°-40°	3517.9	75.9
0°-60°	4284.6	92.4
0°-90°	4634.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4634.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3746	
5°	3722	352
15°	3497	984
25°	3040	1363
35°	1167	819
45°	578	448
55°	353	318
65°	208	207
75°	104	110
85°	31	33
90°	0	



TEST NUMBER: P585073
CATALOG NUMBER: HCC8S60D010BZ-HM86080830-81NDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3746.4
2.5°	3739.4
5°	3722.1
7.5°	3680.6
10°	3618.2
12.5°	3559.4
15°	3497.1
17.5°	3417.4
20°	3320.5
22.5°	3202.8
25°	3040.0
27.5°	2783.8
30°	2396.0
32.5°	1755.5
35°	1166.9
37.5°	862.2
40°	730.6
42.5°	647.5
45°	578.2
47.5°	512.5
50°	453.6
52.5°	398.2
55°	353.2
57.5°	311.6
60°	273.6
62.5°	238.9
65°	207.7
67.5°	176.6
70°	152.4
72.5°	124.7
75°	103.9
77.5°	83.0
80°	62.3
82.5°	45.0
85°	31.1
87.5°	13.8
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)