

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P585070

Luminaire Tested: **HCC8W60D010MW-HM86080830-81MDW**

Issue Date: 10/21/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P585070  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-6)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 10/21/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC8W60D010MW-HM86080830-81MDW  
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" MEDIUM DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 5126.2 lumens  
Efficiency: N/A  
Efficacy: 91.5 lumens/watt  
Spacing Criteria (0/90/45): 1 / 1 / 0.95  
Luminous Opening: Circular (Dia: 0.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 56  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P585070  
CATALOG NUMBER: HCC8W60D010MW-HM86080830-81MDW

### Luminous Intensity Polar Plot

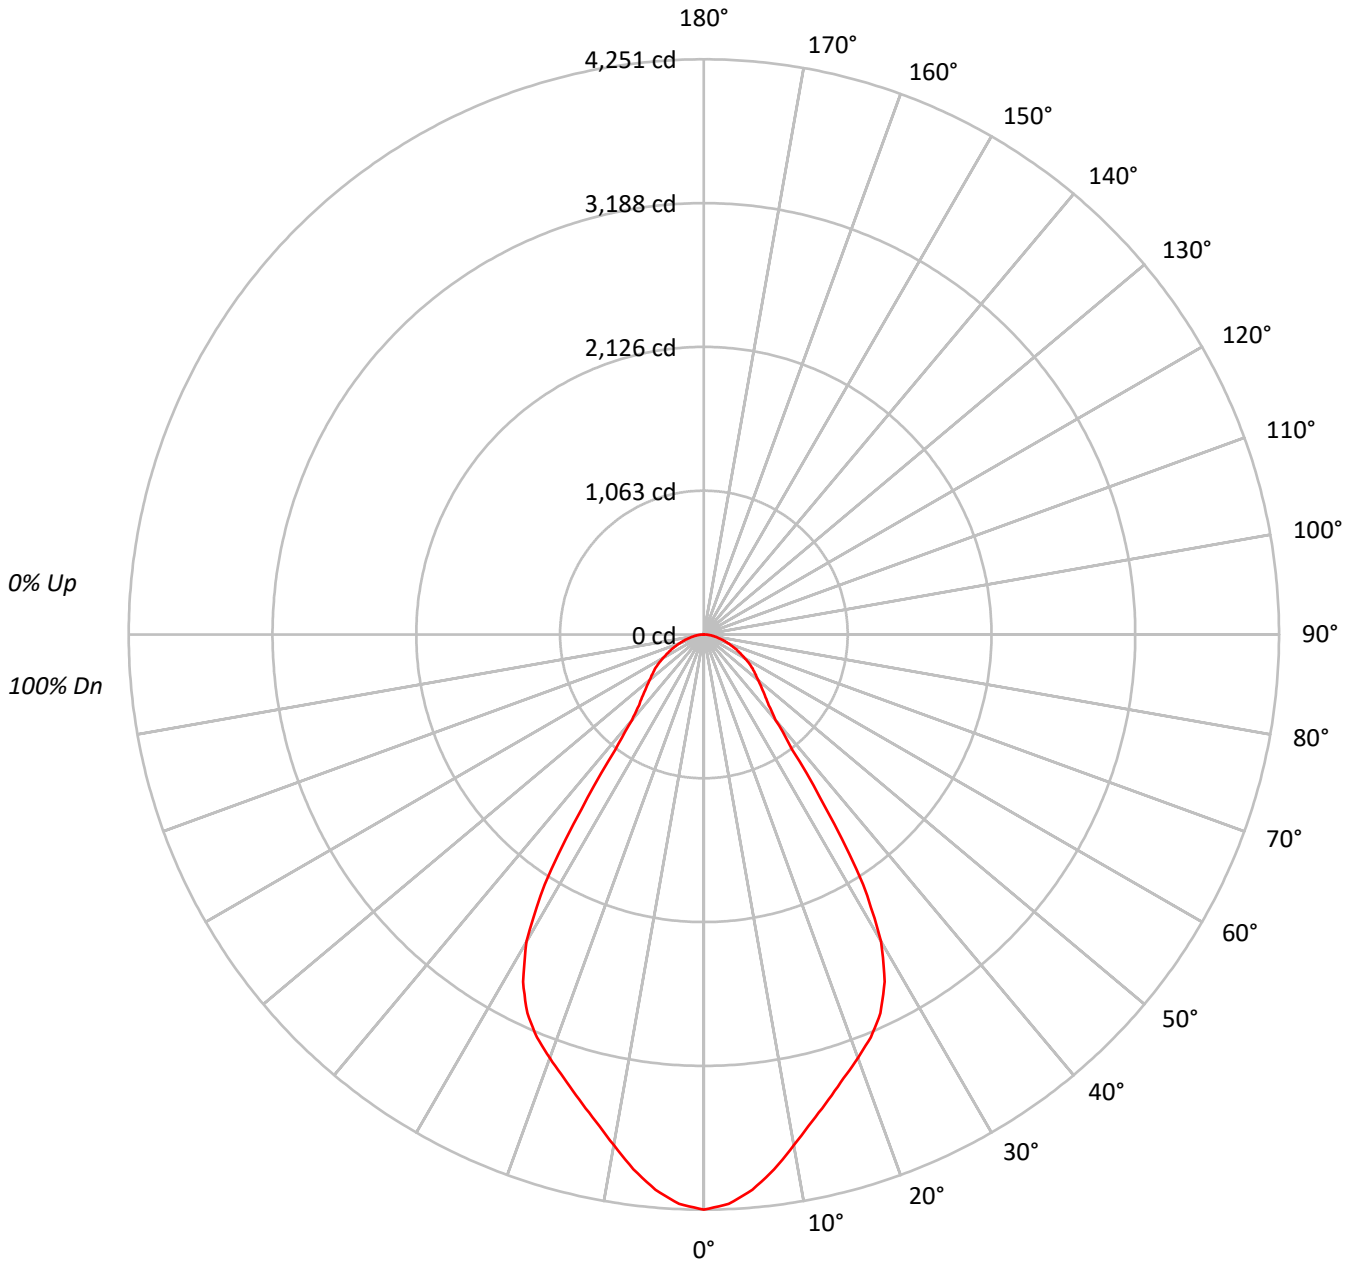

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P585070

CATALOG NUMBER: HCC8W60D010MW-HM86080830-81MDW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	92	90	90	90	90
2	104	98	93	89	102	96	92	88	93	89	86	90	87	84	87	84	82	80	80	80	80
3	98	89	83	78	95	88	82	78	85	80	76	83	78	75	80	77	74	72	72	72	72
4	91	82	75	70	89	81	74	69	78	73	69	76	72	68	74	70	67	65	65	65	65
5	86	76	68	63	84	75	68	63	73	67	62	71	66	62	69	65	61	59	59	59	59
6	81	70	63	58	79	69	62	57	67	61	57	66	61	56	64	60	56	54	54	54	54
7	76	65	58	53	74	64	57	53	63	57	52	62	56	52	60	55	52	50	50	50	50
8	72	61	54	49	70	60	53	49	59	53	48	58	52	48	57	52	48	46	46	46	46
9	68	57	50	45	67	56	50	45	55	49	45	54	49	45	53	48	45	43	43	43	43
10	64	53	46	42	63	53	46	42	52	46	42	51	46	42	50	45	42	40	40	40	40

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	131076
5°	127509
10°	119985
15°	113602
20°	109275
25°	105056
30°	93304
35°	59418
40°	33165
45°	27775
50°	25075
55°	23634
60°	21561
65°	19452
70°	17166
75°	15250
80°	13514
85°	12242



TEST NUMBER: P585070  
 CATALOG NUMBER: HCC8W60D010MW-HM86080830-81MDW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	384.0	7.5
10°-20°	1003.6	19.6
20°-30°	1400.1	27.3
30°-40°	1007.4	19.7
40°-50°	499.2	9.7
50°-60°	390.6	7.6
60°-70°	264.5	5.2
70°-80°	137.3	2.7
80°-90°	39.5	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2787.6	54.4
0°-40°	3795.0	74.0
0°-60°	4684.9	91.4
0°-90°	5126.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5126.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4251	
5°	4119	384
15°	3558	1004
25°	3088	1400
35°	1578	1007
45°	637	499
55°	440	391
65°	267	264
75°	128	137
85°	35	40
90°	0	



TEST NUMBER: P585070  
CATALOG NUMBER: HCC8W60D010MW-HM86080830-81MDW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4250.7
2.5°	4212.7
5°	4119.3
7.5°	3987.6
10°	3831.9
12.5°	3686.5
15°	3558.5
17.5°	3437.2
20°	3330.0
22.5°	3222.7
25°	3087.7
27.5°	2893.9
30°	2620.4
32.5°	2191.1
35°	1578.4
37.5°	1076.6
40°	823.9
42.5°	709.6
45°	636.9
47.5°	574.6
50°	522.7
52.5°	477.7
55°	439.6
57.5°	394.6
60°	349.6
62.5°	304.6
65°	266.6
67.5°	228.5
70°	190.4
72.5°	159.3
75°	128.0
77.5°	100.3
80°	76.1
82.5°	55.4
85°	34.6
87.5°	17.3
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)