

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P585298

Luminaire Tested: **HCC8W80D010MW-HM86080935-81WDBB**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P585298
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-11)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W80D010MW-HM86080935-81WDBB
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, BLACK BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6609.6 lumens
Efficiency: N/A
Efficacy: 94.4 lumens/watt
Spacing Criteria (0/90/45): 1.32 / 1.32 / 1.13
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct

Input Watts (W): 70
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P585298
CATALOG NUMBER: HCC8W80D010MW-HM86080935-81WDBB

Luminous Intensity Polar Plot

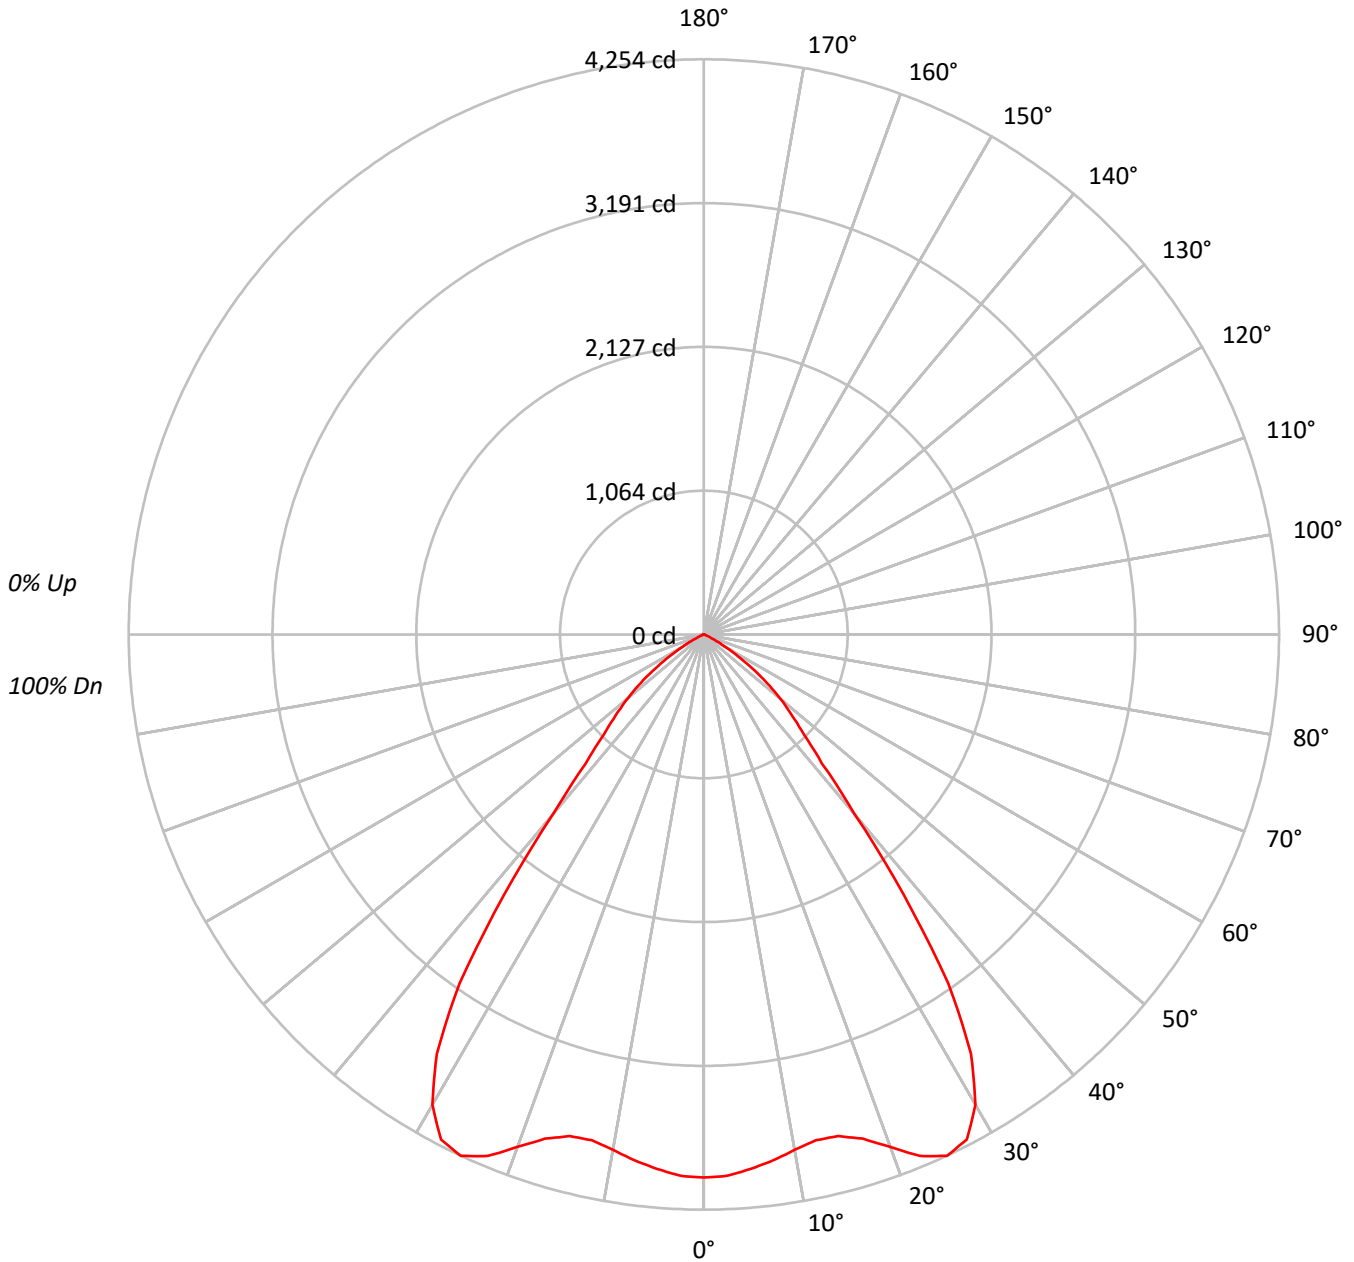

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P585298

CATALOG NUMBER: HCC8W80D010MW-HM86080935-81WDBB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	109	107	104	110	107	105	102	103	101	99	99	98	96	96	95	93	92			
2	106	100	95	92	104	98	94	91	95	92	89	92	89	87	89	87	85	83			
3	99	92	86	81	97	90	85	81	88	83	79	85	81	78	83	80	77	75			
4	93	84	78	73	91	83	77	72	81	76	71	79	74	71	77	73	70	68			
5	87	77	71	66	85	76	70	65	74	69	65	73	68	64	71	67	63	62			
6	82	71	64	59	80	70	64	59	69	63	59	67	62	58	66	61	58	56			
7	77	66	59	54	75	65	59	54	64	58	54	63	57	53	61	57	53	51			
8	72	61	54	49	71	61	54	49	59	53	49	58	53	49	57	52	49	47			
9	68	57	50	45	67	56	50	45	55	49	45	54	49	45	53	48	45	43			
10	64	53	46	42	63	53	46	42	52	46	42	51	45	42	50	45	41	40			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	123842
5°	122814
10°	121190
15°	122573
20°	132367
25°	144752
30°	143000
35°	118621
40°	69816
45°	45615
50°	35361
55°	23494
60°	11434
65°	3539
70°	1190
75°	1048
80°	781
85°	1557



TEST NUMBER: P585298
 CATALOG NUMBER: HCC8W80D010MW-HM86080935-81WDBB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	375.7	5.7
10°-20°	1103.0	16.7
20°-30°	1928.6	29.2
30°-40°	1876.1	28.4
40°-50°	853.2	12.9
50°-60°	395.6	6.0
60°-70°	66.3	1.0
70°-80°	8.1	0.1
80°-90°	3.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3407.4	51.6
0°-40°	5283.5	79.9
0°-60°	6532.2	98.8
0°-90°	6609.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6609.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4016	
5°	3968	376
15°	3840	1103
25°	4254	1929
35°	3151	1876
45°	1046	853
55°	437	396
65°	48	66
75°	9	8
85°	4	3
90°	0	



TEST NUMBER: P585298
CATALOG NUMBER: HCC8W80D010MW-HM86080935-81WDBB

CANDELA DISTRIBUTION (FULL):

	0°
0°	4016.1
2.5°	4007.3
5°	3967.6
7.5°	3923.3
10°	3870.4
12.5°	3830.7
15°	3839.5
17.5°	3910.1
20°	4033.7
22.5°	4174.9
25°	4254.4
27.5°	4210.2
30°	4016.1
32.5°	3676.3
35°	3151.1
37.5°	2427.3
40°	1734.4
42.5°	1293.0
45°	1046.0
47.5°	882.6
50°	737.1
52.5°	587.0
55°	437.0
57.5°	300.1
60°	185.4
62.5°	101.5
65°	48.5
67.5°	22.1
70°	13.2
72.5°	8.8
75°	8.8
77.5°	4.4
80°	4.4
82.5°	4.4
85°	4.4
87.5°	0.0
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)