

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P885617

Luminaire Tested: ML104LSFL95FS1E-TIR1D25NFL-TL1RDMB-340LM-5000K

Issue Date: 7/18/2024

Test Information

Test Method: LM-79-2019
Report Number: P885617
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-120)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/18/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML104LSFL95FS1E-TIR1D25NFL-TL1RDMB-340LM-5000K
Description: 1IN ROUND ML FLEX, SELECTABLE CCT, WITH 25D TIR, MATTE BLACK TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 269.1 lumens
Efficiency: N/A
Efficacy: 44.1 lumens/watt
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.48
Luminous Opening: Circular (Dia: 0.08' x H: 0')
CIE Type: Direct

Input Watts (W): 6.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P885617
CATALOG NUMBER: ML104LSFL95FS1E-TIR1D25NFL-TL1RDMB-340LM-5000K

Luminous Intensity Polar Plot

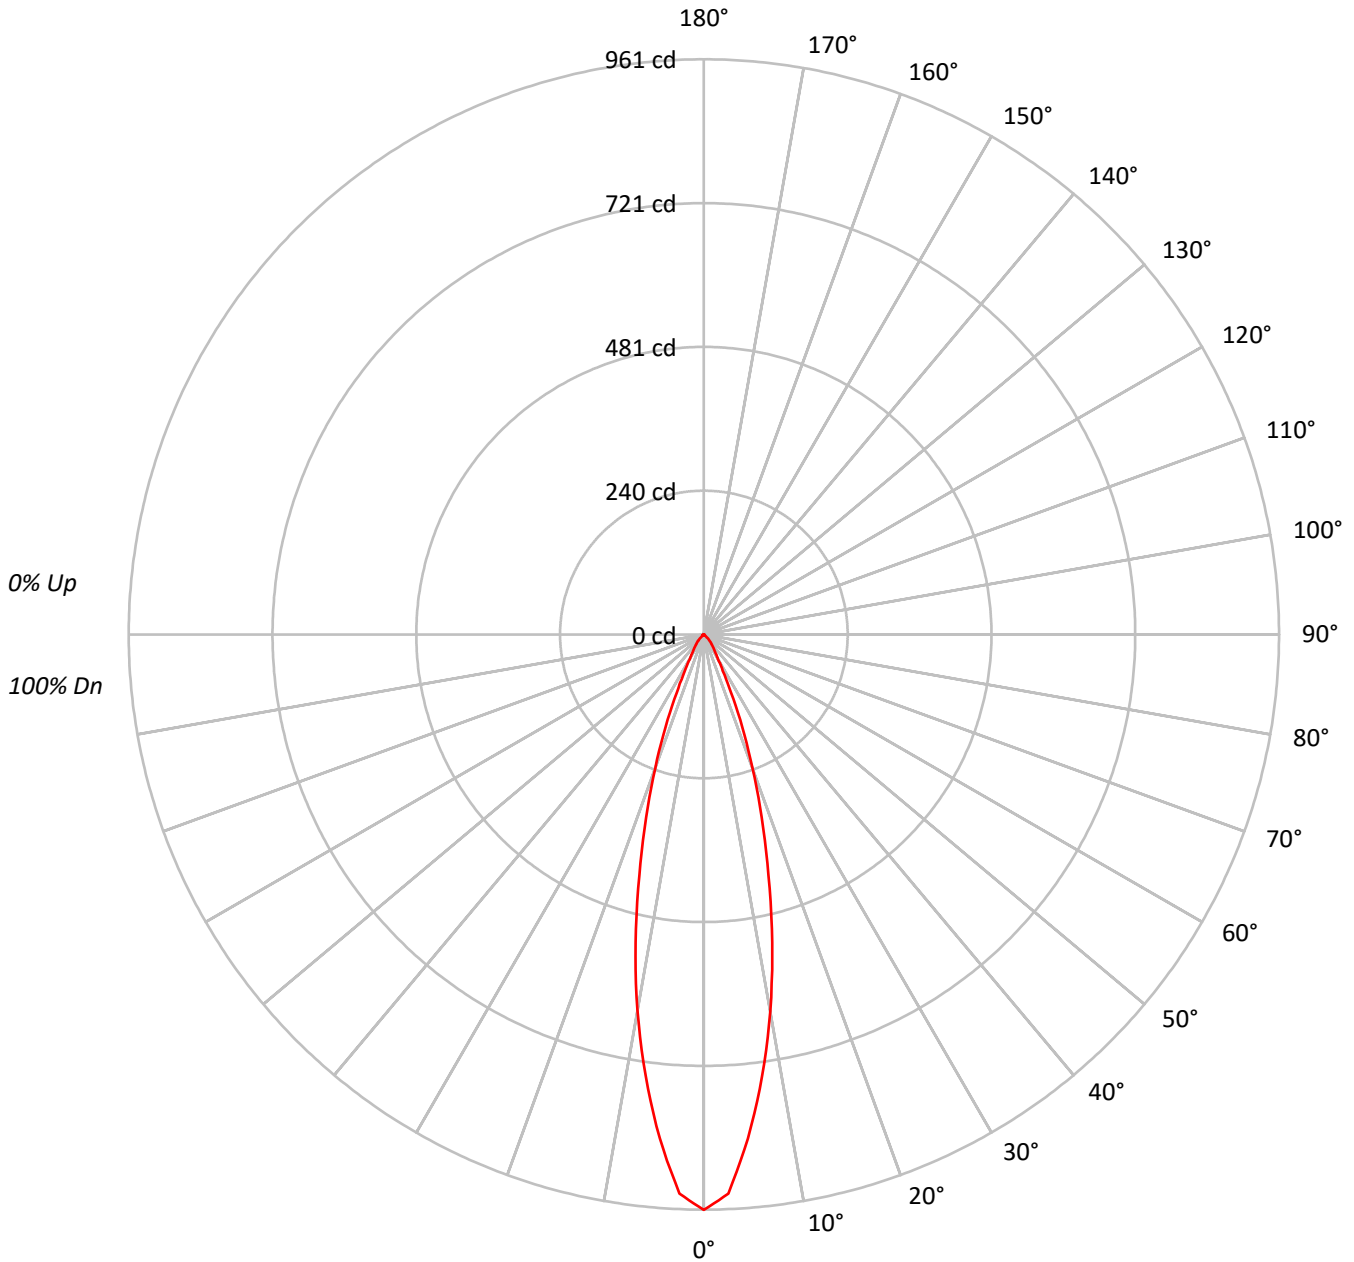



TEST NUMBER: P885617

CATALOG NUMBER: ML104LSFL95FS1E-TIR1D25NFL-TL1RDMB-340LM-5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									20								
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																											
1	115	112	110	108	112	110	108	107	106	105	104	103	101	100	99	98	98	96																											
2	110	107	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92																											
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88																											
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84																											
5	99	93	88	85	98	92	87	84	90	86	84	88	85	83	87	84	82	81																											
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78																											
7	92	85	81	77	91	85	80	77	84	80	77	83	79	77	82	78	76	75																											
8	89	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72																											
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70																											
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68																											

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1897363
5°	1674805
10°	1280347
15°	850159
20°	497747
25°	232564
30°	106650
35°	68664
40°	47146
45°	25677
50°	6141
55°	3441
60°	3947
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 25677 cd/sqm



TEST NUMBER: P885617

CATALOG NUMBER: ML104LSFL95FS1E-TIR1D25NFL-TL1RDDB-340LM-5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	74.2	27.6
10°-20°	114.7	42.6
20°-30°	53.4	19.8
30°-40°	18.4	6.8
40°-50°	6.9	2.6
50°-60°	1.2	0.5
60°-70°	0.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	242.3	90.0
0°-40°	260.6	96.8
0°-60°	268.8	99.9
0°-90°	269.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	269.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	961	
5°	845	74
15°	416	115
25°	107	53
35°	28	18
45°	9	7
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P885617
CATALOG NUMBER: ML104LSFL95FS1E-TIR1D25NFL-TL1RDMB-340LM-5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	961.4
2.5°	934.9
5°	845.4
7.5°	744.7
10°	638.9
12.5°	527.0
15°	416.1
17.5°	320.5
20°	237.0
22.5°	166.8
25°	106.8
27.5°	68.2
30°	46.8
32.5°	35.6
35°	28.5
37.5°	22.4
40°	18.3
42.5°	14.2
45°	9.2
47.5°	3.1
50°	2.0
52.5°	2.0
55°	1.0
57.5°	1.0
60°	1.0
62.5°	1.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)