

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P885805

Luminaire Tested: ML104LSFL9FS1E-TIR1D25NFL-TL1RDMB-200LM-3500K

Issue Date: 7/18/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P885805  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-120)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 7/18/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: HALO  
Catalog Number: ML104LSFL9FS1E-TIR1D25NFL-TL1RDMB-200LM-3500K  
Description: 1IN ROUND ML FLEX, SELECTABLE CCT, WITH 25D TIR, MATTE BLACK TRIM  
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 126.7 lumens  
Efficiency: N/A  
Efficacy: 38.4 lumens/watt  
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.48  
Luminous Opening: Circular (Dia: 0.08' x H: 0')  
CIE Type: Direct


Input Watts (W): 3.3  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P885805

CATALOG NUMBER: ML104LSFL9FS1E-TIR1D25NFL-TL1RDMB-200LM-3500K

### Luminous Intensity Polar Plot

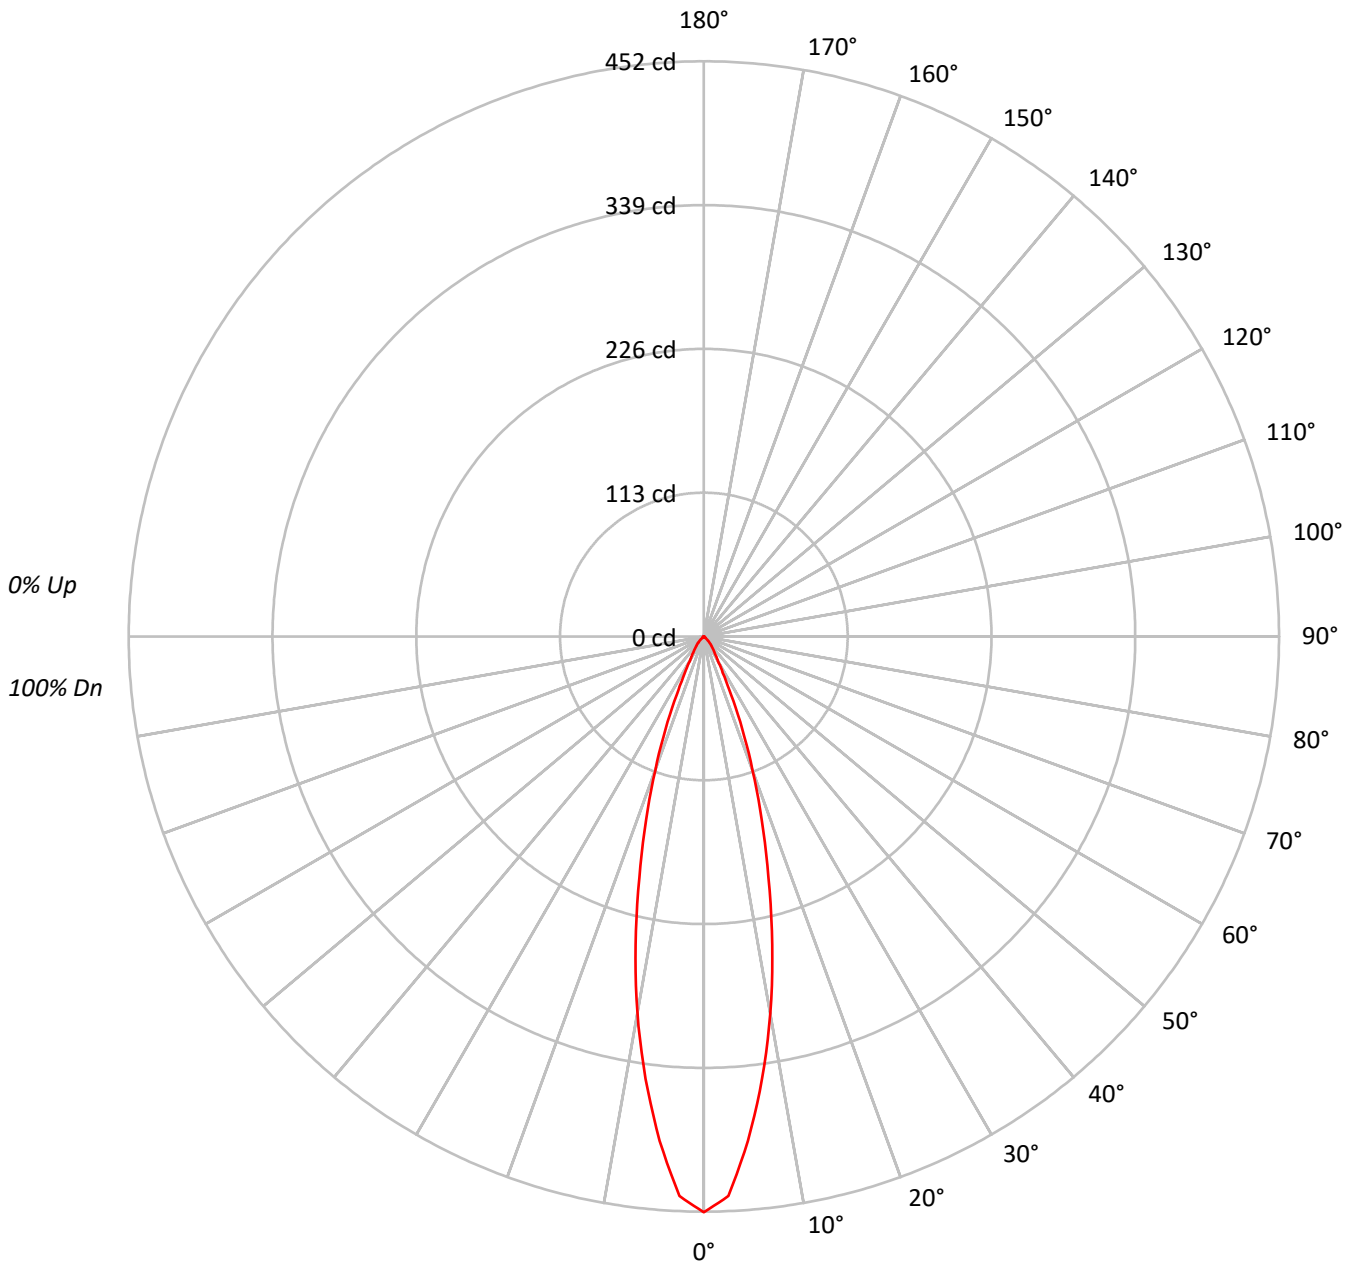



TEST NUMBER: P885805

CATALOG NUMBER: ML104LSFL9FS1E-TIR1D25NFL-TL1RDDB-200LM-3500K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	112	110	108	112	110	108	107	106	105	104	103	101	100	99	98	98	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92
3	106	101	97	94	105	100	96	93	97	94	92	95	93	91	93	91	89	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84
5	99	93	88	85	98	92	87	84	90	86	84	88	85	83	87	84	82	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78
7	92	85	81	77	91	85	80	77	84	80	77	83	79	77	82	78	76	75
8	89	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	893028
5°	788272
10°	602599
15°	400051
20°	234382
25°	109531
30°	50135
35°	32284
40°	22156
45°	12001
50°	3070
55°	1720
60°	1974
65°	0
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 12001 cd/sqm



TEST NUMBER: P885805

CATALOG NUMBER: ML104LSFL9FS1E-TIR1D25NFL-TL1RDMB-200LM-3500K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	34.9	27.6
10°-20°	54.0	42.6
20°-30°	25.1	19.8
30°-40°	8.6	6.8
40°-50°	3.2	2.6
50°-60°	0.6	0.5
60°-70°	0.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	114.0	90.0
0°-40°	122.7	96.8
0°-60°	126.5	99.9
0°-90°	126.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	126.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	452	
5°	398	35
15°	196	54
25°	50	25
35°	13	9
45°	4	3
55°	0	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P885805

CATALOG NUMBER: ML104LSFL9FS1E-TIR1D25NFL-TL1RDMB-200LM-3500K

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	452.5
2.5°	440.1
5°	397.9
7.5°	350.5
10°	300.7
12.5°	248.0
15°	195.8
17.5°	150.8
20°	111.6
22.5°	78.5
25°	50.3
27.5°	32.1
30°	22.0
32.5°	16.8
35°	13.4
37.5°	10.5
40°	8.6
42.5°	6.7
45°	4.3
47.5°	1.4
50°	1.0
52.5°	1.0
55°	0.5
57.5°	0.5
60°	0.5
62.5°	0.5
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)