

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P885950

Luminaire Tested: ML104LSFL9FS1E-TIR1D55WFL-TL1RDSL-400LM-3500K

Issue Date: 6/19/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P885950  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-131)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 6/19/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: HALO  
Catalog Number: ML104LSFL9FS1E-TIR1D55WFL-TL1RDSL-400LM-3500K  
Description: 1IN ROUND ML FLEX, SELECTABLE CCT, WITH 55D TIR, METALLIC SILVER TRIM  
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 427.8 lumens  
Efficiency: N/A  
Efficacy: 71.3 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.77  
Luminous Opening: Circular (Dia: 0.08' x H: 0')  
CIE Type: Direct

Input Watts (W): 6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P885950  
CATALOG NUMBER: ML104LSFL9FS1E-TIR1D55WFL-TL1RDSL-400LM-3500K

### Luminous Intensity Polar Plot

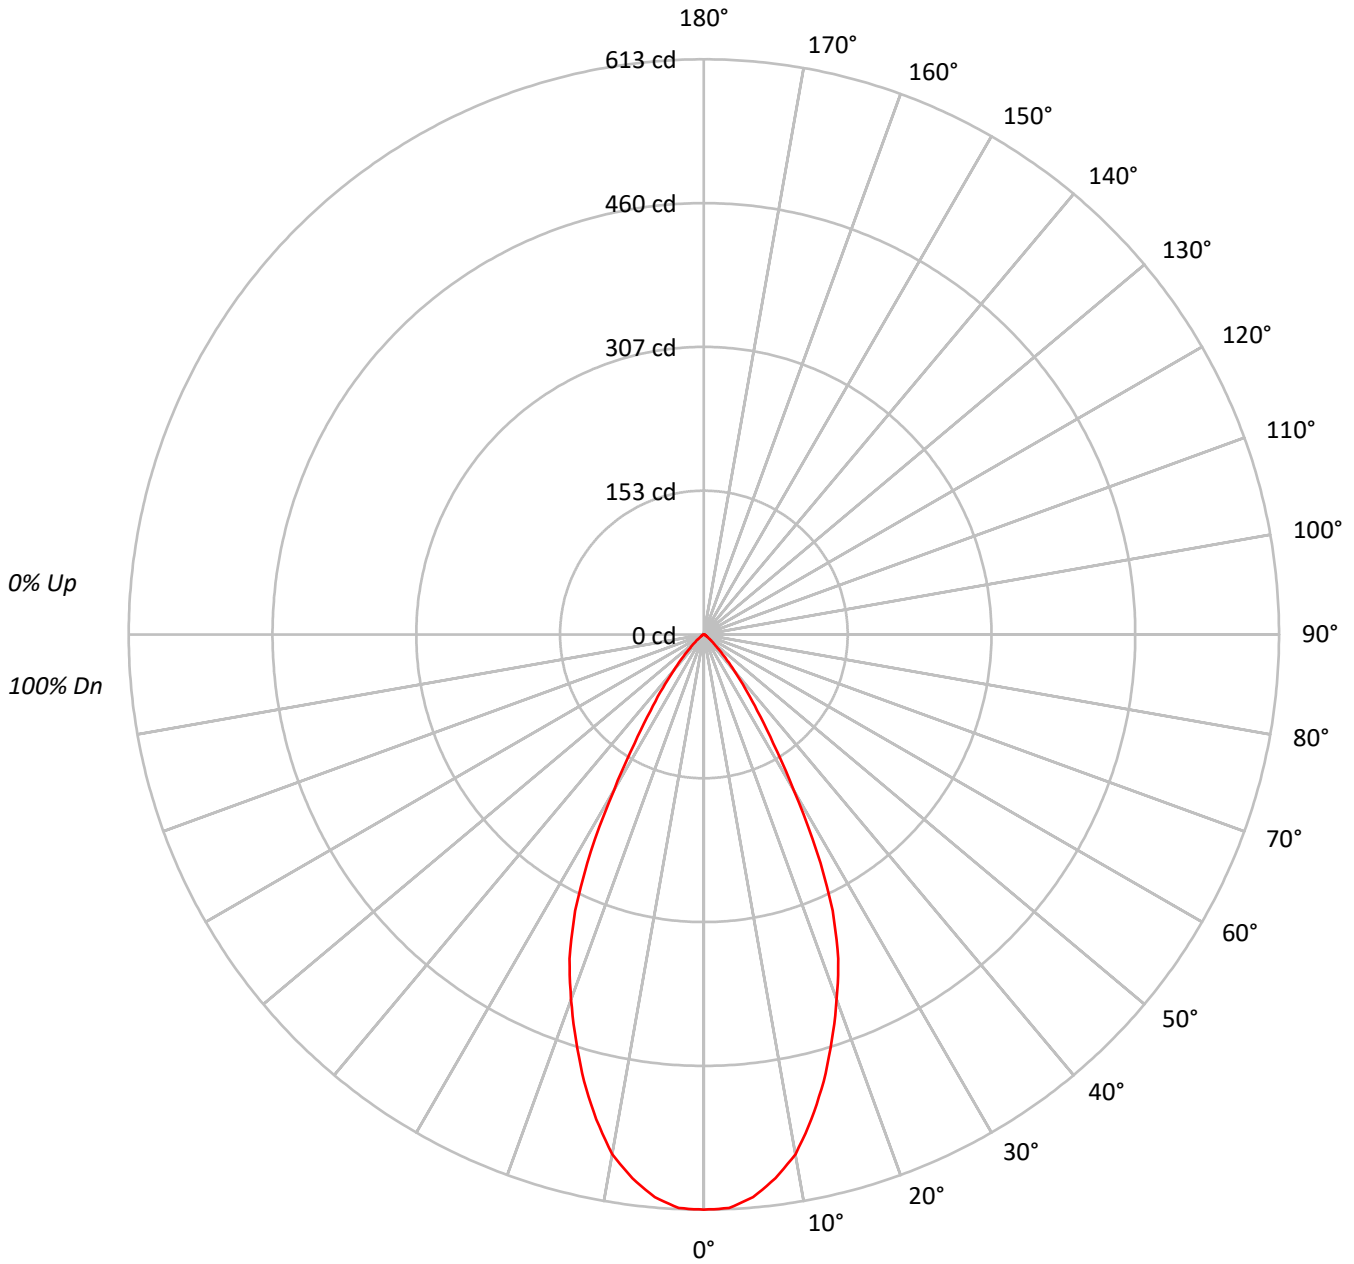



TEST NUMBER: P885950

CATALOG NUMBER: ML104LSFL9FS1E-TIR1D55WFL-TL1RDSL-400LM-3500K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	109	104	100	97	106	102	99	96	99	96	94	96	94	92	93	91	90	88			
3	103	97	93	89	101	96	92	88	93	90	87	91	88	85	89	86	84	83			
4	99	91	86	82	97	90	85	82	88	84	81	86	83	80	84	81	79	77			
5	94	86	81	76	92	85	80	76	83	79	75	82	78	75	80	77	74	73			
6	90	81	76	72	88	80	75	71	79	74	71	78	73	70	76	73	70	68			
7	86	77	71	67	84	76	71	67	75	70	67	74	69	66	73	69	66	65			
8	82	73	67	63	81	72	67	63	71	66	63	70	66	63	69	65	62	61			
9	78	69	63	60	77	69	63	60	68	63	59	67	62	59	66	62	59	58			
10	75	66	60	57	74	65	60	56	64	60	56	64	59	56	63	59	56	55			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1209781
5°	1192610
10°	1127042
15°	1007483
20°	869063
25°	707055
30°	436400
35°	238757
40°	127526
45°	61402
50°	30396
55°	15139
60°	8684
65°	10274
70°	6347
75°	8388
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 61402 cd/sqm



TEST NUMBER: P885950

CATALOG NUMBER: ML104LSFL9FS1E-TIR1D55WFL-TL1RD5L-400LM-3500K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	56.2	13.1
10°-20°	137.0	32.0
20°-30°	143.0	33.4
30°-40°	65.6	15.3
40°-50°	19.0	4.4
50°-60°	4.5	1.1
60°-70°	1.8	0.4
70°-80°	0.7	0.2
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	336.2	78.6
0°-40°	401.9	93.9
0°-60°	425.3	99.4
0°-90°	427.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	427.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	613	
5°	602	56
15°	493	137
25°	325	143
35°	99	66
45°	22	19
55°	4	5
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P885950

CATALOG NUMBER: ML104LSFL9FS1E-TIR1D55WFL-TL1RDSL-400LM-3500K

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	613.0
2.5°	611.9
5°	602.0
7.5°	584.4
10°	562.4
12.5°	529.4
15°	493.1
17.5°	453.5
20°	413.8
22.5°	374.2
25°	324.7
27.5°	260.8
30°	191.5
32.5°	137.6
35°	99.1
37.5°	71.5
40°	49.5
42.5°	34.1
45°	22.0
47.5°	14.3
50°	9.9
52.5°	6.6
55°	4.4
57.5°	3.3
60°	2.2
62.5°	2.2
65°	2.2
67.5°	1.1
70°	1.1
72.5°	1.1
75°	1.1
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)