

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886040

Luminaire Tested: ML104LSFLD2W1E-TIR1D55WFL-TL1RDMW-200LM-3500K

Issue Date: 6/19/2024

Test Information

Test Method: LM-79-2019
Report Number: P886040
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-130)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 6/19/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML104LSFLD2W1E-TIR1D55WFL-TL1RDMW-200LM-3500K
Description: 1IN ROUND ML FLEX, SELECTABLE CCT, WITH 55D TIR, MATTE WHITE TRIM
Light Source: (1) D2W LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 216.5 lumens
Efficiency: N/A
Efficacy: 67.7 lumens/watt
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.77
Luminous Opening: Circular (Dia: 0.08' x H: 0')
CIE Type: Direct

Input Watts (W): 3.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P886040
CATALOG NUMBER: ML104LSFLD2W1E-TIR1D55WFL-TL1RDMW-200LM-3500K

Luminous Intensity Polar Plot

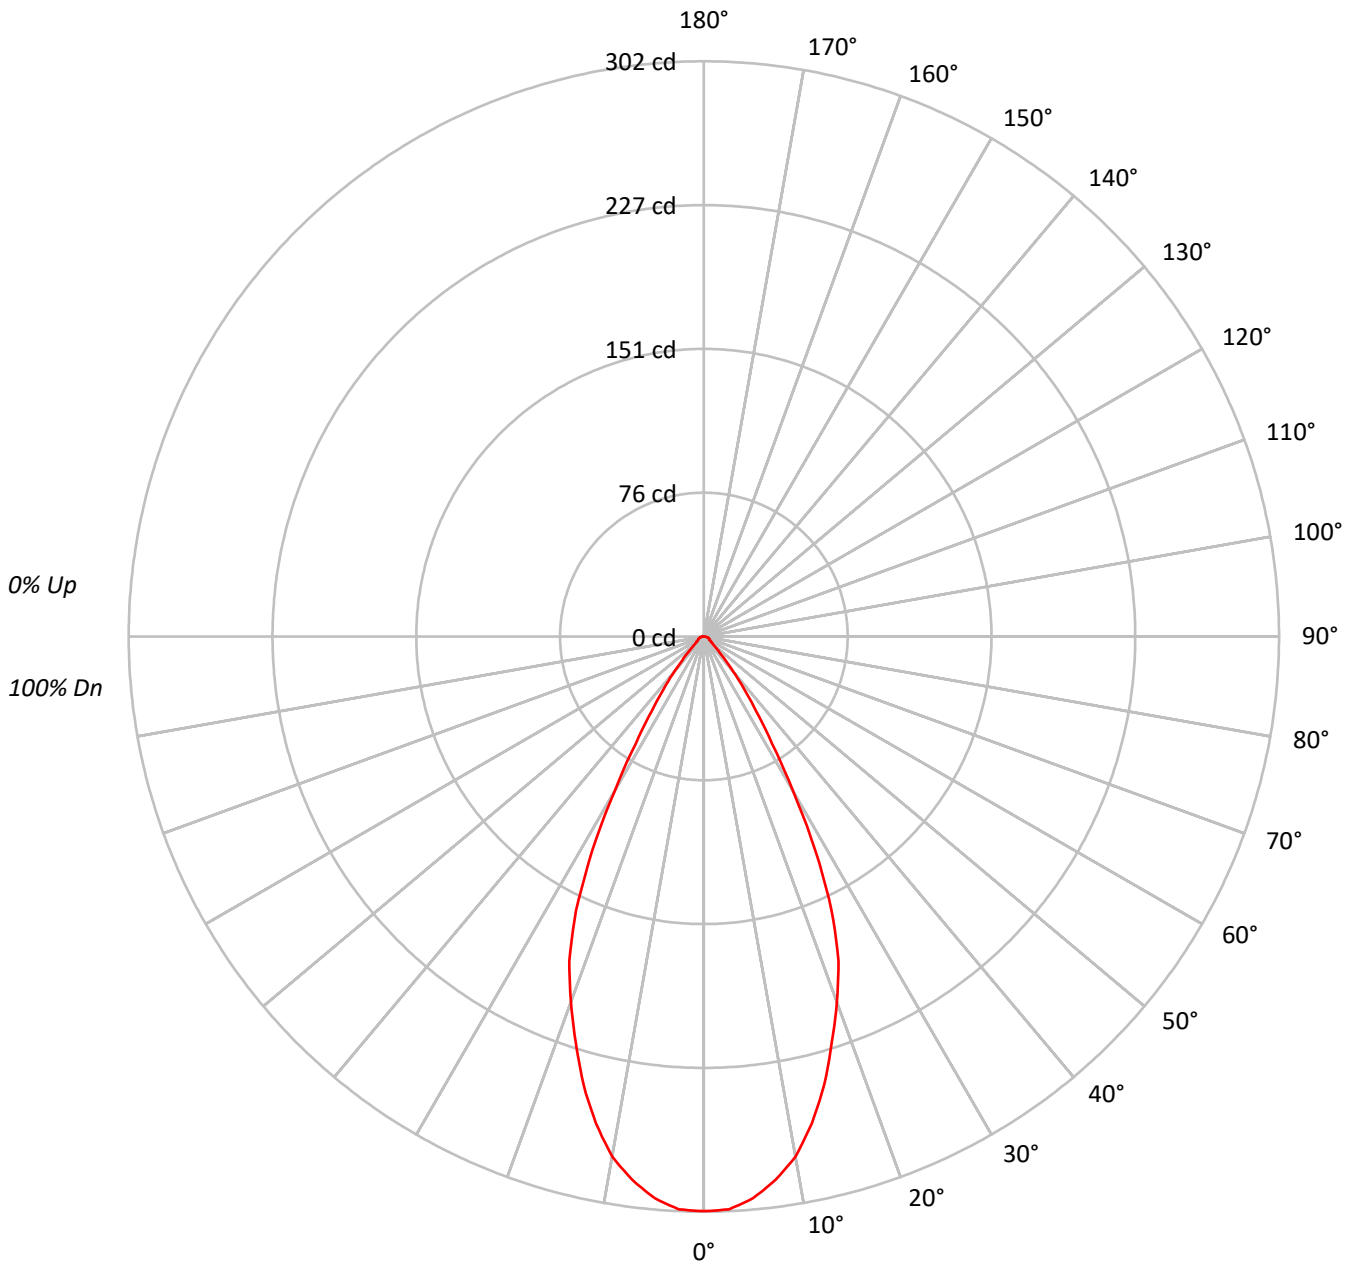



TEST NUMBER: P886040

CATALOG NUMBER: ML104LSFLD2W1E-TIR1D55WFL-TL1RDMW-200LM-3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	102	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	98	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76			
5	93	85	79	75	91	84	78	74	82	77	74	80	76	73	79	75	72	71			
6	88	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67			
7	84	75	70	65	83	75	69	65	73	69	65	72	68	65	71	67	64	63			
8	81	71	66	62	79	71	65	61	70	65	61	69	64	61	68	64	61	59			
9	77	68	62	58	76	67	62	58	66	61	58	65	61	58	65	60	57	56			
10	74	64	59	55	73	64	59	55	63	58	55	62	58	55	62	58	55	53			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	595418
5°	586598
10°	555706
15°	498531
20°	428651
25°	345361
30°	212389
35°	114921
40°	61315
45°	30980
50°	18729
55°	15139
60°	13025
65°	15410
70°	16157
75°	16775
80°	12502
85°	13586

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 30980 cd/sqm



TEST NUMBER: P886040

CATALOG NUMBER: ML104LSFLD2W1E-TIR1D55WFL-TL1RDMW-200LM-3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	27.7	12.8
10°-20°	67.7	31.2
20°-30°	70.1	32.4
30°-40°	31.7	14.6
40°-50°	9.6	4.4
50°-60°	4.0	1.9
60°-70°	3.1	1.4
70°-80°	2.1	1.0
80°-90°	0.6	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	165.4	76.4
0°-40°	197.1	91.0
0°-60°	210.7	97.3
0°-90°	216.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	216.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	302	
5°	296	28
15°	244	68
25°	159	70
35°	48	32
45°	11	10
55°	4	4
65°	3	3
75°	2	2
85°	1	1
90°	0	



TEST NUMBER: P886040

CATALOG NUMBER: ML104LSFLD2W1E-TIR1D55WFL-TL1RDMW-200LM-3500K

CANDELA DISTRIBUTION (FULL):

	0°
0°	301.7
2.5°	301.1
5°	296.1
7.5°	287.8
10°	277.3
12.5°	261.8
15°	244.0
17.5°	223.5
20°	204.1
22.5°	184.7
25°	158.6
27.5°	127.0
30°	93.2
32.5°	66.5
35°	47.7
37.5°	34.4
40°	23.8
42.5°	16.6
45°	11.1
47.5°	7.8
50°	6.1
52.5°	5.0
55°	4.4
57.5°	3.9
60°	3.3
62.5°	3.3
65°	3.3
67.5°	2.8
70°	2.8
72.5°	2.2
75°	2.2
77.5°	1.7
80°	1.1
82.5°	1.1
85°	0.6
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)