

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886085

Luminaire Tested: ML204LSFL95FS1E-TIR1D25NFL-TL2RDMWB-468LM-2700K

Issue Date: 7/18/2024

Test Information

Test Method: LM-79-2019
Report Number: P886085
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-74)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/18/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML204LSFL95FS1E-TIR1D25NFL-TL2RDMWB-468LM-2700K
Description: 2IN ROUND ML FLEX, SELECTABLE CCT, WITH 25D TIR, MATTE WHITE BAFFLED TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 396.1 lumens
Efficiency: N/A
Efficacy: 49.5 lumens/watt
Spacing Criteria (0/90/45): 0.46 / 0.46 / 0.54
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P886085
CATALOG NUMBER: ML204LSFL95FS1E-TIR1D25NFL-TL2RDMWB-468LM-2700K

Luminous Intensity Polar Plot

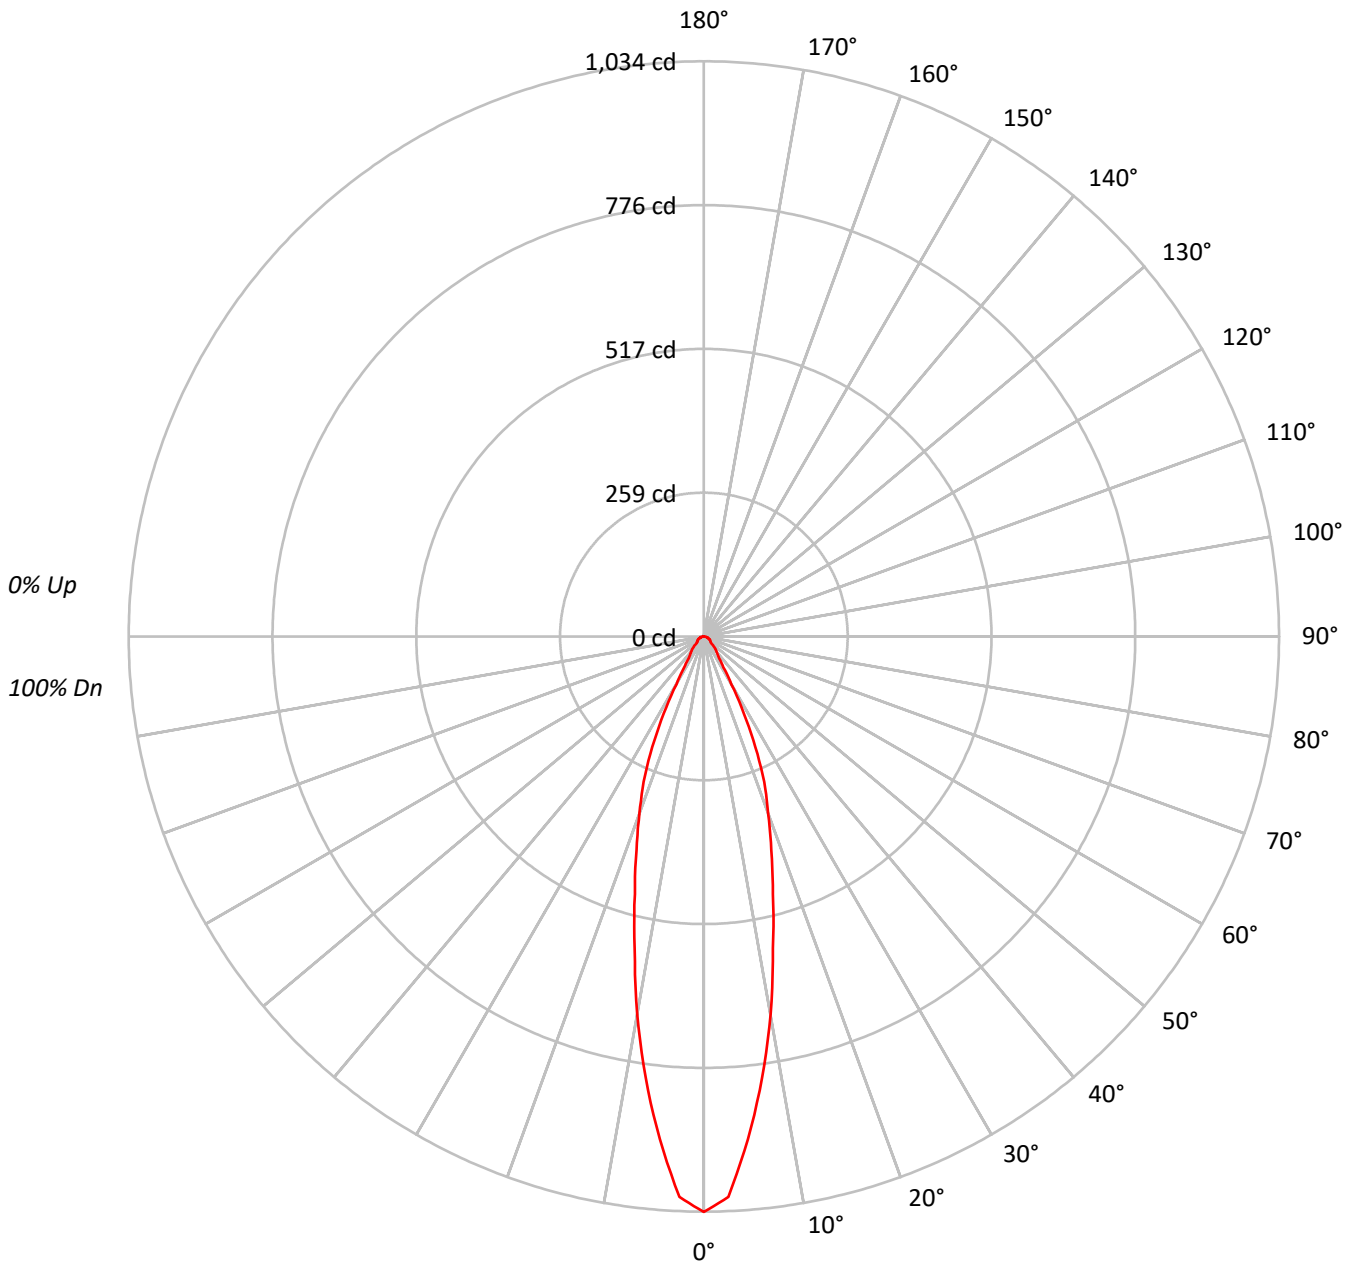



TEST NUMBER: P886085

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D25NFL-TL2RDMWB-468LM-2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	102	101	101	99	98	97	96	95	93			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	103	97	92	88	101	95	91	87	93	89	86	90	87	84	88	85	83	82			
4	98	91	86	82	96	90	85	81	88	83	80	86	82	79	84	81	78	77			
5	94	86	80	76	92	85	80	76	83	79	75	82	78	75	80	77	74	73			
6	90	82	76	72	89	81	76	72	79	75	71	78	74	71	77	73	70	69			
7	86	78	72	68	85	77	72	68	76	71	68	75	70	67	74	70	67	66			
8	83	74	69	65	82	74	68	65	73	68	64	72	67	64	71	67	64	63			
9	80	71	66	62	79	70	65	62	70	65	62	69	64	61	68	64	61	60			
10	77	68	63	59	76	68	63	59	67	62	59	66	62	59	65	61	59	58			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	510401
5°	449304
10°	345483
15°	244972
20°	177517
25°	119383
30°	56287
35°	28730
40°	22671
45°	18072
50°	12204
55°	12215
60°	12433
65°	11674
70°	10819
75°	11247
80°	9376
85°	9624

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 18072 cd/sqm



TEST NUMBER: P886085

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D25NFL-TL2RDMWB-468LM-2700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	79.9	20.2
10°-20°	134.6	34.0
20°-30°	98.1	24.8
30°-40°	33.9	8.6
40°-50°	19.1	4.8
50°-60°	12.7	3.2
60°-70°	9.9	2.5
70°-80°	6.1	1.5
80°-90°	1.8	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	312.5	78.9
0°-40°	346.4	87.5
0°-60°	378.3	95.5
0°-90°	396.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	396.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1034	
5°	907	80
15°	480	135
25°	219	98
35°	48	34
45°	26	19
55°	14	13
65°	10	10
75°	6	6
85°	2	2
90°	0	



TEST NUMBER: P886085

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D25NFL-TL2RDMWB-468LM-2700K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1034.5
2.5°	1008.5
5°	907.2
7.5°	801.0
10°	689.6
12.5°	574.1
15°	479.6
17.5°	402.6
20°	338.1
22.5°	282.9
25°	219.3
27.5°	155.7
30°	98.8
32.5°	65.3
35°	47.7
37.5°	40.2
40°	35.2
42.5°	31.0
45°	25.9
47.5°	17.6
50°	15.9
52.5°	15.1
55°	14.2
57.5°	13.4
60°	12.6
62.5°	10.9
65°	10.0
67.5°	9.2
70°	7.5
72.5°	6.7
75°	5.9
77.5°	5.0
80°	3.3
82.5°	2.5
85°	1.7
87.5°	0.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)