

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886142

Luminaire Tested: ML204LSFL95FS1E-TIR1D40FL-TL2RDMW-468LM-3500K

Issue Date: 6/20/2024


Test Information

Test Method: LM-79-2019
Report Number: P886142
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-77)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 6/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML204LSFL95FS1E-TIR1D40FL-TL2RDMW-468LM-3500K
Description: 2IN ROUND ML FLEX, SELECTABLE CCT, WITH 40D TIR, MATTE WHITE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 535.9 lumens
Efficiency: N/A
Efficacy: 67.0 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.67
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

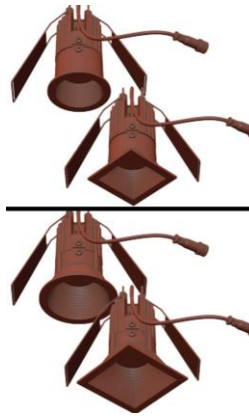

TEST NUMBER: P886142
CATALOG NUMBER: ML204LSFL95FS1E-TIR1D40FL-TL2RDMW-468LM-3500K

Luminous Intensity Polar Plot

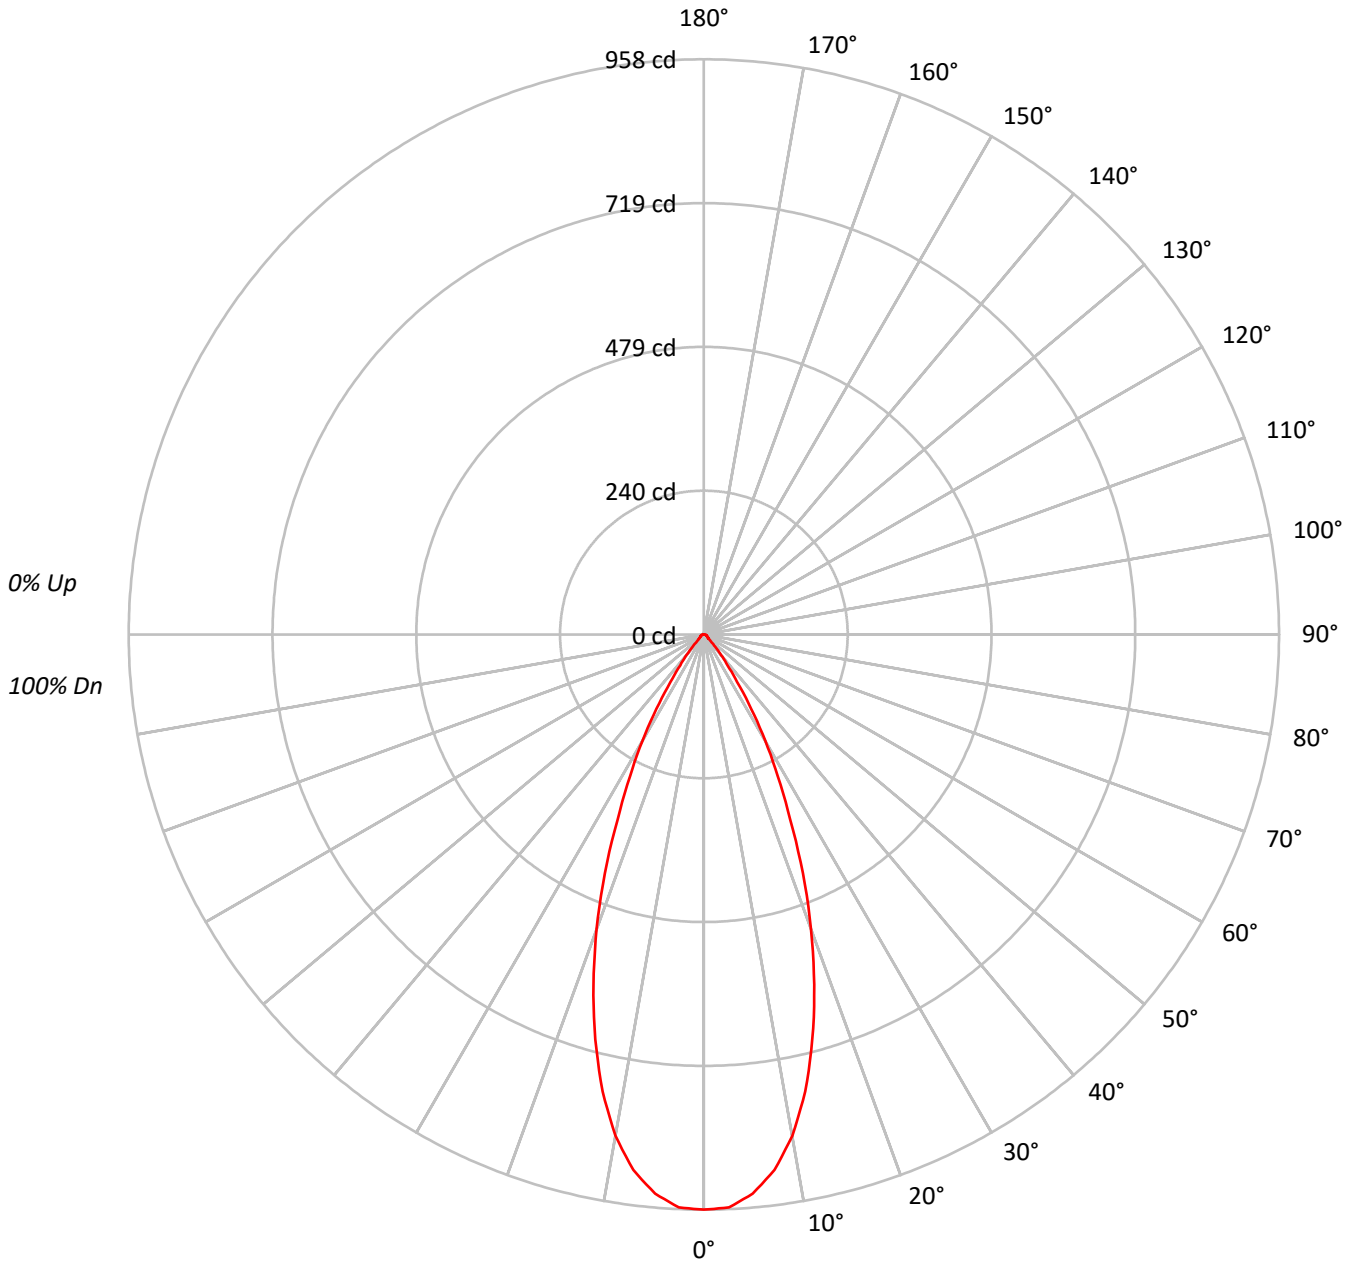



TEST NUMBER: P886142

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D40FL-TL2RDMW-468LM-3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	106	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	109	104	100	97	106	102	99	96	99	96	94	96	94	92	93	91	90	88			
3	104	98	93	89	102	96	92	89	94	90	87	91	88	86	89	87	85	83			
4	99	92	87	83	97	91	86	83	89	85	82	87	83	81	85	82	80	78			
5	95	87	82	78	93	86	81	77	84	80	77	83	79	76	81	78	75	74			
6	91	83	77	73	89	82	77	73	80	76	72	79	75	72	78	74	71	70			
7	87	78	73	69	86	78	73	69	77	72	69	75	71	68	74	71	68	67			
8	83	75	69	65	82	74	69	65	73	68	65	72	68	65	71	67	65	63			
9	80	71	66	62	79	71	66	62	70	65	62	69	65	62	68	64	61	60			
10	77	68	63	59	76	68	63	59	67	62	59	66	62	59	65	61	59	58			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	472608
5°	462874
10°	424690
15°	356681
20°	274020
25°	185199
30°	116277
35°	58243
40°	28854
45°	12490
50°	7522
55°	6193
60°	6217
65°	6304
70°	6491
75°	6863
80°	7671
85°	5095

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12490 cd/sqm



TEST NUMBER: P886142

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D40FL-TL2RDMW-468LM-3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	86.5	16.1
10°-20°	191.8	35.8
20°-30°	157.6	29.4
30°-40°	65.9	12.3
40°-50°	16.3	3.0
50°-60°	7.0	1.3
60°-70°	5.6	1.0
70°-80°	3.8	0.7
80°-90°	1.3	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	435.9	81.3
0°-40°	501.8	93.6
0°-60°	525.2	98.0
0°-90°	535.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	535.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	958	
5°	935	86
15°	698	192
25°	340	158
35°	97	66
45°	18	16
55°	7	7
65°	5	6
75°	4	4
85°	1	1
90°	0	



TEST NUMBER: P886142

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D40FL-TL2RDMW-468LM-3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	957.9
2.5°	955.2
5°	934.6
7.5°	899.7
10°	847.7
12.5°	779.7
15°	698.3
17.5°	611.4
20°	521.9
22.5°	430.6
25°	340.2
27.5°	265.9
30°	204.1
32.5°	146.8
35°	96.7
37.5°	64.5
40°	44.8
42.5°	29.5
45°	17.9
47.5°	11.6
50°	9.8
52.5°	9.0
55°	7.2
57.5°	7.2
60°	6.3
62.5°	6.3
65°	5.4
67.5°	5.4
70°	4.5
72.5°	4.5
75°	3.6
77.5°	2.7
80°	2.7
82.5°	1.8
85°	0.9
87.5°	0.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)