

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886194

Luminaire Tested: ML204LSFL95FS1E-TIR1D55WFL-TL2RDDB-468LM-5000K

Issue Date: 6/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P886194  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-85)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 6/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: HALO  
Catalog Number: ML204LSFL95FS1E-TIR1D55WFL-TL2RDDB-468LM-5000K  
Description: 2IN ROUND ML FLEX, SELECTABLE CCT, WITH 55D TIR, MATTE BLACK TRIM  
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 5000K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 527.2 lumens  
Efficiency: N/A  
Efficacy: 65.9 lumens/watt  
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.81  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P886194  
CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDDB-468LM-5000K

### Luminous Intensity Polar Plot

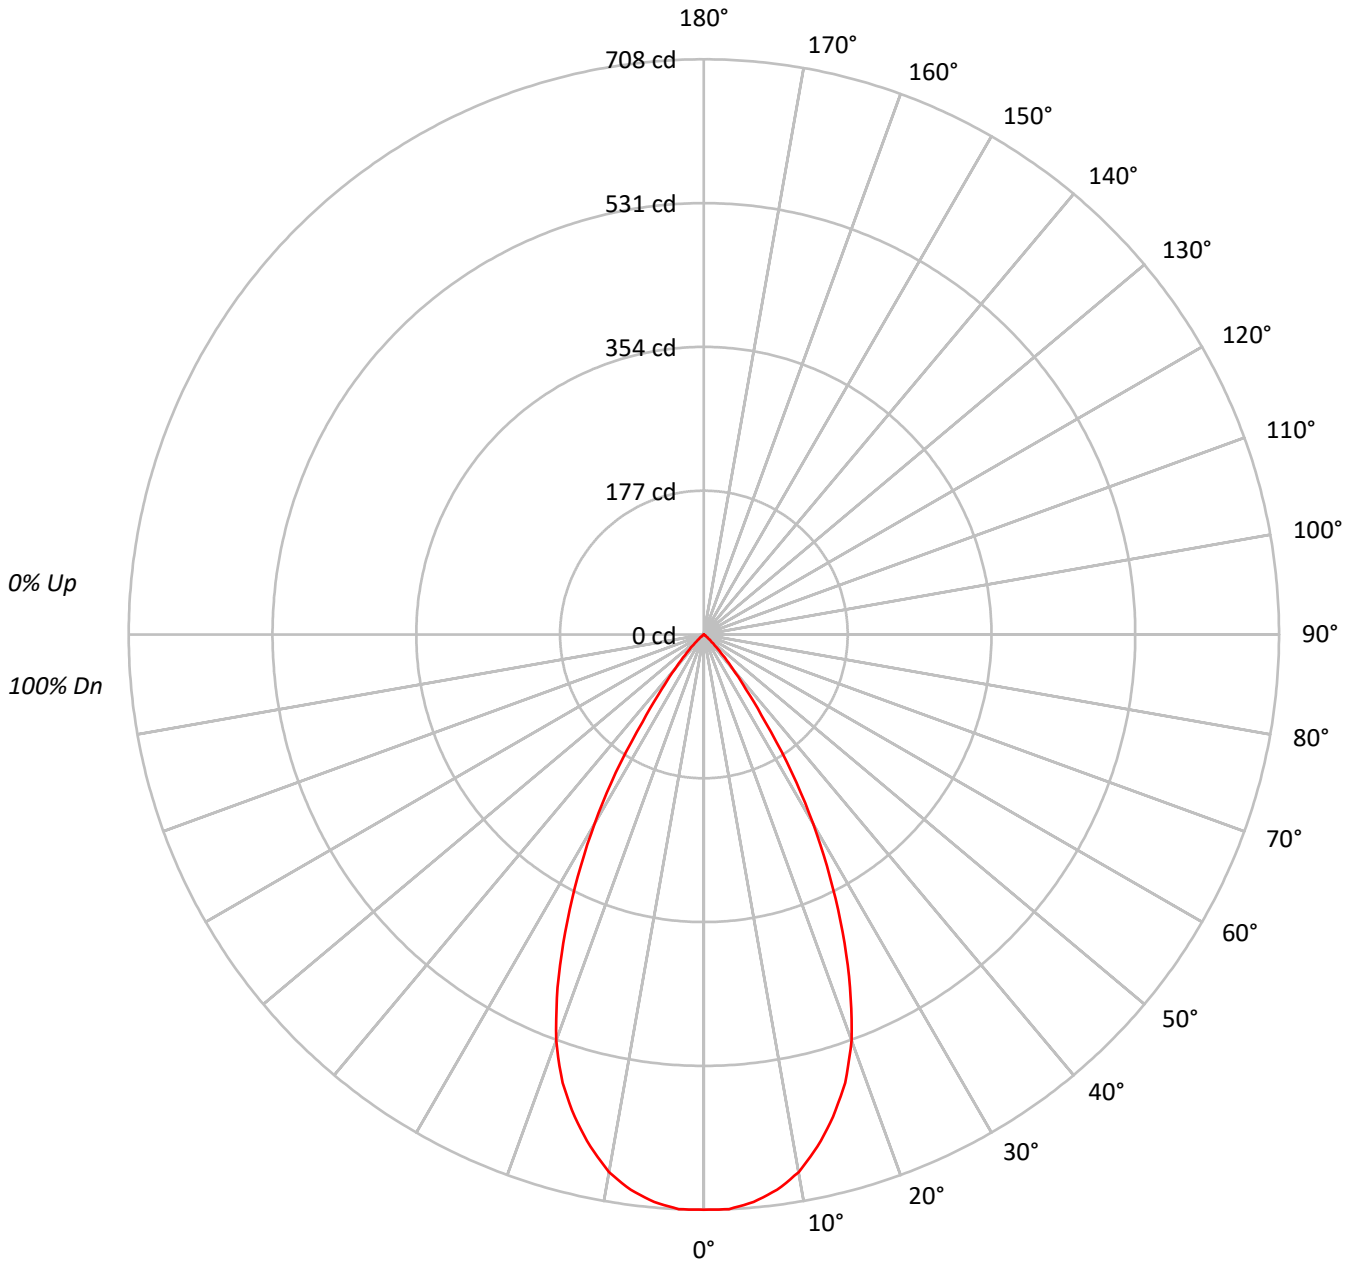



TEST NUMBER: P886194

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMB-468LM-5000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	109	104	100	97	107	102	99	96	99	96	94	96	94	92	94	92	90	89			
3	104	98	93	89	102	96	92	89	94	90	87	91	88	86	89	87	85	83			
4	99	92	87	83	97	91	86	82	89	85	81	87	83	80	85	82	80	78			
5	94	87	81	77	93	86	81	77	84	80	76	82	78	75	81	77	75	73			
6	90	82	76	72	89	81	76	72	80	75	71	78	74	71	77	73	71	69			
7	86	77	72	68	85	77	71	68	75	71	67	74	70	67	73	69	67	65			
8	82	73	68	64	81	73	67	64	72	67	63	71	66	63	70	66	63	62			
9	79	69	64	60	77	69	64	60	68	63	60	67	63	60	66	62	60	58			
10	75	66	61	57	74	66	60	57	65	60	57	64	60	57	63	59	56	55			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	349362
5°	347329
10°	336716
15°	313928
20°	279218
25°	220040
30°	153137
35°	79203
40°	35745
45°	13606
50°	3761
55°	860
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 13606 cd/sqm



TEST NUMBER: P886194

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMB-468LM-5000K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	66.0	12.5
10°-20°	171.0	32.4
20°-30°	182.8	34.7
30°-40°	88.4	16.8
40°-50°	17.6	3.3
50°-60°	1.4	0.3
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	419.8	79.6
0°-40°	508.2	96.4
0°-60°	527.2	100.0
0°-90°	527.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	527.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	708	
5°	701	66
15°	615	171
25°	404	183
35°	132	88
45°	20	18
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P886194

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDDB-468LM-5000K

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	708.1
2.5°	708.1
5°	701.3
7.5°	689.6
10°	672.1
12.5°	645.8
15°	614.6
17.5°	578.6
20°	531.8
22.5°	470.5
25°	404.2
27.5°	336.1
30°	268.8
32.5°	201.6
35°	131.5
37.5°	84.7
40°	55.5
42.5°	34.1
45°	19.5
47.5°	9.7
50°	4.9
52.5°	2.9
55°	1.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)