

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886196

Luminaire Tested: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMBB-468LM-3000K

Issue Date: 6/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P886196  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-88)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 6/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: HALO  
Catalog Number: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMMBB-468LM-3000K  
Description: 2IN ROUND ML FLEX, SELECTABLE CCT, WITH 55D TIR, MATTE BLACK BAFFLED TRIM  
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 3000K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 474.2 lumens  
Efficiency: N/A  
Efficacy: 59.3 lumens/watt  
Spacing Criteria (0/90/45): 0.87 / 0.87 / 0.82  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P886196  
CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMBB-468LM-3000K

### Luminous Intensity Polar Plot

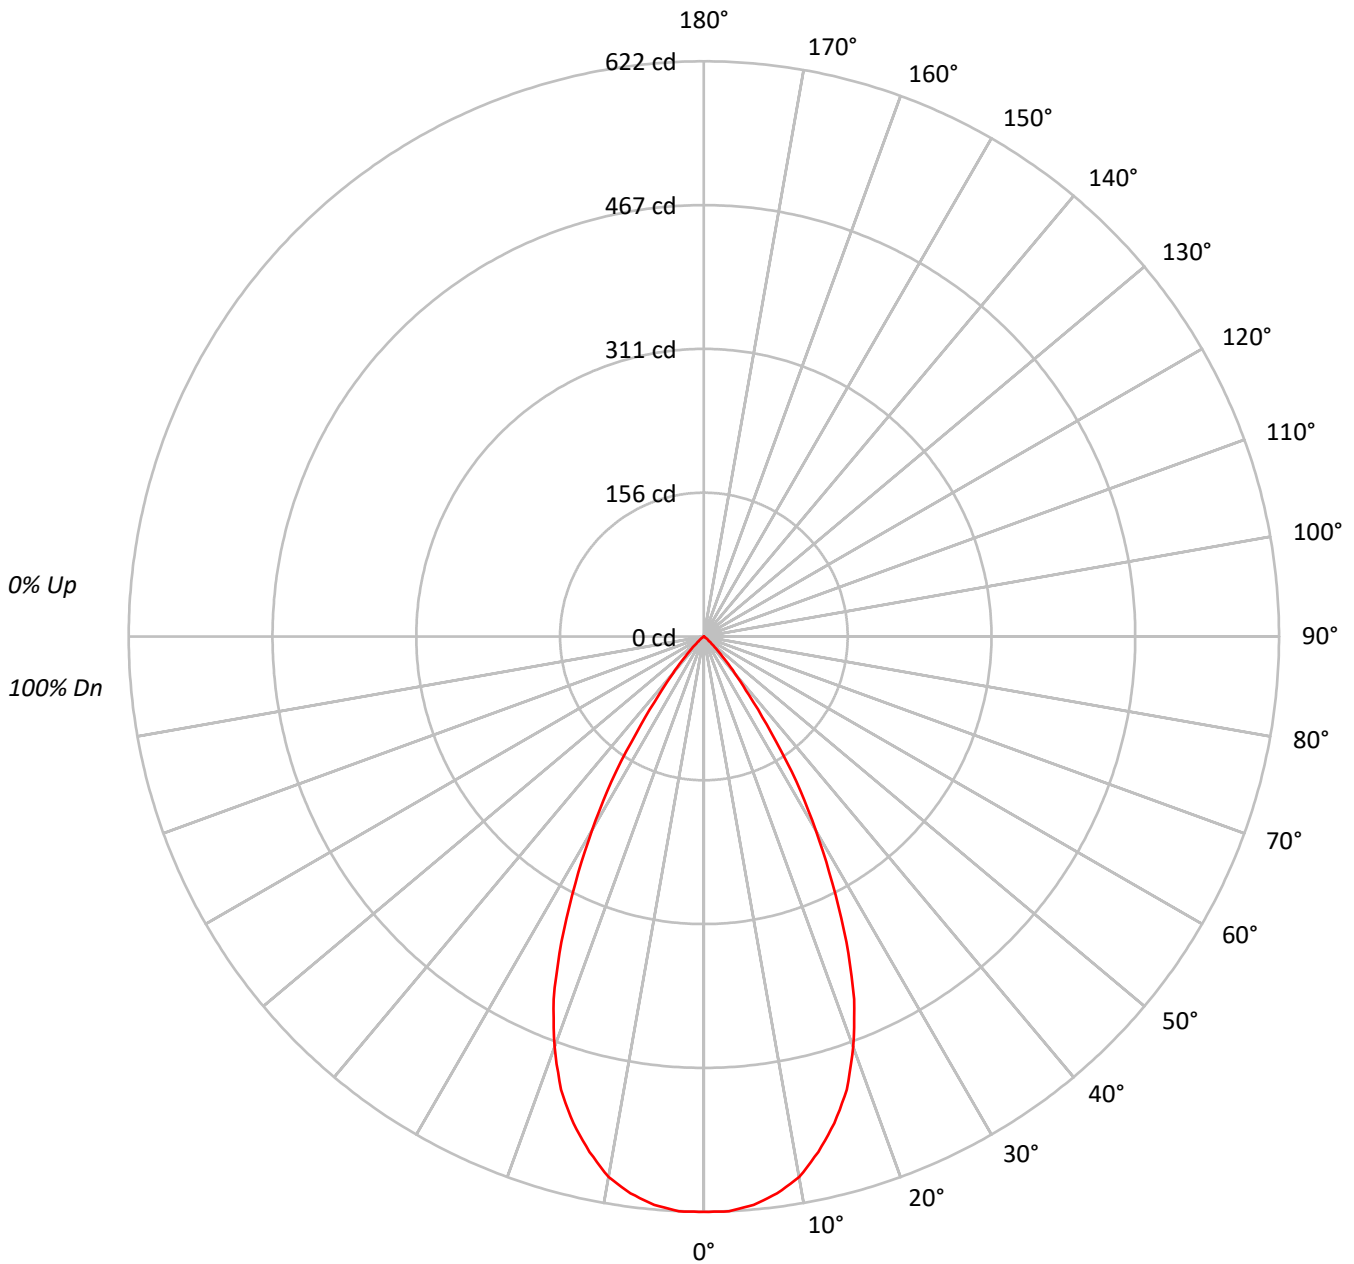



TEST NUMBER: P886196  
 CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMBB-468LM-3000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	109	104	100	97	107	102	99	96	99	96	94	96	94	92	94	92	90	88			
3	104	98	93	89	102	96	92	89	94	90	87	91	88	86	89	87	84	83			
4	99	92	87	83	97	91	86	82	89	84	81	87	83	80	85	82	79	78			
5	94	86	81	77	93	85	80	77	84	79	76	82	78	75	81	77	75	73			
6	90	81	76	72	88	81	75	72	79	75	71	78	74	71	77	73	70	69			
7	86	77	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			
8	82	73	67	63	81	72	67	63	71	66	63	70	66	63	69	65	63	61			
9	78	69	64	60	77	69	63	60	68	63	60	67	62	59	66	62	59	58			
10	75	66	60	57	74	65	60	56	64	60	56	64	59	56	63	59	56	55			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	306981
5°	305578
10°	297388
15°	278377
20°	247978
25°	198591
30°	137755
35°	76192
40°	33491
45°	12699
50°	3991
55°	774
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 12699 cd/sqm



TEST NUMBER: P886196

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMBB-468LM-3000K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	58.1	12.3
10°-20°	151.6	32.0
20°-30°	164.2	34.6
30°-40°	82.3	17.4
40°-50°	16.6	3.5
50°-60°	1.3	0.3
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	373.9	78.9
0°-40°	456.2	96.2
0°-60°	474.2	100.0
0°-90°	474.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	474.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	622	
5°	617	58
15°	545	152
25°	365	164
35°	126	82
45°	18	17
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P886196  
CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDMBB-468LM-3000K

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	622.2
2.5°	622.2
5°	617.0
7.5°	607.4
10°	593.6
12.5°	571.0
15°	545.0
17.5°	513.8
20°	472.3
22.5°	424.6
25°	364.8
27.5°	300.7
30°	241.8
32.5°	186.3
35°	126.5
37.5°	79.7
40°	52.0
42.5°	32.1
45°	18.2
47.5°	9.5
50°	5.2
52.5°	2.6
55°	0.9
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)