

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886219

Luminaire Tested: ML204LSFL95FS1E-TIR1D55WFL-TL2RDSLb-468LM-5000K

Issue Date: 6/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P886219  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-87)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 6/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: HALO  
Catalog Number: ML204LSFL95FS1E-TIR1D55WFL-TL2RDSL B-468LM-5000K  
Description: 2IN ROUND ML FLEX, SELECTABLE CCT, WITH 55D TIR, METALLIC SILVER BAFFLED TRIM  
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 5000K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 553.0 lumens  
Efficiency: N/A  
Efficacy: 69.1 lumens/watt  
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.82  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P886219  
CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDSL B-468LM-5000K

### Luminous Intensity Polar Plot

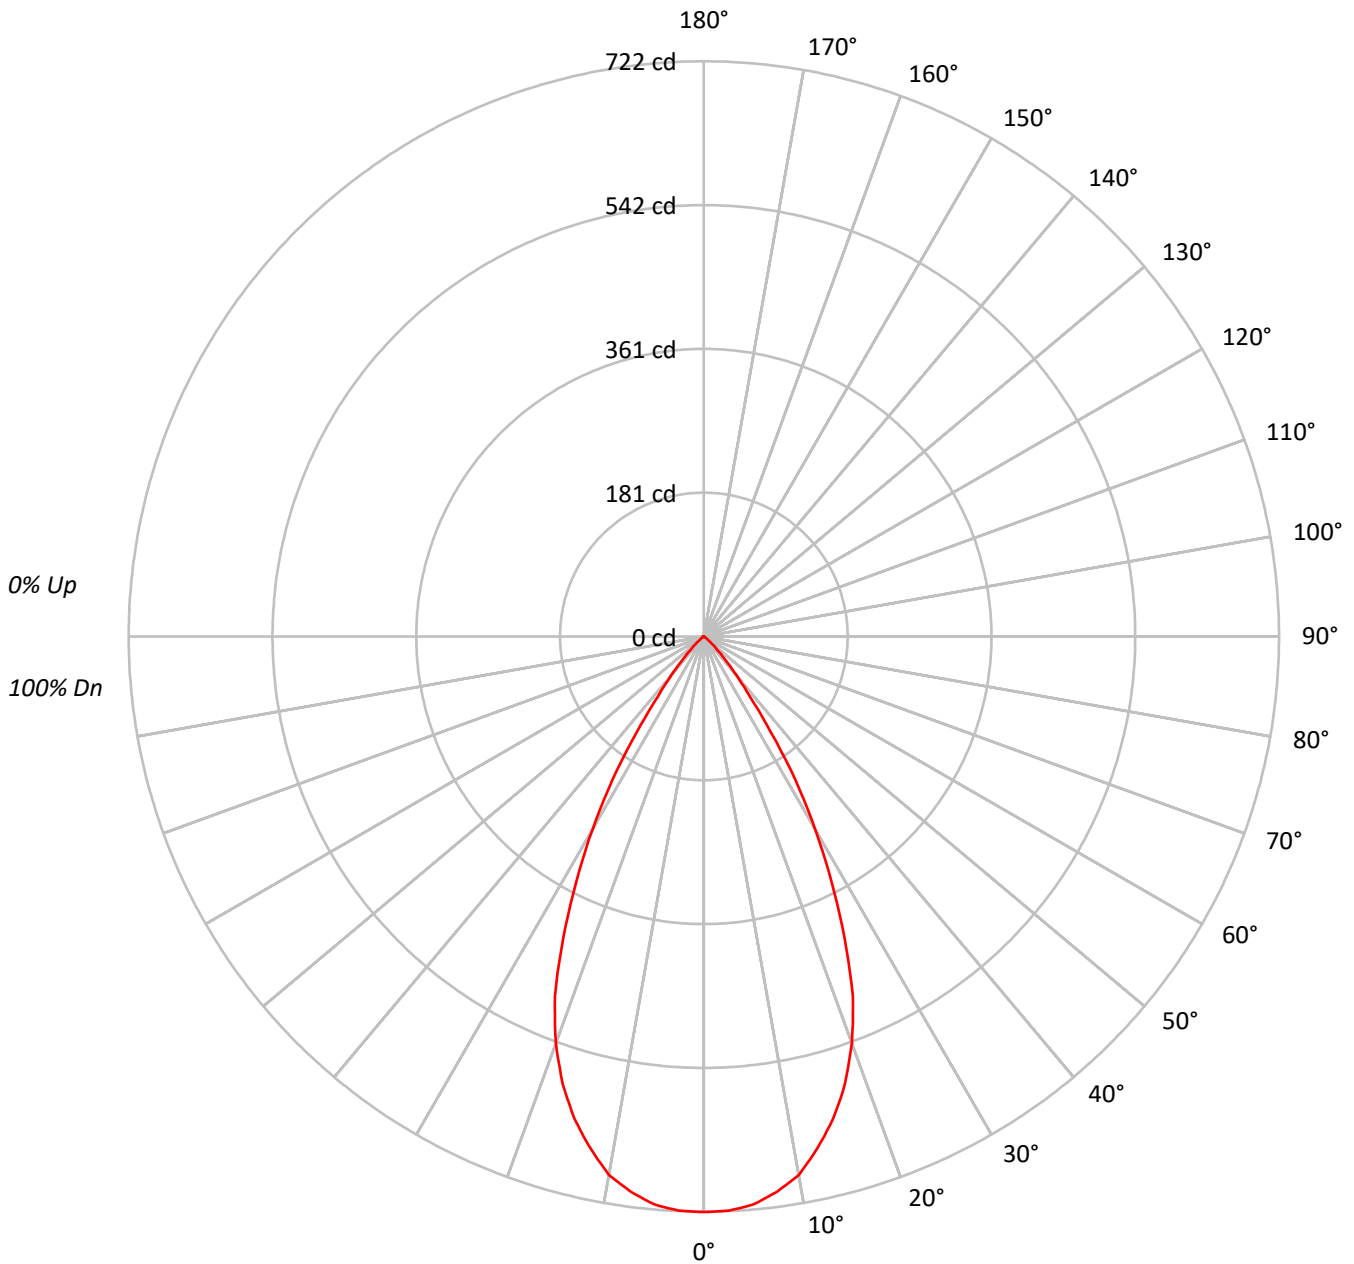



TEST NUMBER: P886219

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDSLb-468LM-5000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	109	104	100	97	106	102	99	96	99	96	94	96	94	92	93	91	90	88			
3	103	97	93	89	101	96	92	88	93	90	87	91	88	85	89	86	84	83			
4	99	91	86	82	97	90	85	82	88	84	81	86	83	80	84	81	79	77			
5	94	86	80	76	92	85	80	76	83	79	75	82	78	75	80	77	74	73			
6	89	81	75	71	88	80	75	71	79	74	71	77	73	70	76	73	70	68			
7	85	77	71	67	84	76	71	67	75	70	66	73	69	66	72	69	66	64			
8	81	72	67	63	80	72	66	63	71	66	62	70	65	62	69	65	62	61			
9	78	69	63	59	77	68	63	59	67	62	59	66	62	59	66	62	59	57			
10	74	65	60	56	73	65	60	56	64	59	56	63	59	56	63	58	55	54			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	356417
5°	354411
10°	343880
15°	320262
20°	285204
25°	227389
30°	159176
35°	88539
40°	40769
45°	16955
50°	6755
55°	2495
60°	1875
65°	1167
70°	1443
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 16955 cd/sqm



TEST NUMBER: P886219

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDSL B-468LM-5000K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	67.3	12.2
10°-20°	174.3	31.5
20°-30°	188.9	34.2
30°-40°	95.5	17.3
40°-50°	21.9	4.0
50°-60°	3.5	0.6
60°-70°	1.1	0.2
70°-80°	0.4	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	430.6	77.9
0°-40°	526.1	95.1
0°-60°	551.5	99.7
0°-90°	553.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	553.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	722	
5°	716	67
15°	627	174
25°	418	189
35°	147	96
45°	24	22
55°	3	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P886219

CATALOG NUMBER: ML204LSFL95FS1E-TIR1D55WFL-TL2RDSL B-468LM-5000K

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	722.4
2.5°	721.4
5°	715.6
7.5°	702.9
10°	686.4
12.5°	658.1
15°	627.0
17.5°	589.0
20°	543.2
22.5°	488.7
25°	417.7
27.5°	346.6
30°	279.4
32.5°	214.2
35°	147.0
37.5°	93.5
40°	63.3
42.5°	40.9
45°	24.3
47.5°	14.6
50°	8.8
52.5°	5.8
55°	2.9
57.5°	1.9
60°	1.9
62.5°	1.0
65°	1.0
67.5°	1.0
70°	1.0
72.5°	1.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)