

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886470

Luminaire Tested: ML204LSFLD2W1E-TIR1D40FL-TL2RDMWB-400LM-3500K

Issue Date: 6/20/2024


Test Information

Test Method: LM-79-2019
Report Number: P886470
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-80)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 6/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML204LSFLD2W1E-TIR1D40FL-TL2RDMWB-400LM-3500K
Description: 2IN ROUND ML FLEX, SELECTABLE CCT, WITH 40D TIR, MATTE WHITE BAFFLED TRIM
Light Source: (1) D2W LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 431.4 lumens
Efficiency: N/A
Efficacy: 69.6 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.68
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 6.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

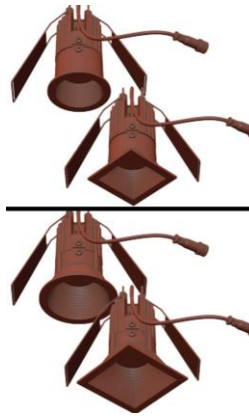

TEST NUMBER: P886470
CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDMWB-400LM-3500K

Luminous Intensity Polar Plot

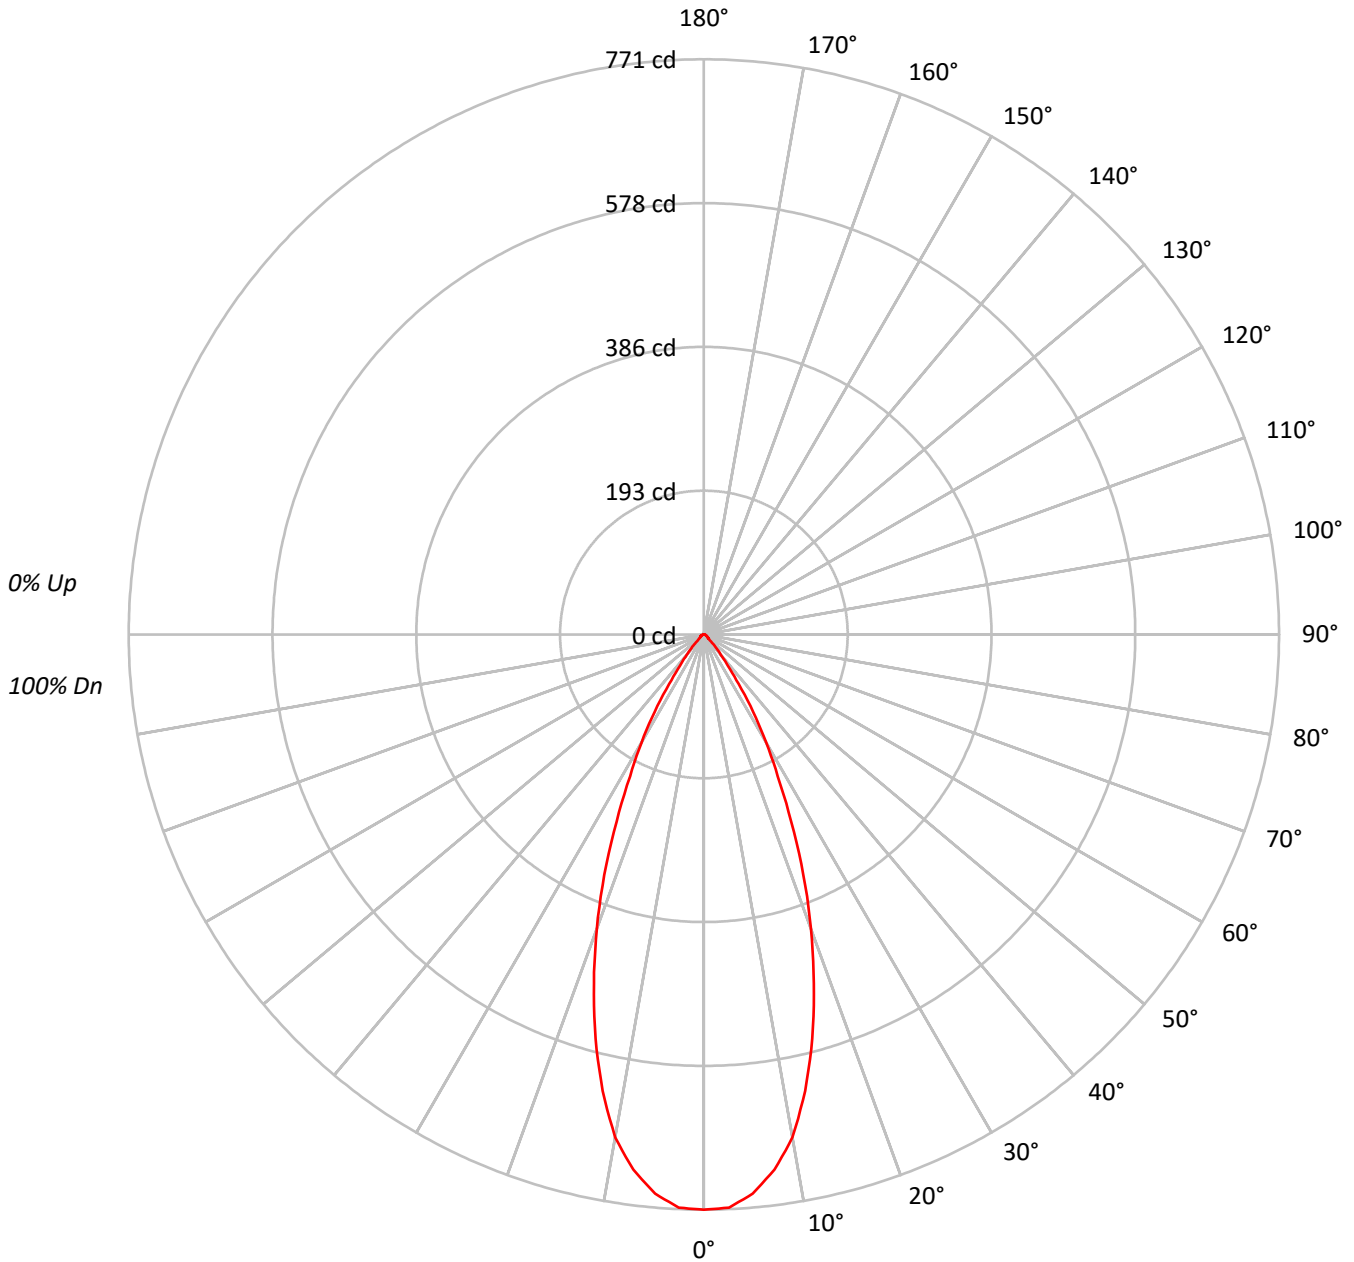



TEST NUMBER: P886470

CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDMWB-400LM-3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	109	104	100	97	106	102	99	96	99	96	94	96	94	92	94	92	90	88			
3	104	98	93	90	102	96	92	89	94	90	87	91	89	86	89	87	85	83			
4	99	92	87	83	97	91	86	83	89	85	82	87	84	81	85	82	80	79			
5	95	87	82	78	93	86	81	78	85	80	77	83	79	76	81	78	76	74			
6	91	83	77	73	89	82	77	73	80	76	73	79	75	72	78	74	72	70			
7	87	79	73	69	86	78	73	69	77	72	69	76	71	68	74	71	68	67			
8	83	75	69	66	82	74	69	65	73	69	65	72	68	65	71	67	65	63			
9	80	71	66	62	79	71	66	62	70	65	62	69	65	62	68	64	62	60			
10	77	68	63	59	76	68	63	59	67	62	59	66	62	59	65	62	59	58			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	380445
5°	372587
10°	342928
15°	286550
20°	220256
25°	150522
30°	95027
35°	48726
40°	22800
45°	10606
50°	6064
55°	4989
60°	4243
65°	4203
70°	4183
75°	4194
80°	3978
85°	3963

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 10606 cd/sqm



TEST NUMBER: P886470

CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDMWB-400LM-3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	69.6	16.1
10°-20°	154.2	35.7
20°-30°	127.6	29.6
30°-40°	54.5	12.6
40°-50°	13.4	3.1
50°-60°	5.2	1.2
60°-70°	3.7	0.9
70°-80°	2.5	0.6
80°-90°	0.8	0.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	351.3	81.4
0°-40°	405.8	94.1
0°-60°	424.5	98.4
0°-90°	431.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	431.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	771	
5°	752	70
15°	561	154
25°	276	128
35°	81	54
45°	15	13
55°	6	5
65°	4	4
75°	2	2
85°	1	1
90°	0	



TEST NUMBER: P886470

CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDMWB-400LM-3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	771.1
2.5°	768.9
5°	752.3
7.5°	723.4
10°	684.5
12.5°	626.7
15°	561.0
17.5°	490.2
20°	419.5
22.5°	348.7
25°	276.5
27.5°	214.4
30°	166.8
32.5°	122.7
35°	80.9
37.5°	52.7
40°	35.4
42.5°	24.5
45°	15.2
47.5°	9.4
50°	7.9
52.5°	6.5
55°	5.8
57.5°	5.1
60°	4.3
62.5°	4.3
65°	3.6
67.5°	3.6
70°	2.9
72.5°	2.9
75°	2.2
77.5°	2.2
80°	1.4
82.5°	1.4
85°	0.7
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)