

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886473

Luminaire Tested: ML204LSFLD2W1E-TIR1D40FL-TL2RDSL-400LM-4000K

Issue Date: 6/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P886473  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-78)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 6/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: HALO  
Catalog Number: ML204LSFLD2W1E-TIR1D40FL-TL2RDSL-400LM-4000K  
Description: 2IN ROUND ML FLEX, SELECTABLE CCT, WITH 40D TIR, METALLIC SILVER TRIM  
Light Source: (1) D2W LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 454.9 lumens  
Efficiency: N/A  
Efficacy: 73.4 lumens/watt  
Spacing Criteria (0/90/45): 0.67 / 0.67 / 0.67  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 6.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P886473  
CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDSL-400LM-4000K

### Luminous Intensity Polar Plot

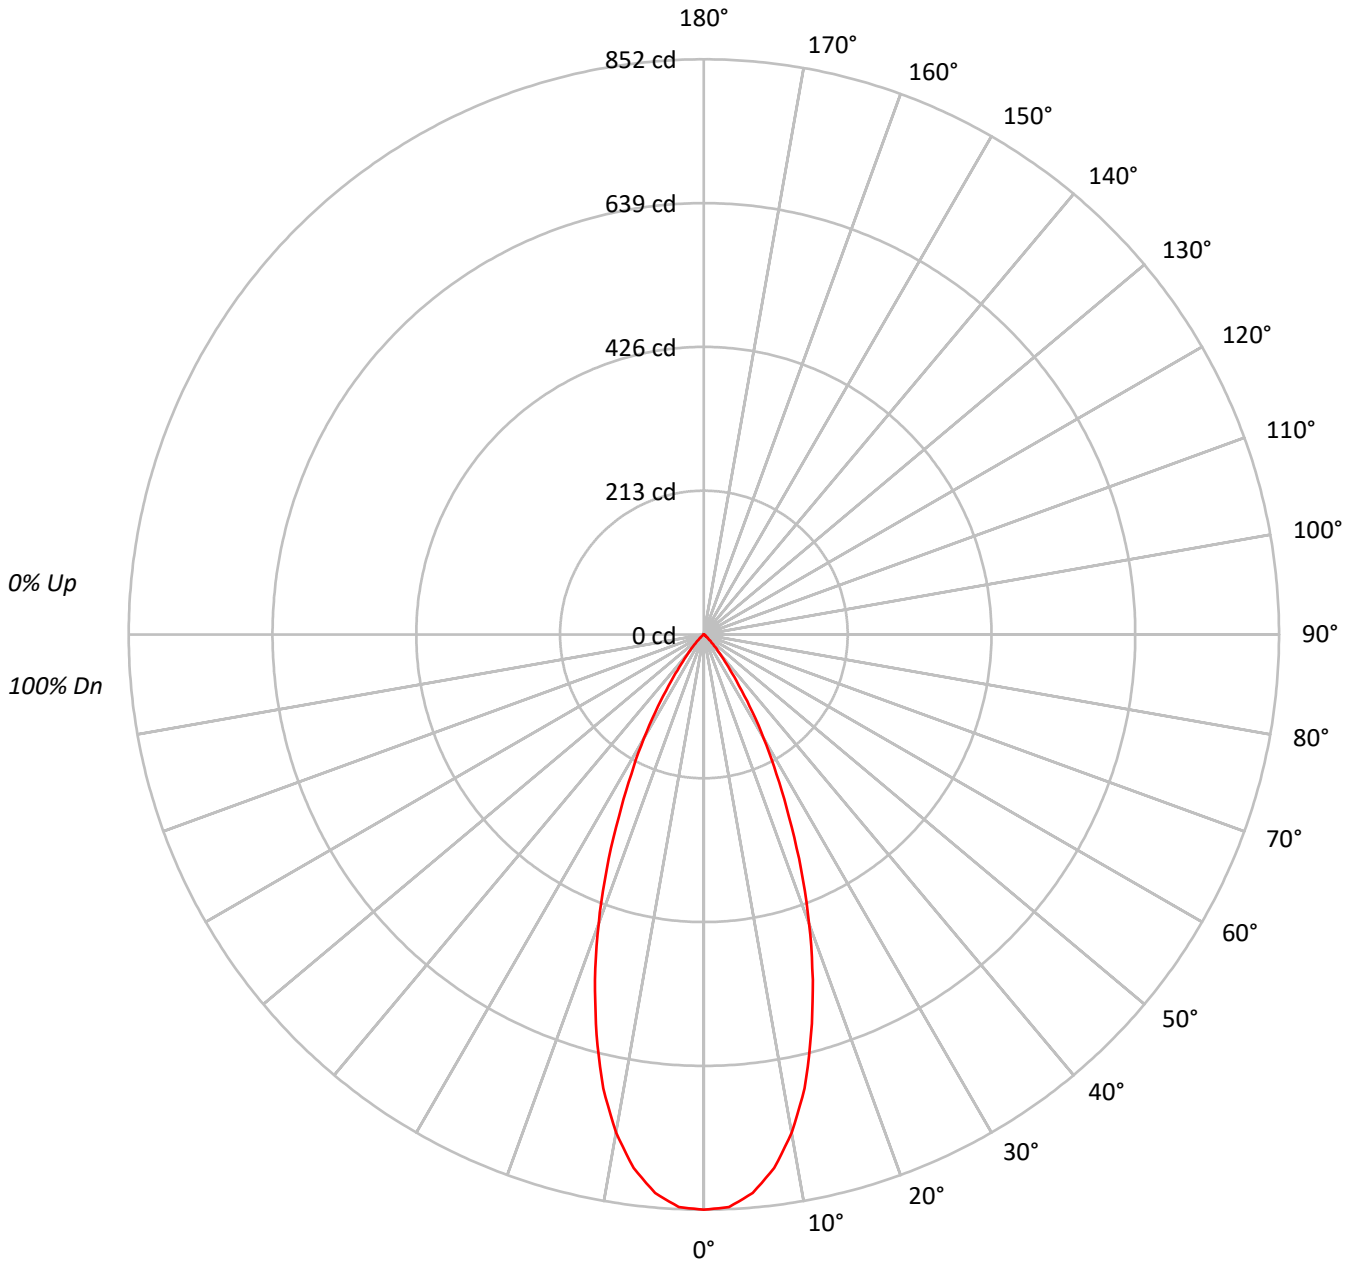



TEST NUMBER: P886473

CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDSL-400LM-4000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	97	95			
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	90			
3	105	99	94	91	103	98	94	90	95	92	89	93	90	87	90	88	86	85			
4	100	93	89	85	98	92	88	84	90	86	83	88	85	82	87	84	82	80			
5	96	89	83	80	94	88	83	79	86	82	79	84	81	78	83	80	77	76			
6	92	84	79	75	91	83	78	75	82	78	74	81	77	74	79	76	73	72			
7	88	80	75	71	87	79	74	71	78	74	70	77	73	70	76	72	70	69			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62			
10	78	70	65	61	77	69	64	61	68	64	61	68	64	61	67	63	61	59			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	420359
5°	411218
10°	375242
15°	313417
20°	239315
25°	162172
30°	100952
35°	50353
40°	23444
45°	8652
50°	3531
55°	1978
60°	1480
65°	934
70°	1154
75°	1525
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 8652 cd/sqm



TEST NUMBER: P886473

CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDSL-400LM-4000K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	76.7	16.9
10°-20°	168.7	37.1
20°-30°	137.8	30.3
30°-40°	56.5	12.4
40°-50°	11.7	2.6
50°-60°	2.2	0.5
60°-70°	0.9	0.2
70°-80°	0.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	383.1	84.2
0°-40°	439.6	96.6
0°-60°	453.5	99.7
0°-90°	454.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	454.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	852	
5°	830	77
15°	614	169
25°	298	138
35°	84	56
45°	12	12
55°	2	2
65°	1	1
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P886473

CATALOG NUMBER: ML204LSFLD2W1E-TIR1D40FL-TL2RDSL-400LM-4000K

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	852.0
2.5°	848.9
5°	830.3
7.5°	797.0
10°	749.0
12.5°	688.7
15°	613.6
17.5°	536.2
20°	455.8
22.5°	376.1
25°	297.9
27.5°	232.9
30°	177.2
32.5°	126.1
35°	83.6
37.5°	54.2
40°	36.4
42.5°	22.4
45°	12.4
47.5°	7.0
50°	4.6
52.5°	3.1
55°	2.3
57.5°	1.5
60°	1.5
62.5°	0.8
65°	0.8
67.5°	0.8
70°	0.8
72.5°	0.8
75°	0.8
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)