

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P677538

Luminaire Tested: ML4DM08LSFL95FS1E-TL40R2GMW-2700K

Issue Date: 4/25/2023

Test Information

Test Method: LM-79-2019
Report Number: P677538
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2304-979-1)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/25/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML4DM08LSFL95FS1E-TL40R2GMW-2700K
Description: DIRECT MOUNT, CONICAL LENS TRIM
Light Source: (1) SELECTABLE LUMEN LED 95CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 513.6 lumens
Efficiency: N/A
Efficacy: 49.9 lumens/watt
Spacing Criteria (0/90/45): 1.15 / 1.15 / 1.23
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P677538
CATALOG NUMBER: ML4DM08LSFL95FS1E-TL40R2GMW-2700K

Luminous Intensity Polar Plot

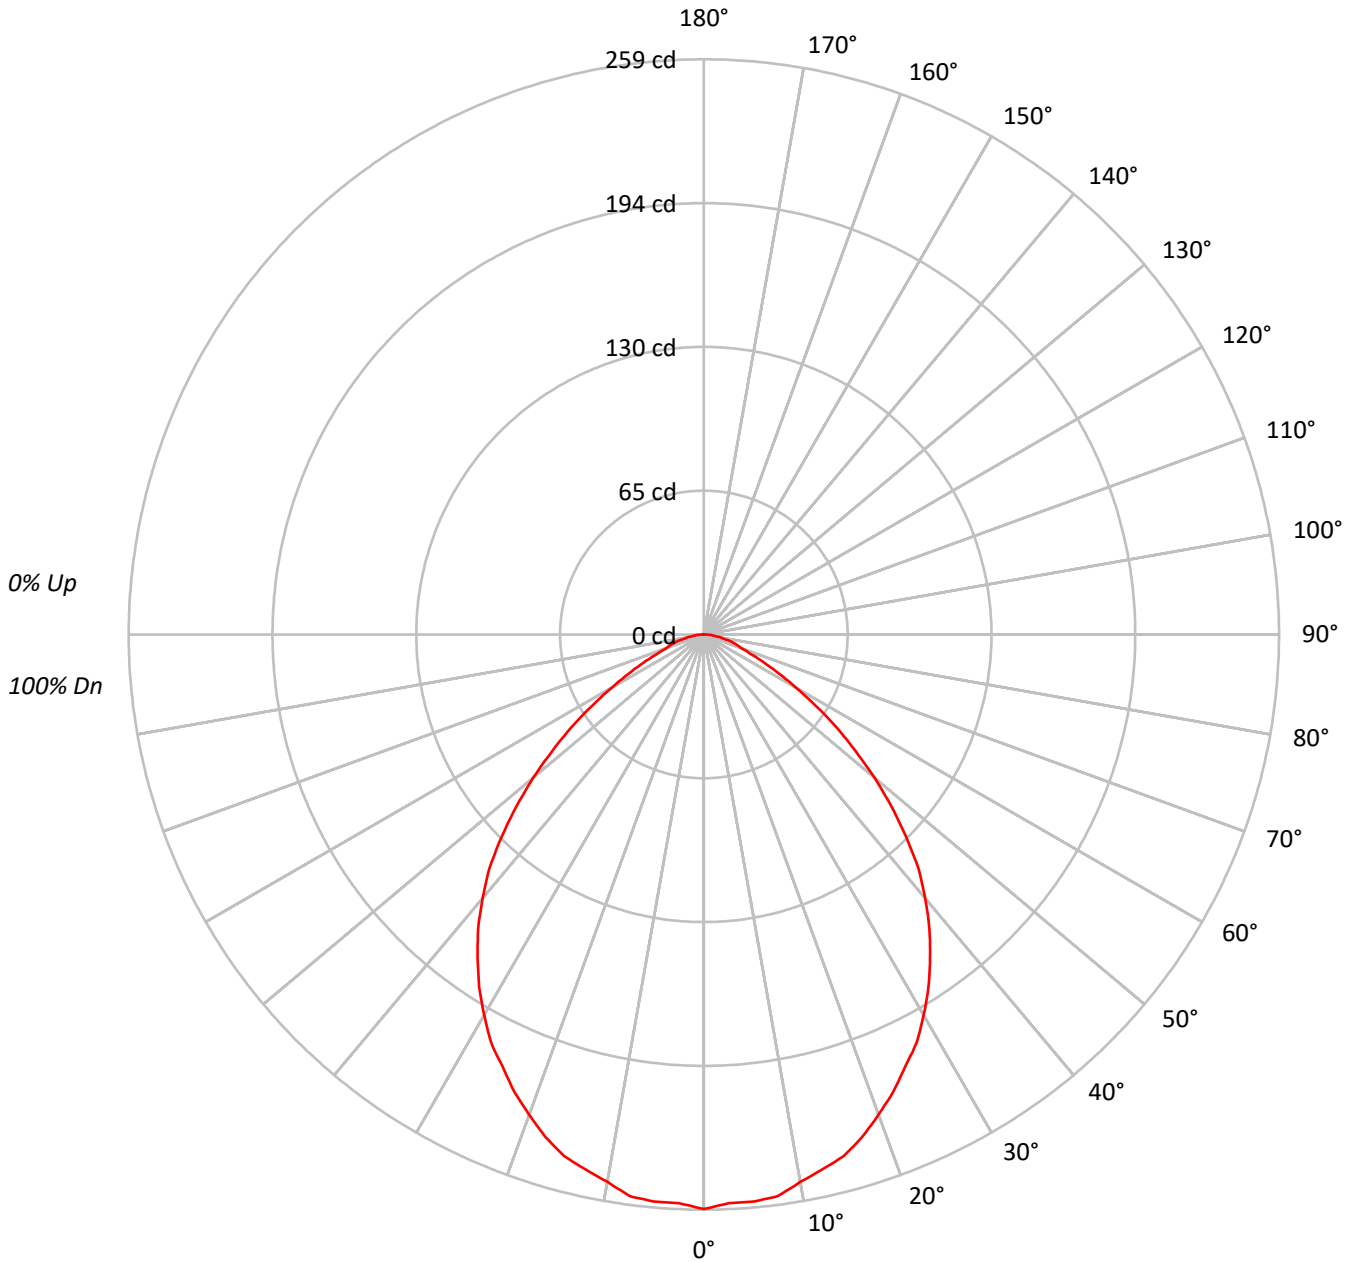



TEST NUMBER: P677538

CATALOG NUMBER: ML4DM08LSFL95FS1E-TL40R2GMW-2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88		
2	103	96	90	85	100	94	89	84	90	86	82	87	84	80	84	81	79	77		
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67		
4	88	77	70	64	86	76	69	63	74	67	62	71	66	62	69	65	61	59		
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52		
6	76	64	56	50	74	63	55	50	61	54	49	59	53	49	58	53	48	47		
7	70	58	50	45	69	57	50	45	56	49	44	55	48	44	53	48	44	42		
8	66	53	46	40	64	53	45	40	52	45	40	50	44	40	49	44	40	38		
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34		
10	58	46	38	34	57	45	38	33	44	38	33	43	37	33	43	37	33	31		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	31910
5°	31734
10°	31350
15°	31056
20°	30190
25°	29206
30°	28186
35°	26743
40°	24958
45°	22450
50°	19208
55°	15634
60°	11767
65°	8697
70°	6455
75°	6243
80°	5114
85°	5095

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 22450 cd/sqm



TEST NUMBER: P677538

CATALOG NUMBER: ML4DM08LSFL95FS1E-TL40R2GMW-2700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	24.3	4.7
10°-20°	68.3	13.3
20°-30°	99.0	19.3
30°-40°	110.9	21.6
40°-50°	98.9	19.2
50°-60°	65.0	12.7
60°-70°	30.4	5.9
70°-80°	13.4	2.6
80°-90°	3.6	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	191.5	37.3
0°-40°	302.4	58.9
0°-60°	466.3	90.8
0°-90°	513.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	513.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	259	
5°	256	24
15°	243	68
25°	215	99
35°	178	111
45°	129	99
55°	73	65
65°	30	30
75°	13	13
85°	4	4
90°	0	



TEST NUMBER: P677538
CATALOG NUMBER: ML4DM08LSFL95FS1E-TL40R2GMW-2700K

CANDELA DISTRIBUTION (FULL):

	0°
0°	258.7
2.5°	256.3
5°	256.3
7.5°	255.1
10°	250.3
12.5°	246.7
15°	243.2
17.5°	237.2
20°	230.0
22.5°	222.9
25°	214.6
27.5°	207.4
30°	197.9
32.5°	188.3
35°	177.6
37.5°	166.9
40°	155.0
42.5°	143.0
45°	128.7
47.5°	114.4
50°	100.1
52.5°	85.8
55°	72.7
57.5°	59.6
60°	47.7
62.5°	38.1
65°	29.8
67.5°	22.6
70°	17.9
72.5°	15.5
75°	13.1
77.5°	9.5
80°	7.2
82.5°	4.8
85°	3.6
87.5°	1.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)