

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: HALO

Report Number: P601395

Luminaire Tested: **ML4DM08LSAWW95FS1E - TIR4D25AWW - TL45R6G_ TL46S6G_ 4000K**

Issue Date: 7/29/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P601395
 Test Lab: COOPER LIGHTING SOLUTIONS
 Issue Date: 7/29/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: HALO
 Catalog Number: ML4DM08LSAWW95FS1E - TIR4D25AWW - TL45R6G_ TL46S6G_ 4000K
 Description: DIRECT MOUNT, 25D WW OPTIC, LINEAR SPREAD LENS TRIM
 Light Source: (1) SELECTABLE LUMEN LED 95CRI / 4000K CCT
 Ballast/Driver: -

Summary

Lumens per Lamp: N/A
 Luminaire Lumens: 767.9 lumens
 Efficiency: N/A
 Efficacy: 74.6 lumens/watt
 Spacing Criteria (0/90/45): 1.21 / 0.78 / 1
 Luminous Opening: Circular (Dia: 0.21' x H: 0')
 CIE Type: Direct


Input Watts (W): 10.3
 Input Voltage (V): NR
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT



Meas		Calibration Due Date	
Instrument	Identificatio		
Photometer	GONIO 1 11111111	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P601395
CATALOG NUMBER: ML4DM08LSAWW95FS1E - TIR4D25AWW - TL45R6G_ TL46S6G_ 4000K

Luminous Intensity Polar Plot

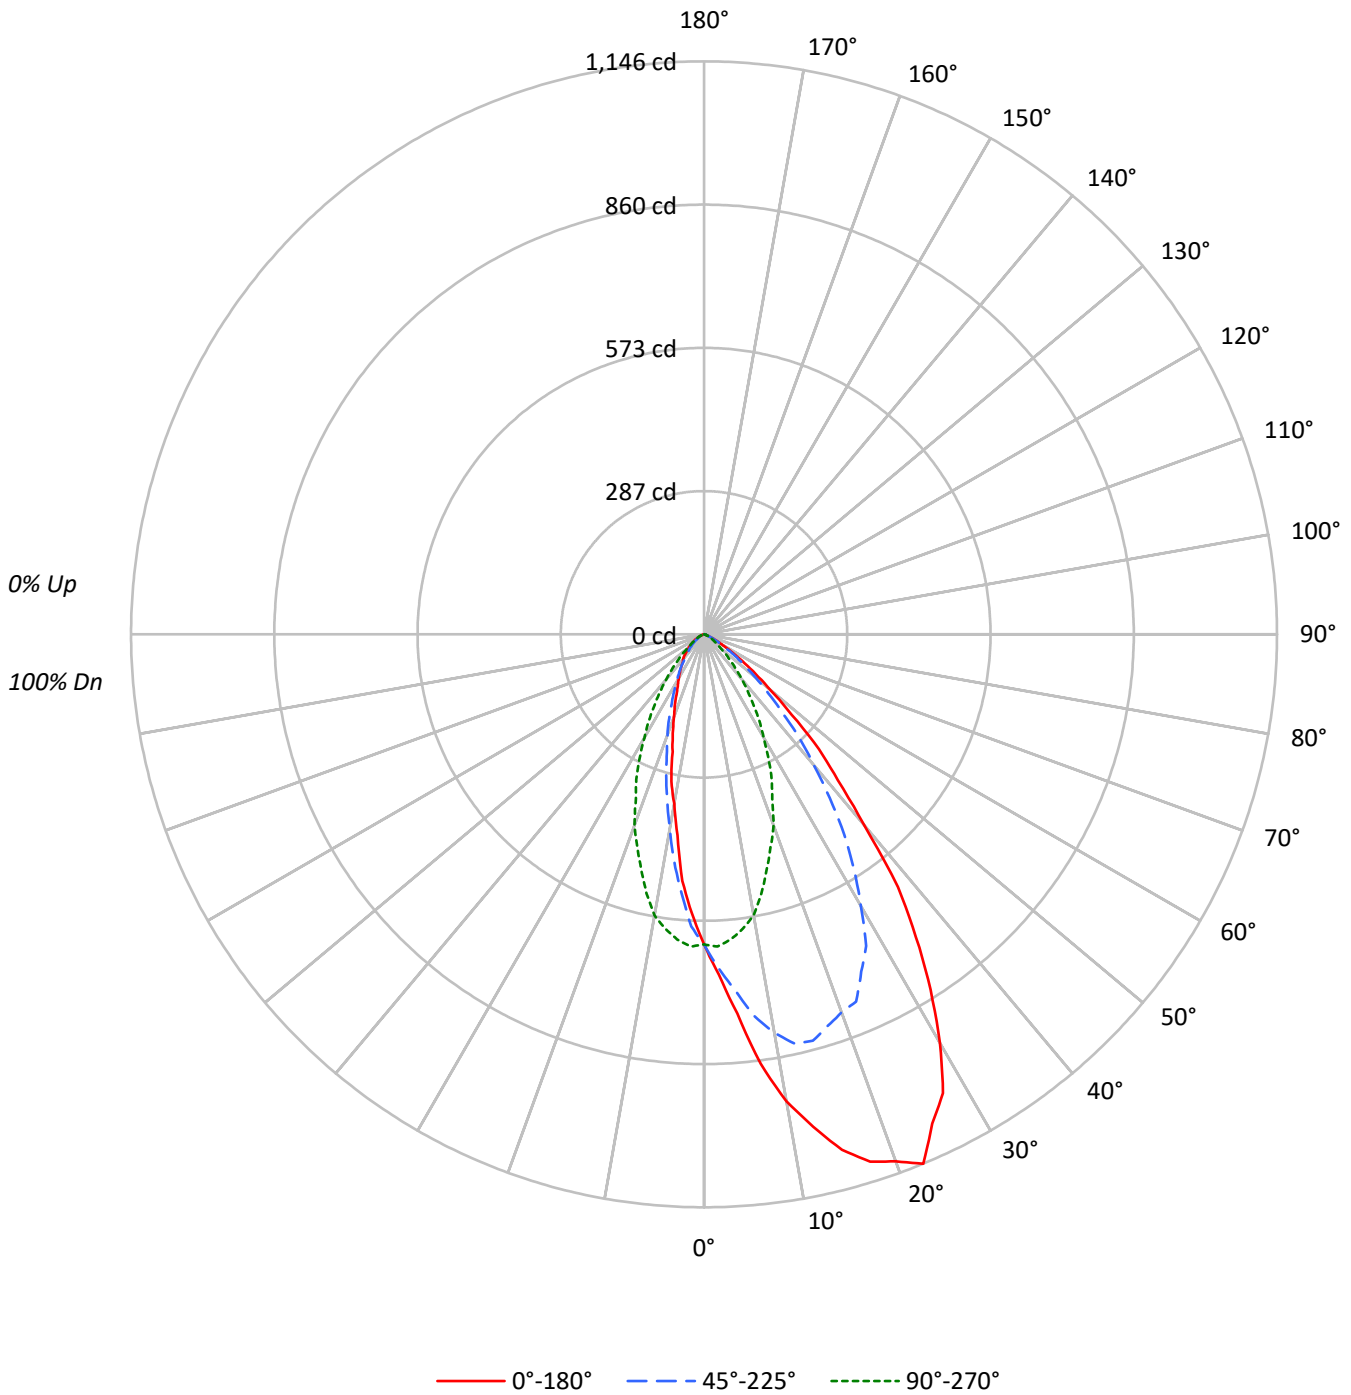

TEST NUMBER: P601395

CATALOG NUMBER: ML4DM08LSAWW95FS1E - TIR4D25AWW - TL45R6G_ TL46S6G_ 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	96	96	96	92		
1	113	110	107	104	110	107	105	103	103	101	99	100	98	96	96	95	94	92	92	91	88	84	80	83		
2	106	100	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83	83	80	78	76	76	76		
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76	76	73	73	72	72	69		
4	94	85	79	74	92	84	78	73	82	76	72	79	75	72	78	74	71	69	69	66	66	65	65	63		
5	88	78	72	67	86	77	71	67	76	70	66	74	69	65	72	68	65	63	63	61	61	60	60	58		
6	83	73	66	61	81	72	65	61	70	65	60	69	64	60	67	63	59	58	58	56	56	55	55	53		
7	78	68	61	56	77	67	60	56	65	60	55	64	59	55	63	58	55	53	53	51	51	51	51	51		
8	74	63	56	52	72	62	56	51	61	55	51	60	55	51	59	54	51	49	49	48	48	47	47	46		
9	70	59	52	48	68	58	52	48	57	52	47	56	51	47	55	51	47	46	46	44	44	44	44	44		
10	66	55	49	44	65	55	48	44	54	48	44	53	48	44	52	47	44	42	42	42	42	42	42	42		

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	195869	195869	195869
5°	241215	194177	156901
10°	304027	183019	110107
15°	348905	158777	79405
20°	376858	136697	58738
25°	376176	111560	44736
30°	344050	86851	36644
35°	285023	66187	30414
40°	204658	48475	26793
45°	145042	33135	22105
50°	85083	21271	18225
55°	51088	14479	14479
60°	27345	10736	10736
65°	15018	8069	6949
70°	8586	5724	4247
75°	3782	3782	0
80°	2728	2728	0
85°	0	0	0

TEST NUMBER: P601395
 CATALOG NUMBER: ML4DM08LSAWW95FS1E - TIR4D25AWW - TL45R6G_ TL46S6G_ 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	58.8	7.7
10°-20°	159.9	20.8
20°-30°	209.0	27.2
30°-40°	179.2	23.3
40°-50°	102.5	13.4
50°-60°	41.9	5.5
60°-70°	13.4	1.7
70°-80°	2.8	0.4
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	427.7	55.7
0°-40°	607.0	79.0
0°-60°	751.4	97.8
0°-90°	767.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	767.9	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	620	620	620	620	620	
5°	761	715	613	518	495	79
15°	1067	842	486	292	243	301
25°	1080	744	320	153	128	494
35°	739	489	172	80	79	456
45°	325	221	74	40	50	247
55°	93	76	26	19	26	88
65°	20	17	11	8	9	22
75°	3	3	3	2	0	4
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P601395

CATALOG NUMBER: ML4DM08LSAWW95FS1E - TIR4D25AWW - TL45R6G_ TL46S6G_ 4000K

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	45°	67.5°	90°	112.5°	135°
0°	620.3	620.3	620.3	620.3	620.3	620.3	620.3	620.3	620.3	620.3	620.3
2.5°	680.6	694.5	689.9	697.6	696.1	682.2	668.2	646.6	624.9	612.6	584.7
5°	761.0	778.1	790.4	781.2	776.5	765.7	714.6	666.7	612.6	558.4	518.2
7.5°	866.2	861.6	875.5	847.7	849.2	844.6	770.3	677.5	594.0	515.1	457.9
10°	948.2	934.3	948.2	938.9	920.4	898.7	809.0	672.9	570.8	471.8	394.4
12.5°	1008.5	1027.1	1027.1	1005.4	986.9	962.1	838.4	669.8	530.6	419.2	340.3
15°	1067.3	1073.5	1062.7	1045.7	1027.1	976.1	841.5	649.7	485.7	368.1	292.4
17.5°	1106.0	1107.5	1102.9	1087.4	1061.1	1030.2	821.4	631.1	443.9	327.9	245.9
20°	1121.5	1109.1	1107.5	1079.7	1056.5	1028.7	804.4	586.3	406.8	280.0	213.5
22.5°	1146.2	1116.8	1116.8	1089.0	1041.0	1036.4	795.1	535.2	355.8	239.8	182.5
25°	1079.7	1075.1	1084.3	1045.7	1008.5	1000.8	744.0	496.5	320.2	207.3	153.1
27.5°	1034.8	1022.5	1010.1	985.3	949.8	931.2	702.3	447.0	278.4	173.2	129.9
30°	943.6	943.6	928.1	915.7	867.8	853.9	628.0	400.6	238.2	148.5	108.3
32.5°	843.0	829.1	830.7	816.7	787.3	776.5	558.4	349.6	205.7	120.7	94.4
35°	739.4	723.9	716.2	705.4	700.7	666.7	488.8	301.6	171.7	105.2	80.4
37.5°	637.3	621.8	615.6	598.6	573.9	566.1	413.0	250.6	143.9	86.6	66.5
40°	496.5	496.5	495.0	476.4	468.7	464.1	341.9	208.8	117.6	69.6	57.2
42.5°	396.0	400.6	397.5	389.8	372.8	369.7	284.6	170.2	95.9	58.8	48.0
45°	324.8	310.9	307.8	306.3	297.0	295.4	221.2	134.6	74.2	48.0	40.2
47.5°	238.2	236.7	239.8	232.0	221.2	230.5	174.8	102.1	58.8	38.7	34.0
50°	173.2	176.3	176.3	168.6	165.5	168.6	134.6	77.3	43.3	30.9	29.4
52.5°	129.9	128.4	126.8	128.4	126.8	126.8	100.5	57.2	34.0	24.7	23.2
55°	92.8	92.8	91.3	94.4	95.9	92.8	75.8	41.8	26.3	20.1	18.6
57.5°	65.0	65.0	61.9	65.0	65.0	68.1	54.1	30.9	21.7	15.5	15.5
60°	43.3	43.3	43.3	44.9	46.4	46.4	37.1	21.7	17.0	12.4	12.4
62.5°	29.4	29.4	29.4	30.9	30.9	34.0	26.3	17.0	13.9	10.8	9.3
65°	20.1	20.1	20.1	20.1	21.7	21.7	17.0	12.4	10.8	9.3	7.7
67.5°	12.4	13.9	12.4	13.9	13.9	13.9	10.8	9.3	7.7	6.2	4.6
70°	9.3	9.3	9.3	9.3	9.3	9.3	7.7	7.7	6.2	4.6	3.1
72.5°	6.2	6.2	6.2	6.2	6.2	6.2	4.6	4.6	4.6	3.1	3.1
75°	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	1.5	1.5
77.5°	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	0.0
80°	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	0.0	0.0
82.5°	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P601395
 CATALOG NUMBER: ML4DM08LSAWW95FS1E - TIR4D25AWW - TL45R6G_ TL46S6G_ 4000K

CANDELA DISTRIBUTION (continued):

	157.5°	180°
0°	620.3	620.3
2.5°	569.2	558.4
5°	482.6	495.0
7.5°	420.7	405.3
10°	352.7	343.4
12.5°	306.3	301.6
15°	253.7	242.9
17.5°	218.1	207.3
20°	182.5	174.8
22.5°	156.2	151.6
25°	134.6	128.4
27.5°	116.0	112.9
30°	100.5	100.5
32.5°	86.6	89.7
35°	77.3	78.9
37.5°	66.5	69.6
40°	61.9	65.0
42.5°	52.6	58.8
45°	44.9	49.5
47.5°	38.7	43.3
50°	32.5	37.1
52.5°	29.4	32.5
55°	24.7	26.3
57.5°	20.1	21.7
60°	15.5	17.0
62.5°	12.4	13.9
65°	9.3	9.3
67.5°	6.2	7.7
70°	3.1	4.6
72.5°	1.5	1.5
75°	1.5	0.0
77.5°	0.0	0.0
80°	0.0	0.0
82.5°	0.0	0.0
85°	0.0	0.0
87.5°	0.0	0.0
90°	0.0	0.0

(END OF REPORT)