

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886616

Luminaire Tested: ML310LSFL95FS1E-TIR4D55WFL-TL3RDDB-850LM-5000K

Issue Date: 7/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P886616
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML310LSFL95FS1E-TIR4D55WFL-TL3RDDB-850LM-5000K
Description: 3IN ROUND ML FLEX, SELECTABLE CCT, WITH 55D TIR, MATTE BLACK TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1133.0 lumens
Efficiency: N/A
Efficacy: 83.3 lumens/watt
Spacing Criteria (0/90/45): 0.83 / 0.83 / 0.76
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 13.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P886616
CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDMB-850LM-5000K

Luminous Intensity Polar Plot

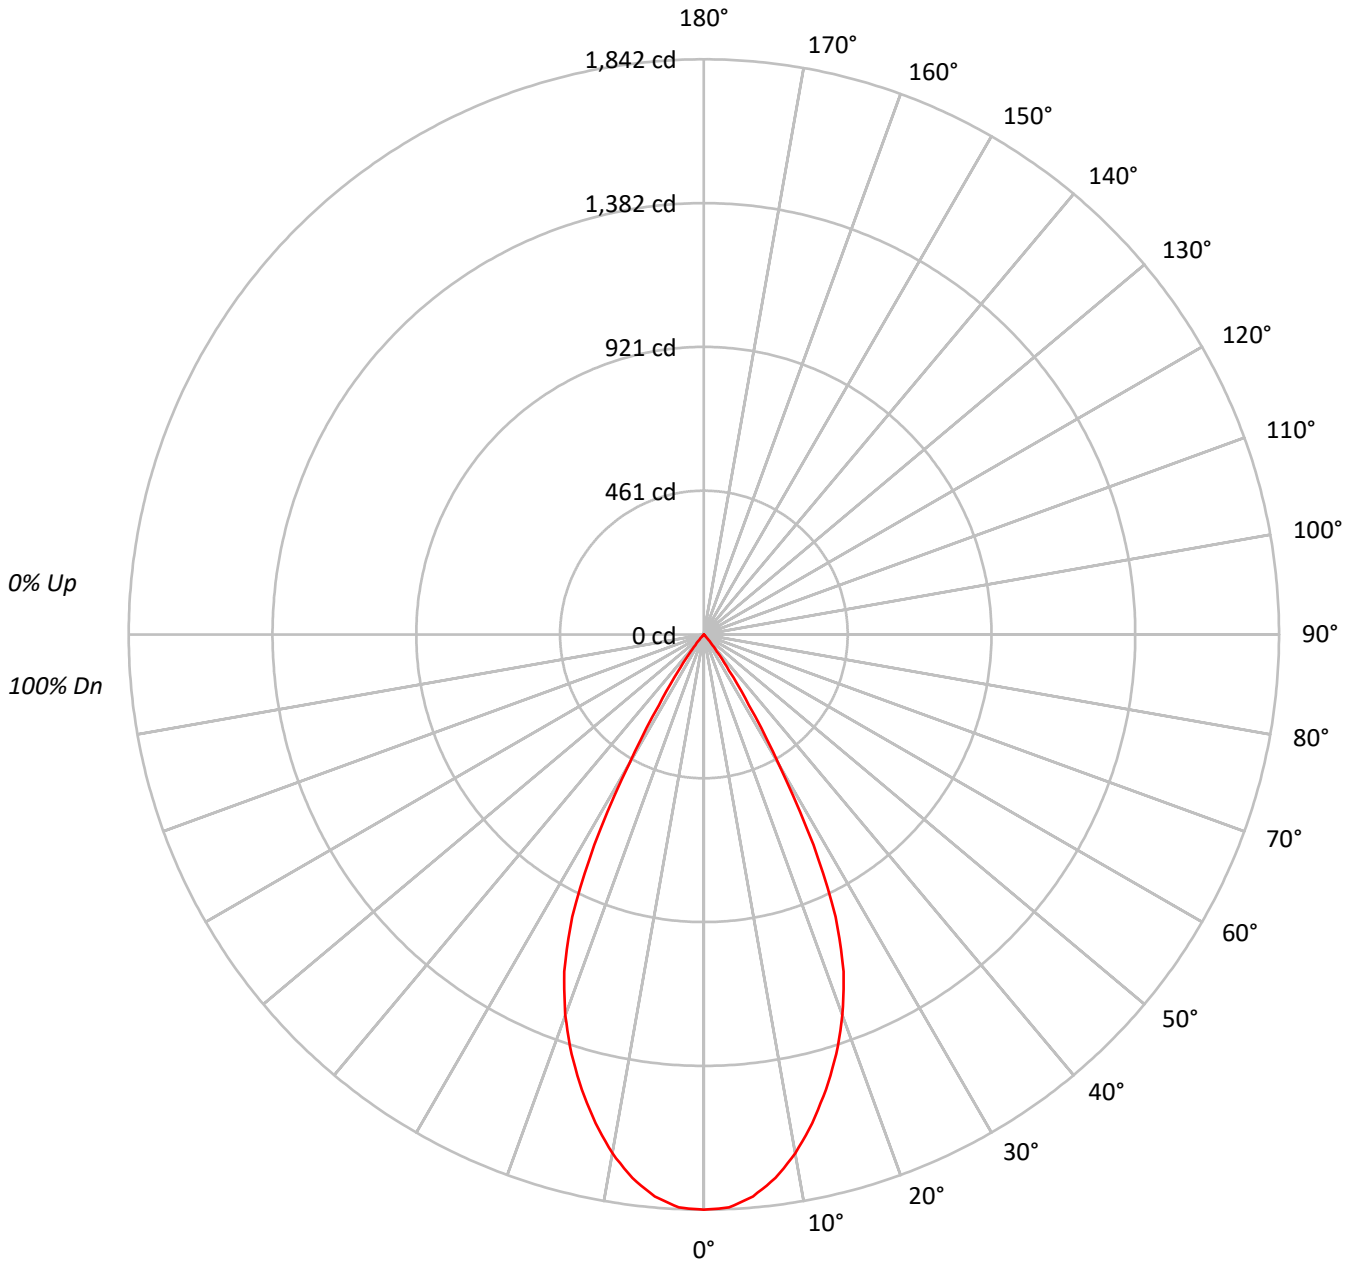



TEST NUMBER: P886616

CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDMB-850LM-5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	95	95	95
2	109	105	102	99	107	104	100	98	100	98	96	97	95	93	95	93	92	90	90	90	90
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	101	94	89	86	99	93	89	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	84	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	70	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	64	71	67	64	70	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	64	61	68	64	61	67	64	61	60	60	60	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	403937
5°	397600
10°	375678
15°	342590
20°	302730
25°	241466
30°	120601
35°	37798
40°	7843
45°	651
50°	0
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 651 cd/sqm



TEST NUMBER: P886616

CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDMB-850LM-5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	168.6	14.9
10°-20°	420.5	37.1
20°-30°	430.2	38.0
30°-40°	109.2	9.6
40°-50°	4.5	0.4
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1019.3	90.0
0°-40°	1128.5	99.6
0°-60°	1133.0	100.0
0°-90°	1133.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1133.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1842	
5°	1806	169
15°	1509	421
25°	998	430
35°	141	109
45°	2	4
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P886616

CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDMB-850LM-5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1842.1
2.5°	1836.9
5°	1806.3
7.5°	1755.7
10°	1687.2
12.5°	1602.9
15°	1509.1
17.5°	1409.0
20°	1297.3
22.5°	1168.7
25°	998.0
27.5°	759.8
30°	476.3
32.5°	268.7
35°	141.2
37.5°	67.4
40°	27.4
42.5°	7.4
45°	2.1
47.5°	1.1
50°	0.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)