

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886625

Luminaire Tested: ML310LSFL95FS1E-TIR4D55WFL-TL3RDSL-850LM-4000K

Issue Date: 7/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P886625
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-8)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML310LSFL95FS1E-TIR4D55WFL-TL3RDSL-850LM-4000K
Description: 3IN ROUND ML FLEX, SELECTABLE CCT, WITH 55D TIR, METALLIC SILVER TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 95CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1149.7 lumens
Efficiency: N/A
Efficacy: 84.5 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.76
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct


Input Watts (W): 13.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P886625

CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDSL-850LM-4000K

Luminous Intensity Polar Plot

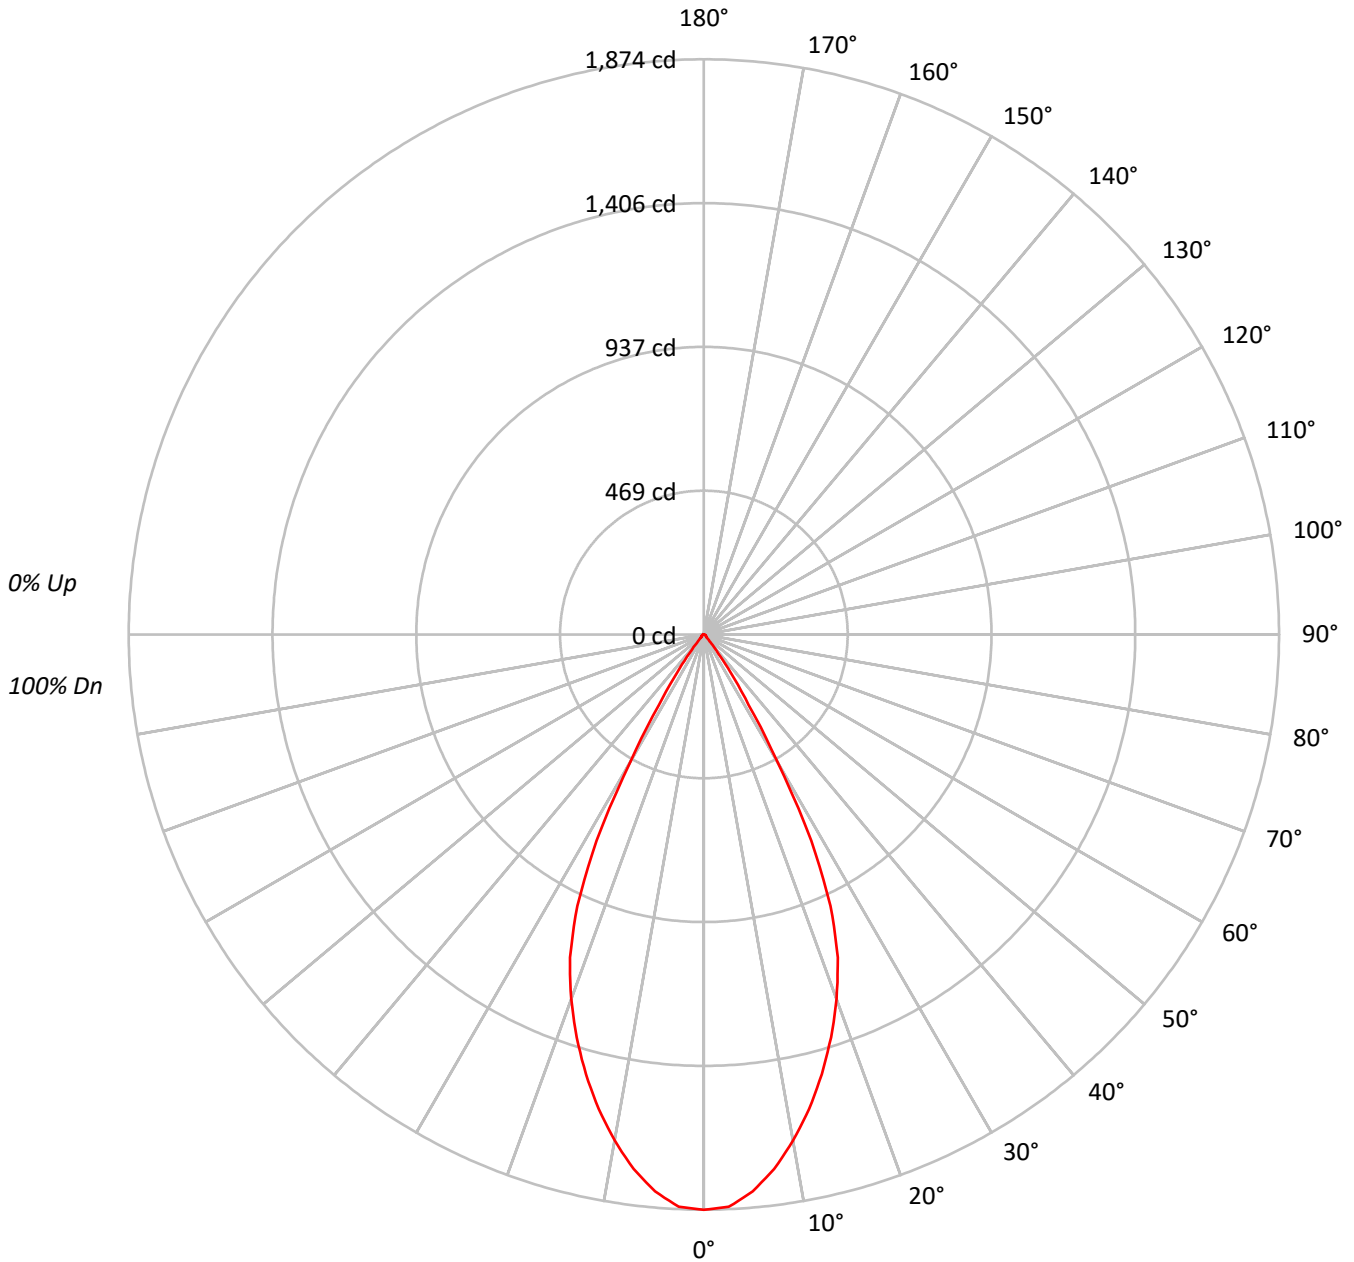



TEST NUMBER: P886625
 CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDSL-850LM-4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	109	107	112	109	107	105	105	104	102	102	100	99	98	97	96	94		
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	92	91	89		
3	104	99	94	90	102	97	93	90	95	91	88	92	89	87	90	88	86	84		
4	100	93	88	84	98	92	87	84	90	86	83	88	85	82	86	83	81	80		
5	96	88	83	79	94	87	82	79	85	81	78	84	80	77	82	79	77	75		
6	92	84	78	74	90	83	78	74	81	77	74	80	76	73	79	75	73	71		
7	88	79	74	70	86	79	74	70	78	73	70	76	72	69	75	72	69	68		
8	84	76	70	67	83	75	70	67	74	70	66	73	69	66	72	68	66	65		
9	81	72	67	63	80	72	67	63	71	66	63	70	66	63	69	65	63	61		
10	78	69	64	60	77	68	64	60	68	63	60	67	63	60	66	62	60	59		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	411042
5°	400901
10°	372716
15°	336733
20°	294889
25°	236094
30°	120626
35°	39993
40°	10620
45°	3721
50°	3411
55°	3441
60°	3508
65°	3113
70°	3206
75°	3389
80°	3788
85°	2516

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 80°
 Luminance: 3788 cd/sqm



TEST NUMBER: P886625

CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDSL-850LM-4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	169.1	14.7
10°-20°	413.1	35.9
20°-30°	422.5	36.8
30°-40°	113.4	9.9
40°-50°	11.9	1.0
50°-60°	7.8	0.7
60°-70°	6.3	0.5
70°-80°	4.2	0.4
80°-90°	1.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1004.7	87.4
0°-40°	1118.2	97.3
0°-60°	1137.9	99.0
0°-90°	1149.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1149.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1874	
5°	1821	169
15°	1483	413
25°	976	423
35°	149	113
45°	12	12
55°	9	8
65°	6	6
75°	4	4
85°	1	1
90°	0	



TEST NUMBER: P886625

CATALOG NUMBER: ML310LSFL95FS1E-TIR4D55WFL-TL3RDSL-850LM-4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1874.5
2.5°	1866.4
5°	1821.3
7.5°	1756.1
10°	1673.9
12.5°	1583.6
15°	1483.3
17.5°	1377.0
20°	1263.7
22.5°	1139.3
25°	975.8
27.5°	757.2
30°	476.4
32.5°	271.8
35°	149.4
37.5°	77.2
40°	37.1
42.5°	16.0
45°	12.0
47.5°	11.0
50°	10.0
52.5°	9.0
55°	9.0
57.5°	8.0
60°	8.0
62.5°	7.0
65°	6.0
67.5°	6.0
70°	5.0
72.5°	5.0
75°	4.0
77.5°	3.0
80°	3.0
82.5°	2.0
85°	1.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)