

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P886721

Luminaire Tested: ML310LSFL9FS1E-TIR4D40FL-TL3RDMW-1000LM-5000K

Issue Date: 7/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P886721
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2402-314-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML310LSFL9FS1E-TIR4D40FL-TL3RDMW-1000LM-5000K
Description: 3IN ROUND ML FLEX, SELECTABLE CCT, WITH 40D TIR, MATTE WHITE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1389.3 lumens
Efficiency: N/A
Efficacy: 100.7 lumens/watt
Spacing Criteria (0/90/45): 0.67 / 0.67 / 0.62
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct


Input Watts (W): 13.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P886721

CATALOG NUMBER: ML310LSFL9FS1E-TIR4D40FL-TL3RDMW-1000LM-5000K

Luminous Intensity Polar Plot

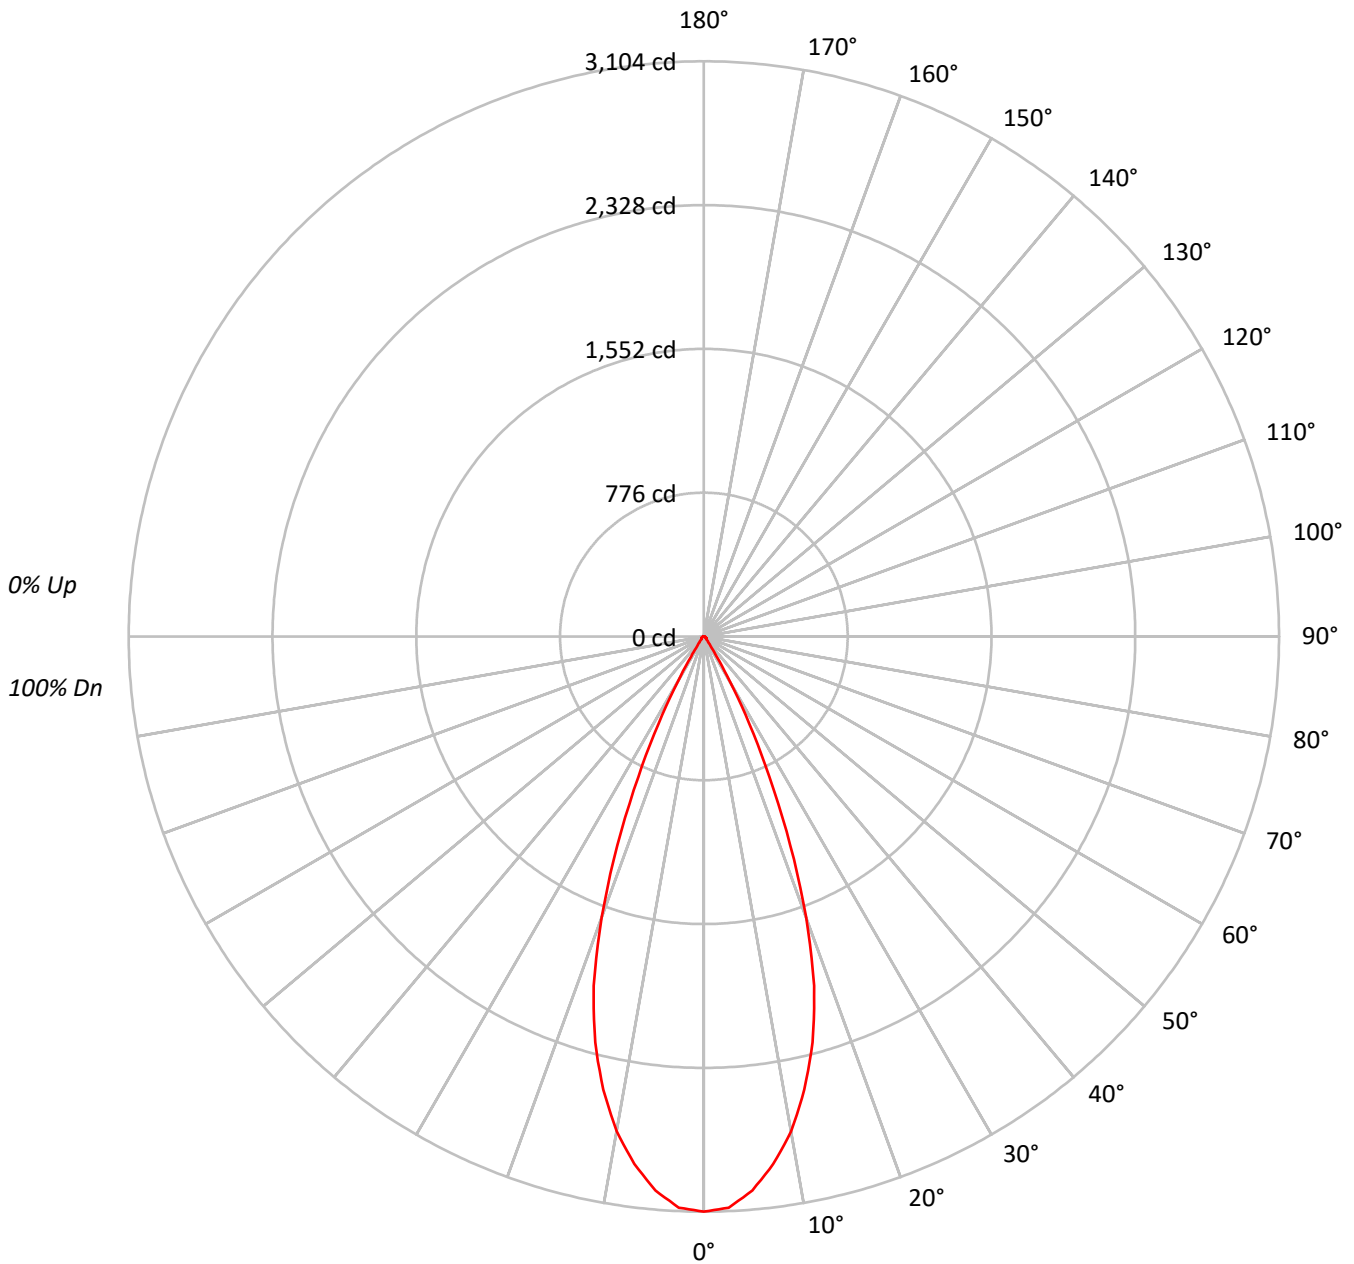



TEST NUMBER: P886721

CATALOG NUMBER: ML310LSFL9FS1E-TIR4D40FL-TL3RDMW-1000LM-5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20		
RC	80				70				50				30				10		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30
RCR																			
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	95
2	110	105	102	99	108	104	101	98	101	98	96	98	96	94	95	93	92	90	90
3	105	100	96	92	103	99	95	92	96	93	90	94	91	89	92	89	87	86	86
4	101	95	90	87	100	94	90	86	92	88	85	90	87	84	88	86	83	82	82
5	97	91	86	82	96	90	85	82	88	84	81	86	83	80	85	82	80	79	79
6	94	87	82	78	93	86	81	78	84	80	77	83	80	77	82	79	76	75	75
7	91	83	78	75	89	82	78	74	81	77	74	80	76	74	79	76	73	72	72
8	87	80	75	71	86	79	74	71	78	74	71	77	73	71	76	73	70	69	69
9	84	76	72	68	83	76	71	68	75	71	68	74	71	68	74	70	68	67	67
10	81	74	69	66	81	73	69	66	72	68	65	72	68	65	71	68	65	64	64

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	680603
5°	660509
10°	603641
15°	514714
20°	376073
25°	202100
30°	70416
35°	16758
40°	7958
45°	5396
50°	5151
55°	5773
60°	5570
65°	6019
70°	5963
75°	5931
80°	5809
85°	5787

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 87.5°
 Luminance: 6033 cd/sqm



TEST NUMBER: P886721

CATALOG NUMBER: ML310LSFL9FS1E-TIR4D40FL-TL3RDMW-1000LM-5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	277.1	19.9
10°-20°	615.8	44.3
20°-30°	390.1	28.1
30°-40°	57.7	4.2
40°-50°	14.4	1.0
50°-60°	13.0	0.9
60°-70°	11.3	0.8
70°-80°	7.3	0.5
80°-90°	2.5	0.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1283.0	92.4
0°-40°	1340.7	96.5
0°-60°	1368.1	98.5
0°-90°	1389.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1389.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3104	
5°	3001	277
15°	2267	616
25°	835	390
35°	63	58
45°	17	14
55°	15	13
65°	12	11
75°	7	7
85°	2	3
90°	0	



TEST NUMBER: P886721

CATALOG NUMBER: ML310LSFL9FS1E-TIR4D40FL-TL3RDMW-1000LM-5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	3103.8
2.5°	3085.2
5°	3000.7
7.5°	2870.9
10°	2711.0
12.5°	2504.8
15°	2267.3
17.5°	1976.5
20°	1611.6
22.5°	1218.8
25°	835.3
27.5°	530.6
30°	278.1
32.5°	127.4
35°	62.6
37.5°	41.7
40°	27.8
42.5°	19.7
45°	17.4
47.5°	16.2
50°	15.1
52.5°	15.1
55°	15.1
57.5°	13.9
60°	12.7
62.5°	12.7
65°	11.6
67.5°	10.4
70°	9.3
72.5°	8.1
75°	7.0
77.5°	5.8
80°	4.6
82.5°	3.5
85°	2.3
87.5°	1.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)