

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P640329

Luminaire Tested: ML5609LSFL40D2W1E - 692W - 900LM - 2700K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P640329
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-39)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5609LSFL40D2W1E - 692W - 900LM - 2700K
Description: ML56 RR, 40D TIR OPTIC, 6" WHITE TRIM
Light Source: (1) D2W SELECTABLE LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1149.8 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 11.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P640329
CATALOG NUMBER: ML5609LSFL40D2W1E - 692W - 900LM - 2700K

Luminous Intensity Polar Plot

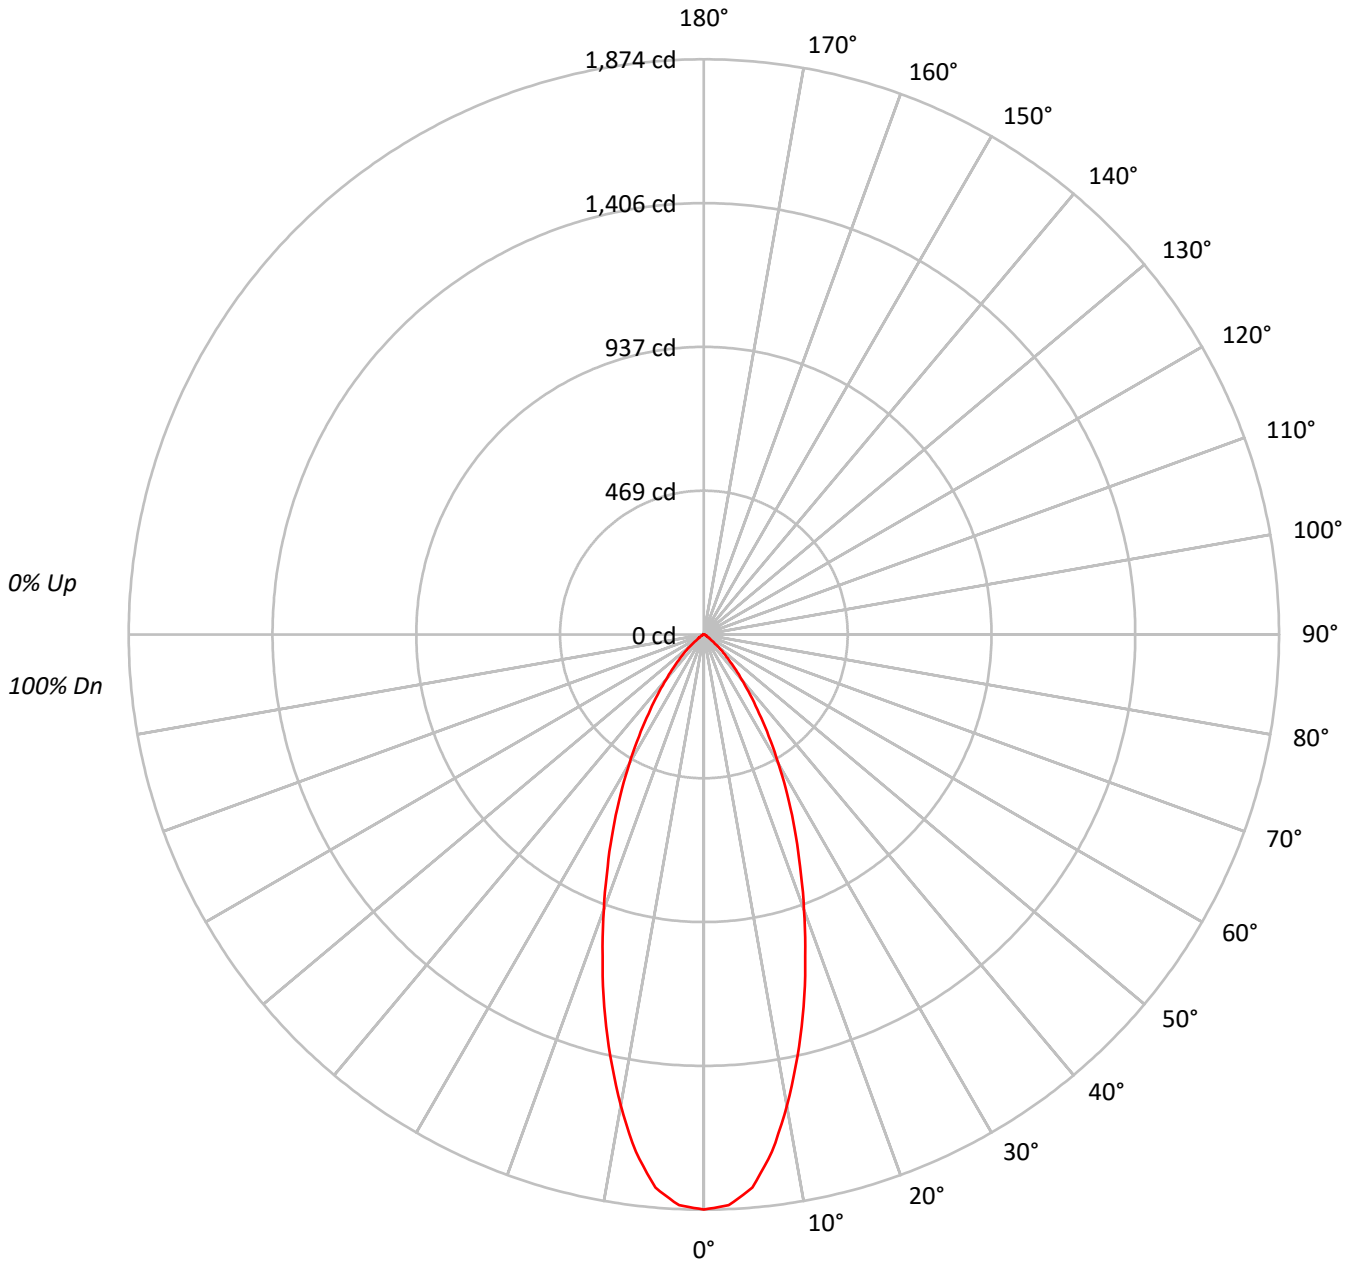



TEST NUMBER: P640329

CATALOG NUMBER: ML5609LSFL40D2W1E - 692W - 900LM - 2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	98	96	95	94			94
2	108	103	99	96	106	102	98	95	98	95	93	95	93	91	93	91	89	87			87
3	103	96	92	88	101	95	91	87	92	89	86	90	87	84	88	85	83	81			81
4	98	90	85	81	96	89	84	80	87	83	79	85	81	78	83	80	78	76			76
5	93	85	79	75	91	84	79	75	82	78	74	81	76	73	79	75	73	71			71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67			67
7	84	75	70	65	83	75	69	65	73	69	65	72	68	65	71	67	64	63			63
8	81	71	66	62	79	71	65	61	70	65	61	69	64	61	68	64	61	59			59
9	77	68	62	58	76	67	62	58	66	61	58	65	61	58	65	60	57	56			56
10	74	64	59	55	73	64	58	55	63	58	55	62	58	55	62	57	54	53			53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	102711
5°	99565
10°	86755
15°	71249
20°	55614
25°	42311
30°	30682
35°	21021
40°	13647
45°	8482
50°	4452
55°	2017
60°	1316
65°	778
70°	481
75°	424
80°	631
85°	629

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8482 cd/sqm



TEST NUMBER: P640329

CATALOG NUMBER: ML5609LSFL40D2W1E - 692W - 900LM - 2700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	164.4	14.3
10°-20°	346.7	30.2
20°-30°	320.6	27.9
30°-40°	199.3	17.3
40°-50°	87.6	7.6
50°-60°	21.6	1.9
60°-70°	6.3	0.5
70°-80°	2.5	0.2
80°-90°	0.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	831.8	72.3
0°-40°	1031.1	89.7
0°-60°	1140.2	99.2
0°-90°	1149.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1149.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1874	
5°	1809	164
15°	1255	347
25°	700	321
35°	314	199
45°	109	88
55°	21	22
65°	6	6
75°	2	3
85°	1	1
90°	0	



TEST NUMBER: P640329

CATALOG NUMBER: ML5609LSFL40D2W1E - 692W - 900LM - 2700K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1873.6
2.5°	1861.5
5°	1809.3
7.5°	1700.0
10°	1558.5
12.5°	1407.9
15°	1255.4
17.5°	1097.9
20°	953.3
22.5°	818.9
25°	699.5
27.5°	588.1
30°	484.7
32.5°	393.4
35°	314.1
37.5°	246.9
40°	190.7
42.5°	147.5
45°	109.4
47.5°	81.3
50°	52.2
52.5°	28.1
55°	21.1
57.5°	16.1
60°	12.0
62.5°	9.0
65°	6.0
67.5°	3.0
70°	3.0
72.5°	3.0
75°	2.0
77.5°	2.0
80°	2.0
82.5°	1.0
85°	1.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)