

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P640551

Luminaire Tested: ML5612LSFL4097FS1E - 591WB - 900LM - 2700K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P640551
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-24)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSFL4097FS1E - 591WB - 900LM - 2700K
Description: ML56 RR, 40D TIR OPTIC, 5" DEADFRONT TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1243.8 lumens
Efficiency: N/A
Efficacy: 93.5 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P640551

CATALOG NUMBER: ML5612LSFL4097FS1E - 591WB - 900LM - 2700K

Luminous Intensity Polar Plot

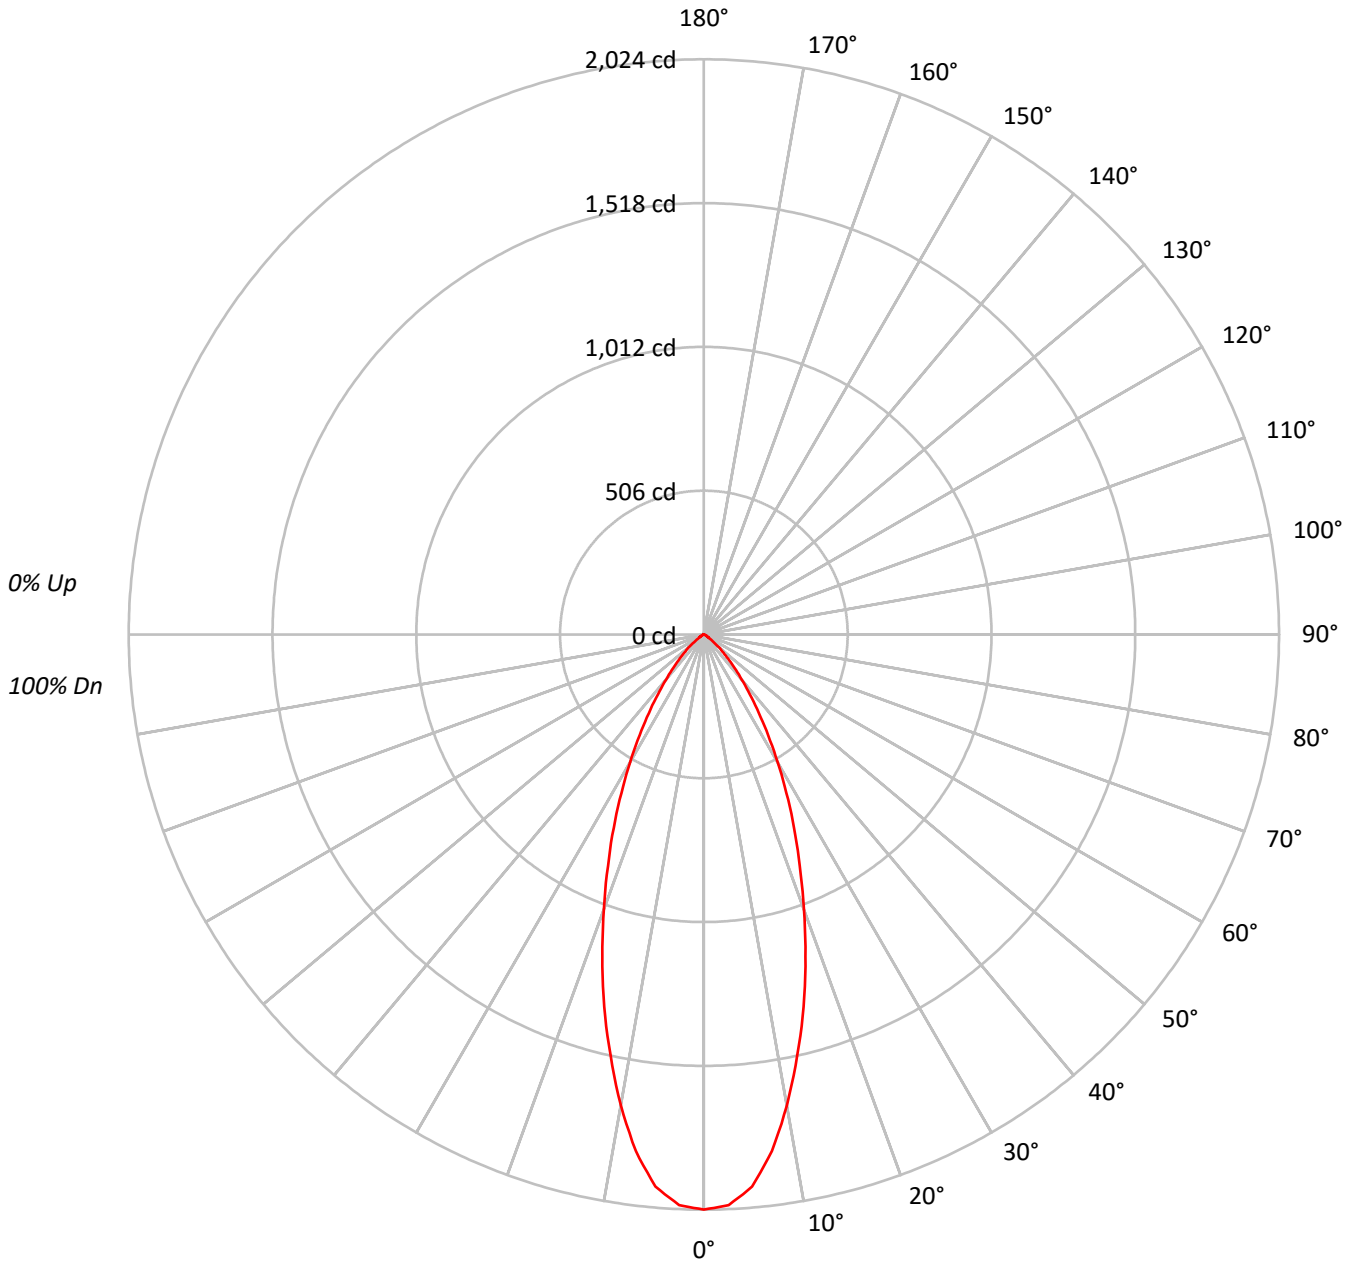



TEST NUMBER: P640551

CATALOG NUMBER: ML5612LSFL4097FS1E - 591WB - 900LM - 2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 114 | 111 | 108 | 106 | 111 | 109 | 106 | 104 | 105 | 103 | 101 | 101 | 99 | 98 | 97 | 96 | 95 | 94 | | | |
| 2 | 108 | 103 | 99 | 96 | 106 | 101 | 98 | 95 | 98 | 95 | 93 | 95 | 93 | 91 | 93 | 91 | 89 | 87 | | | |
| 3 | 103 | 96 | 91 | 88 | 101 | 95 | 90 | 87 | 92 | 89 | 85 | 90 | 87 | 84 | 88 | 85 | 83 | 81 | | | |
| 4 | 98 | 90 | 85 | 81 | 96 | 89 | 84 | 80 | 87 | 83 | 79 | 85 | 81 | 78 | 83 | 80 | 77 | 76 | | | |
| 5 | 93 | 85 | 79 | 75 | 91 | 84 | 78 | 74 | 82 | 77 | 74 | 80 | 76 | 73 | 79 | 75 | 72 | 71 | | | |
| 6 | 88 | 80 | 74 | 70 | 87 | 79 | 73 | 69 | 77 | 73 | 69 | 76 | 72 | 69 | 75 | 71 | 68 | 67 | | | |
| 7 | 84 | 75 | 69 | 65 | 83 | 75 | 69 | 65 | 73 | 68 | 65 | 72 | 68 | 64 | 71 | 67 | 64 | 63 | | | |
| 8 | 80 | 71 | 65 | 61 | 79 | 71 | 65 | 61 | 70 | 65 | 61 | 69 | 64 | 61 | 68 | 63 | 60 | 59 | | | |
| 9 | 77 | 67 | 62 | 58 | 76 | 67 | 62 | 58 | 66 | 61 | 58 | 65 | 61 | 57 | 64 | 60 | 57 | 56 | | | |
| 10 | 74 | 64 | 59 | 55 | 73 | 64 | 58 | 55 | 63 | 58 | 55 | 62 | 58 | 54 | 61 | 57 | 54 | 53 | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 159761 |
| 5° | 154578 |
| 10° | 134851 |
| 15° | 110828 |
| 20° | 86334 |
| 25° | 65379 |
| 30° | 47336 |
| 35° | 32486 |
| 40° | 21249 |
| 45° | 13397 |
| 50° | 7774 |
| 55° | 3303 |
| 60° | 2242 |
| 65° | 1420 |
| 70° | 762 |
| 75° | 671 |
| 80° | 1000 |
| 85° | 996 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13397 cd/sqm



TEST NUMBER: P640551

CATALOG NUMBER: ML5612LSFL4097FS1E - 591WB - 900LM - 2700K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 177.4 | 14.3 |
| 10°-20° | 374.4 | 30.1 |
| 20°-30° | 344.2 | 27.7 |
| 30°-40° | 213.7 | 17.2 |
| 40°-50° | 95.8 | 7.7 |
| 50°-60° | 26.6 | 2.1 |
| 60°-70° | 8.1 | 0.6 |
| 70°-80° | 2.5 | 0.2 |
| 80°-90° | 1.2 | 0.1 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 896.0 | 72.0 |
| 0°-40° | 1109.6 | 89.2 |
| 0°-60° | 1232.1 | 99.1 |
| 0°-90° | 1243.8 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1243.8 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2024 | |
| 5° | 1951 | 177 |
| 15° | 1356 | 374 |
| 25° | 751 | 344 |
| 35° | 337 | 214 |
| 45° | 120 | 96 |
| 55° | 24 | 27 |
| 65° | 8 | 8 |
| 75° | 2 | 2 |
| 85° | 1 | 1 |
| 90° | 0 | |



TEST NUMBER: P640551

CATALOG NUMBER: ML5612LSFL4097FS1E - 591WB - 900LM - 2700K

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 2023.8 |
| 2.5° | 2009.6 |
| 5° | 1950.7 |
| 7.5° | 1834.0 |
| 10° | 1682.3 |
| 12.5° | 1517.6 |
| 15° | 1356.1 |
| 17.5° | 1188.1 |
| 20° | 1027.7 |
| 22.5° | 881.5 |
| 25° | 750.6 |
| 27.5° | 628.4 |
| 30° | 519.3 |
| 32.5° | 420.0 |
| 35° | 337.1 |
| 37.5° | 265.1 |
| 40° | 206.2 |
| 42.5° | 159.3 |
| 45° | 120.0 |
| 47.5° | 88.4 |
| 50° | 63.3 |
| 52.5° | 39.3 |
| 55° | 24.0 |
| 57.5° | 18.5 |
| 60° | 14.2 |
| 62.5° | 10.9 |
| 65° | 7.6 |
| 67.5° | 5.5 |
| 70° | 3.3 |
| 72.5° | 2.2 |
| 75° | 2.2 |
| 77.5° | 2.2 |
| 80° | 2.2 |
| 82.5° | 1.1 |
| 85° | 1.1 |
| 87.5° | 1.1 |
| 90° | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)